


- 14 RECEPTACLE AND COVERPLATES FOR WALKIES SHALL BE WHITE IN COLOR. REFER TO DETAIL D/SD4.2 FOR MOUNTING.
- 17 EXISTING GFI DUPLEX RECEPTACLE AND COVERPLATE FOR RESTROOM TO REMAIN AND BE RECONNECT TO NEAR CIRCUIT AS SHOWN.
- 18 ELECTRIC WATER COOLER GFI RECEPTACLE AND COVERPLATE SHALL BE WHITE IN COLOR. MOUNT AT 18" A.F.F.
- 20 30 AMP, 250 VOLT, 3 PHASE TWIST-LOCK RECEPTACLE AND STAINLESS STEEL COVERPLATE FOR DREAMSTEAMER.
- 23 TELEPHONE OUTLET IN HALL SHALL BE THE COLOR AS DESIGNATED IN THE SPECIFICATIONS. INSTALL EMPTY 3/4" CONDUIT, WITH PULLWIRE, BACK TO IT SECTION OF IPS. ENCLOSURE WIRE AND #RJ4C JACK FOR TWO LINE TELEPHONE BY OTHERS. MOUNT AS NOTED ON PLANS AND DETAILS.
- 24 SOUND SYSTEM, FURNISH AND INSTALL ALL CONDUITS AND PERFORM ALL WORK AS INDICATED IN THE DETAIL.
- 25 FURNISH AND INSTALL A 3/4" CONDUIT WITH PULLWIRE FROM HVAC SECTION OF IPS ENCLOSURE, UP TO UNIT IT SERVES. COORDINATE EXACT REQUIREMENT WITH MECHANICAL CONTRACTOR.
- 29 IPS ENCLOSURE, ALL CONDUITS STUBBED INTO IPS ENCLOSURE SHALL BE INSTALLED IN A CLEAN AND NEAT MANNER. ANCHOR IPS ENCLOSURE ACCORDING TO MANUFACTURERS SPECIFICATIONS AND LOCAL CODES IN SEISMIC AREAS. REFER TO SPECIFICATIONS AND E051 FOR MORE INFORMATION.
- 34 EXTEND 1" TELEPHONE CONDUIT FROM SERVICE ENTRANCE AT DENISING WALL TO DEPHARC ON TELEPHONE BOARD.
- 35 REGISTER CASHWRAP/BACKWRAP COUNTER. PERFORM ALL WORK AS INDICATED IN THE DETAIL.
- 36 SAW CUT/GORE DRILL FLOOR SLAB FOR UNDERSLAB CONDUIT, PATCH AS REQUIRED. COORDINATE WITH LANDLORD.
- 37 REGISTER (POS) SHALL SHARE A 20 AMP, 120 VOLT DEDICATED CIRCUIT AND UTILITY POWER (UP) SHALL SHARE A 20 AMP, 120 VOLT CIRCUIT. STUB UP 1/2" CONDUIT FROM STUB-UP TO WALL/ON 4X4 J-BOX FOR DATA AND TELEPHONE. CUT AND PATCH FLOOR AS REQUIRED TO QUAD RECEPTABLES. CUT AND PATCH FLOOR AS REQUIRED TO ROUTE CONDUIT TO WALL AS SHOWN. ROUTE UP INSIDE WALL TO CEILING SPACE AND CONNECT TO PANEL LOCATED INSIDE IPS ENCLOSURE. REFER TO POWER PLAN AND PANEL SCHEDULES FOR CIRCUIT DESIGNATIONS.
- 38 DATA OUTLET LOCATED AT EACH REGISTER IN CASHWRAP. CAT 5E CABLE AND #RJ4C JACK. STUB UP 1" CONDUIT 1" A.F.F. WHERE SHOWN ON DETAIL. INSTALL 1/2" CONDUIT FROM STUB-UP TO WALL/ON 4X4 J-BOX FOR DATA AND TELEPHONE. CUT AND PATCH FLOOR AS REQUIRED TO QUAD RECEPTABLES. CUT AND PATCH FLOOR AS REQUIRED TO ROUTE CONDUIT TO WALL AS SHOWN. ROUTE UP INSIDE WALL TO CEILING SPACE AND CONNECT TO L.V. SECTION OF THE IPS. WIRE FOR DATA LINES TO BE PULLED AND CONNECTED BY P.O.S. CONTRACTOR.
- 39 TELEPHONE OUTLET BEHIND CURTAIN ABOVE BACKWRAP. TELEPHONE WIRE AND #RJ4C JACK BY OTHERS.
- 40 ALARM BOX, J-BOX AND 1" CONDUIT STUBBED UP AND OUT OF WALL, OPEN CEILINGS, INSTALL BOX 12" ABOVE TRACK LIGHTING SYSTEM. HARD CEILING, INSTALL BOX 6" BELOW CEILING BY ELECTRICAL CONTRACTOR, CABLE AND ALARM BOX BY CHECKPOINT. SEE POWER PLANS FOR LOCATION, COORDINATE WITH MECHANICAL CONTRACTOR.
- 41 ENCLOSURE WITH SENSORIMATIC POWER PACK AND ISOLATED GROUND TYPE DUPLEX RECEPTACLE MOUNTED ABOVE ENTRY PORTAL AT 14'-0" A.F.F. PAINT EQUIPMENT TO MATCH. (DO NOT MOUNT ON PORTAL). COORDINATE SENSORIMATIC FREQUENCY WITH ADJACENT TENANT SENSORIMATIC SYSTEMS. PAINT ENCLOSURE TO MATCH WALL.

- EXPRESS**
EXPRESS FASHION OPERATIONS, LLC
161/a STORE DESIGN & CONSTRUCTION
Express Drive Columbus, Ohio 43250
Telephone: 614.474.4001 Express.com

D

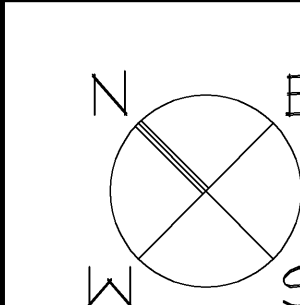

1/4"-1'-0"

**ELECTRICAL
POWER
PLAN**

DRAWING NUMBER:
E02.1