

NOTE:
LENGTH OF FLEXIBLE METAL CONDUIT, MC TYPE CABLE, OR
AC90(CANADA) IS NOT TO EXCEED 6'-0".

NOTE:
REFER TO SHEET ED4.01 FOR ELECTRICAL LIGHTING SCHEDULE,
LIGHT DESCRIPTIONS, AND CONSTRUCTION NOTES.

NOTE:
REFER TO SHEET E05.01 FOR PANEL SCHEDULE AND LIGHTING
ZONE DESIGNATIONS.

NOTE:
ELECTRICAL CONTRACTOR SHALL REFER TO ARCHITECTURAL SHEETS
FOR MOUNTING HEIGHTS AND INSTALLATION DETAILS FOR
SUSPENDED LIGHTING IN NON-SALES AREA.

NOTE:
GENERAL CONTRACTOR SHALL VERIFY CEILING FIRE RATING WITH
ARCHITECT, AND BOX OR TENT ALL RECESSED LIGHT FIXTURES, IF
REQUIRED, TO MAINTAIN CEILING FIRE RATING.


- ELECTRICAL CONTRACTOR SHALL INSTALL OCCUPANCY MOTION SENSOR SWITCH FOR CONTROL OF LIGHTS AS SHOWN. ELECTRICAL CONTRACTOR SHALL SET SWITCH FOR 15 MINUTES. MOUNT AT 44" AFF.
 - BREAK-OFF CIRCUIT.
 - JUNCTION BOX INSTALLED AT THE CENTERLINE OR MOUNTING PLATE OF WALL SCONCE. SEE ARCHITECTURAL DRAWINGS FOR MOUNTING HEIGHTS.
 - LOCATE RF ANTENNA ABOVE CEILING IN ACCESSIBLE LOCATION WITHIN REACH OF ACCESS POINT. MOUNT TO BOTTOM OF STRUCTURE IF POSSIBLE. PROVIDE 1/2" CONDUIT TO ITS PANEL FOR A GROUP OF (4) RF ANTENNAS.
 - FURNISH AND INSTALL JUNCTION BOX, TOGGLE DISCONNECT SWITCH IN NON-VISIBLE LOCATION. FINAL CONNECTION FOR 120 VOLT SIGN AND CONDUIT PER DETAIL. SIGN IS FURNISHED WITH INTERNAL GROUND FAULT PROTECTION BY SIGN MANUFACTURER PER N.E.C. ARTICLE 600-238. VERIFY EXACT LOCATION OF JUNCTION BOX WITH SIGN MANUFACTURER. (REUSE EXISTING JUNCTION BOX AND CONDUIT INTO SPACE IF ALREADY INSTALLED. VERIFY IN FIELD EXACT LOCATION ON CANOPY).
- NOTE:
THE CIRCUIT FOR SIGNAGE MUST BE A DEDICATED ISOLATED 3-LINE CIRCUIT CONSISTING OF HOT, NEUTRAL, AND GROUND WIRES LEADING DIRECTLY TO THE PANEL.
- REFER TO SHEET E02.01 FOR POWER REQUIREMENTS.
 - LIGHT FIXTURES TO BE INSTALLED IN MILLWORK FIXTURE, NOT IN CEILING. VERIFY WITH LSD&C.
 - LIGHT FIXTURES ARE MOUNTED TO A MOVABLE ACCESS PANEL. INSTALL WITH ENOUGH SLACK TO ALLOW THE PANEL TO FULLY OPEN AND NOT PUT EXCESS TENSION ON THE WIRE. REFER TO ARCHITECTURAL DRAWINGS FOR MORE INFORMATION.

ELECTRICAL LIGHTING PLAN KEYNOTES

NTS

D

09/25/12

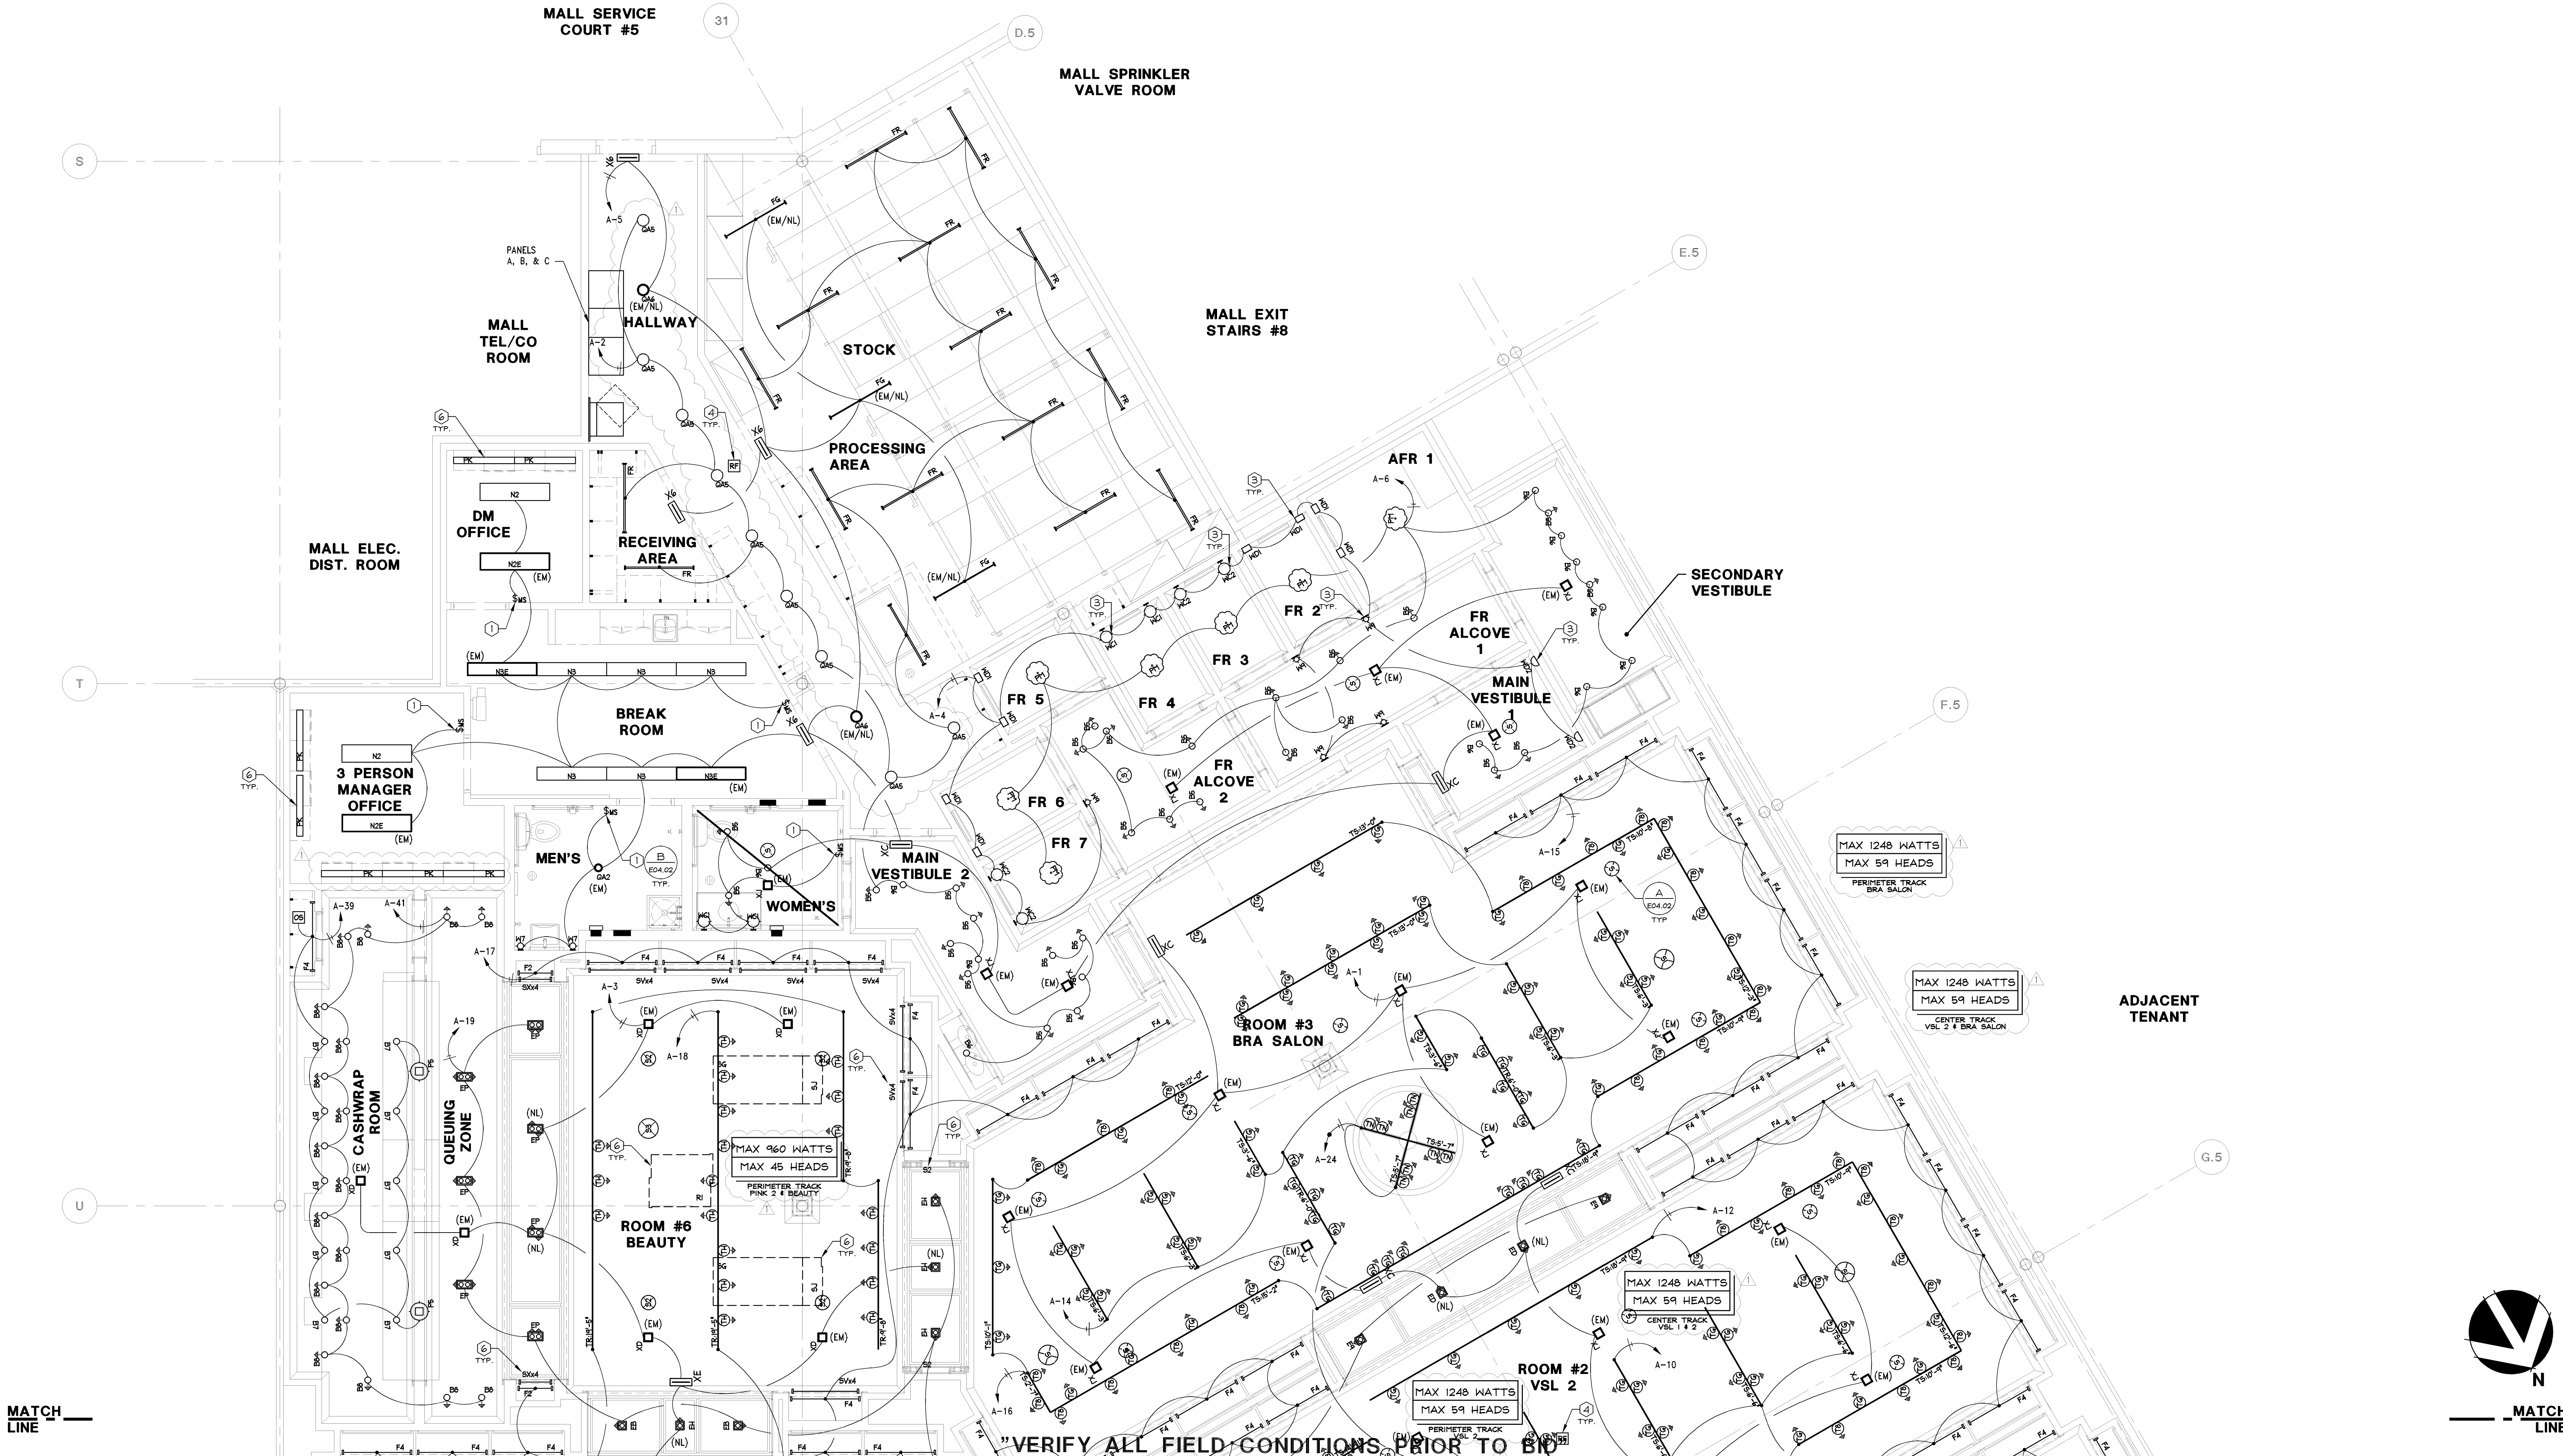

ELECTRICAL LIGHTING PLAN

1/4" = 1'-0"

A

TBA
Thorson • Baker + Associates
CONSULTING ENGINEERS
3030 West Streetboro Road
Richfield, Ohio 44286
(330) 656-6688 PH
(330) 656-6675 FAX

Lbrands
STORE DESIGN & CONSTRUCTION
Three Limited Parkway • Columbus, Ohio 43230
Telephone: 614.415.7000 • Fax: 614.415.7349

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY OF LBRANDS AND SHALL NOT BE REPRODUCED OR USED IN ANY MANNER WITHOUT THE WRITTEN PERMISSION OF LBRANDS. ANY REPRODUCTION OR USE OF THESE DRAWINGS WITHOUT THE WRITTEN PERMISSION OF LBRANDS IS STRICTLY PROHIBITED. LBRANDS ASSUMES NO LIABILITY FOR ANY ERRORS OR OMISSIONS IN THESE DRAWINGS. THE USER OF THESE DRAWINGS SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE APPROPRIATE AGENCIES. LBRANDS SHALL NOT BE RESPONSIBLE FOR ANY DELAYS OR COSTS INCURRED BY THE USER OF THESE DRAWINGS. THE USER OF THESE DRAWINGS SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE APPROPRIATE AGENCIES. LBRANDS SHALL NOT BE RESPONSIBLE FOR ANY DELAYS OR COSTS INCURRED BY THE USER OF THESE DRAWINGS.

PROJECT INFORMATION: 010500587
VICTORIA'S SECRET
NORTH POINT MALL
SPACE #1050
1000 NORTH POINT CIRCLE
ALPHARETTA, GA 30022
DATE ISSUED: 09/19/14
DESIGNED BY: RDW
DRAWN BY: TBA
CHECKED BY: JDM
ELECTRICAL LIGHTING PLAN
DRAWING NUMBER: E03.02

REVISIONS:
NO ADDENDUM - LARGEST COMMENTS
A MASTER UPDATES (15156.01 & 0156A) 01/02/2015

ELITE CONSTRUCTION GROUP
LANE JACKSON, TX
PHONE: 979-285-0712
NOTE: THESE PRINTS HAVE BEEN
REDUCED BY 50 PERCENT. SCALE
WILL BE 50 PERCENT OF WHAT IS
NOTED ON PLANS.

DATE ISSUED: 09/19/14
DESIGNED BY: RDW
DRAWN BY: TBA
CHECKED BY: JDM
ELECTRICAL LIGHTING PLAN
DRAWING NUMBER: E03.02