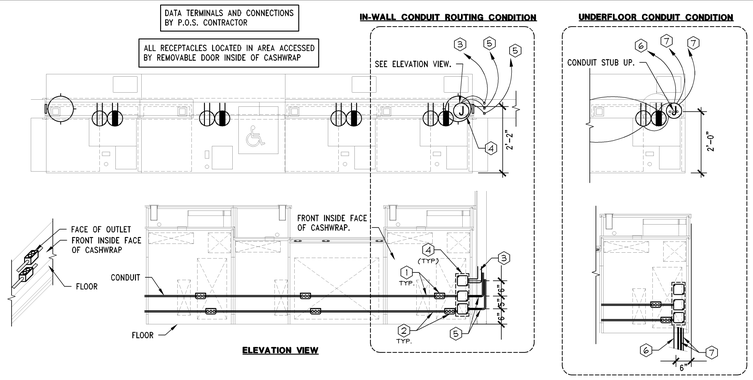

CASHWRAP & TELE/COMP SYSTEM NOTES

1. REGISTERS SHALL SHARE DEDICATED CIRCUIT WITH A SEPARATE ISOLATED NEUTRAL & 3RD WIRE GROUND. THE ELECTRICAL CONTRACTOR SHALL FURNISH ORANGE #IGS362 RECEPTACLE (HUBBLE). PROVIDE 1/2" CONDUIT BETWEEN EACH RECEPTACLE. THE EMPTY BOX IS PRE-INSTALLED BY VENDOR WITH PLUGS ORIENTED TO TOP.
2. CIRCUITS FOR UTILITY POWER W/DUPLEX RECEPTACLE. THE ELECTRICAL CONTRACTOR SHALL FURNISH RECEPTACLES. PROVIDE 1/2" CONDUIT BETWEEN EACH RECEPTACLE. THE EMPTY BOX IS PRE-INSTALLED BY VENDOR WITH PLUGS ORIENTED TO TOP.
3. PROVIDE 1-1/2" CONDUIT FROM DEMARC PANEL LOCATION DOWN WALL AND CONNECT TO JUNCTION BOX FOR DATA CONNECTION. WIRE FOR DATA LINES TO BE PULLED AND CONNECTED BY P.O.S. CONTRACTOR.
4. (3) 4X4 EMPTY J-BOXES ARE PRE-MOUNTED VERTICALLY IN CASHWRAP BY VENDOR. THE TOP BOX IS FOR DATA WHILE THE BOTTOM TWO ARE FOR POWER. SEE ELEVATION VIEW.
5. PROVIDE 1/2" CONDUIT FROM PRE-INSTALLED JUNCTION BOXES. STUB OUT FROM ADJACENT WALL FOR POWER CONNECTION. ROUTE CONDUIT UP INSIDE WALL TO CEILING SPACE AND CONNECT TO PANEL LOCATED INSIDE IFS ENCLOSURE. REFER TO POWER PLAN AND PANEL SCHEDULES FOR CIRCUIT DESIGNATIONS.
6. ROUTE 1-1/2" CONDUIT UNDERFLOOR FROM DEMARC PANEL LOCATION, STUB UP AND PROVIDE FLEXIBLE CONNECTION TO PRE-INSTALLED JUNCTION BOX FOR DATA. WIRE FOR DATA LINES TO BE PULLED AND CONNECTED BY P.O.S. CONTRACTOR.
7. PROVIDE 3/4" CONDUIT UNDERFLOOR FROM PANEL LOCATED IN IFS ENCLOSURE, STUB UP AND PROVIDE FLEXIBLE CONNECTION TO PRE-INSTALLED JUNCTION BOXES. REFER TO POWER PLAN AND PANEL SCHEDULES FOR CIRCUIT DESIGNATIONS.

NOTE: REFER TO ARCHITECTURAL SHEETS FOR ADDITIONAL INFORMATION AND LOCATION OF CASHWRAP

NOTE: REFER TO SHEET E02.01 FOR ACTUAL QUANTITY OF REGISTERS AND RECEPTACLES.

POWER/DATA REQUIREMENTS FOR VSL CASHWRAP

1/2" = 1'-0" | 05D-E0404-M00-CW | M | 08/01/14

NOTE: FOR 12'-0" SHOW WINDOW, PROVIDE AN ADDITIONAL CEILING, ORIENTED WITH LONG SIDE PARALLEL TO STOREFRONT. SHALL BE LOCATED 6'-0" FROM THE FIRST RECEPTACLE, AND 4" FROM OF REAR WALL. COLOR TO MATCH CEILING.

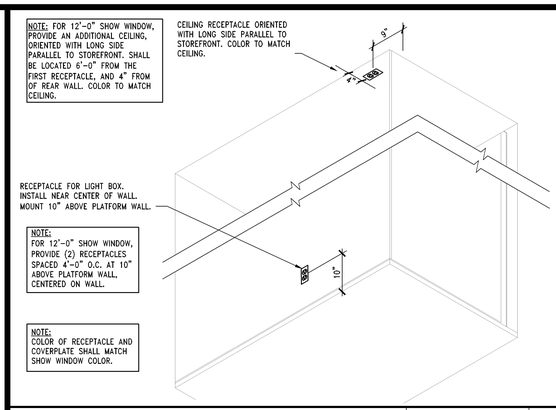

NOTE: FOR 12'-0" SHOW WINDOW, PROVIDE (2) RECEPTACLES SPACED 4'-0" O.C. AT 10" ABOVE PLATFORM WALL, CENTERED ON WALL.

NOTE: COLOR OF RECEPTACLE AND COVERPLATE SHALL MATCH SHOW WINDOW COLOR.

VSS DISPLAY WINDOW

3/4" = 1'-0" | 05D-E0404-D00-DISP | D | 05/24/13

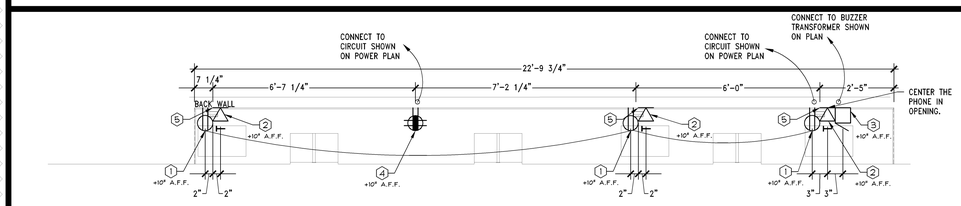

CASHWRAP & ELECTRICAL CHASE NOTES

1. CIRCUIT FOR UTILITY POWER W/DUPLEX RECEPTACLE BY ELECTRICAL CONTRACTOR. CONNECT TO CIRCUIT AS SHOWN ON POWER PLAN.
2. TELEPHONE OUTLET ON INSIDE OF BACKWRAP UNIT. GENERAL CONTRACTOR TO INSTALL 1/2" CONDUIT WITH PULLWIRE. CONDUIT SHALL RUN FROM DEMARC PANEL LOCATION TO WALL DOWN TO 10" AFF. TELEPHONE WIRE AND #RJ14C JACK BY OTHERS.
3. EDWARDS 1064-G5 BUZZER. SEE POWER PLAN FOR ADDITIONAL INFORMATION.
4. DEDICATED POWER W/QUAD RECEPTACLE BY ELECTRICAL CONTRACTOR. CONNECT TO CIRCUIT SHOWN ON PLAN.

   NOTE: LABEL AND TAG ALL PULLWIRE RUNS AT EACH END WITH ORIGIN/DESIGNATION.
5. 10" WIDE ACCESS HOLE, CENTERED ON DIMENSION SHOWN.

NOTE: REFER TO ARCHITECTURAL SHEETS FOR ADDITIONAL INFORMATION.

POWER/DATA REQUIREMENTS FOR BACKWRAP - VSL (BW7R-V07)

1/2" = 1'-0" | 05D-E0404-L03-BW7R | L | 08/01/14

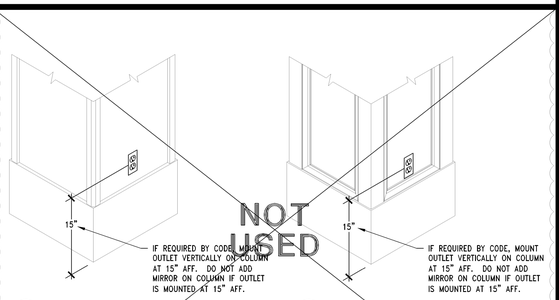

1 STANDARD BEAUTY COLUMN

2 BRA SALON/VSL COLUMN

NOTE: COLOR OF RECEPTACLES AND COVERPLATES ARE:
1. BLACK IN BLACK ROOM
2. WHITE IN PINK ROOM
3. WHITE IN VS SALES AREA
4. WHITE IN BRA SALON

COLUMN RECEPTACLE MOUNTING DETAIL

1" = 1'-0" | 05D-E0404-G00-RECP | G | 05/24/13

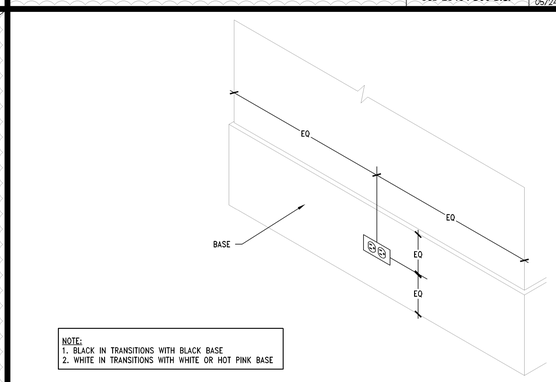

NOTE:
1. BLACK IN TRANSITIONS WITH BLACK BASE
2. WHITE IN TRANSITIONS WITH WHITE OR HOT PINK BASE

TRANSITION REC. MOUNTING DETAIL

1 1/2" = 1'-0" | 05D-E0404-A00-RECP | C | 09/12/14

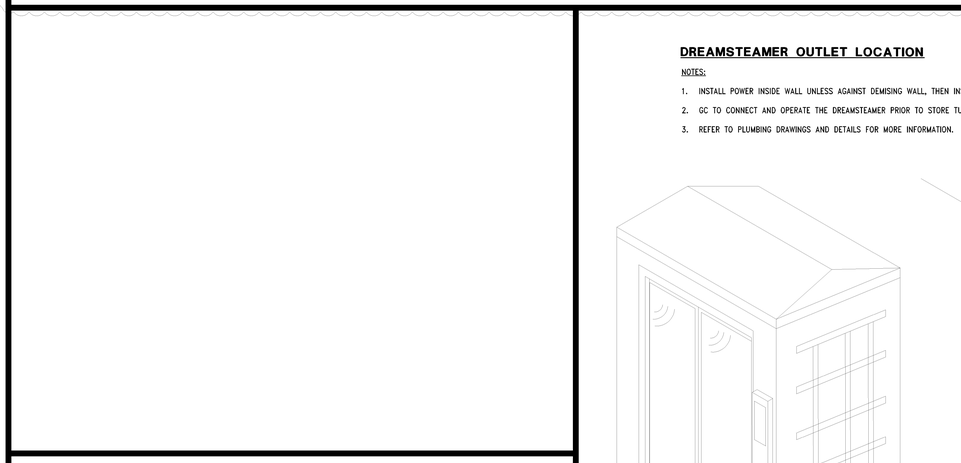

SPECIFICATIONS	SERIES 2300
MODEL (208 VOLTS)	2200-308
MODEL (240 VOLTS)	N/A
BRANCH CIRCUIT RATING	40 AMPS
RECEPTACLE	BY LIGHTING PKG. DISTRIBUTOR
NEMA CONFIGURATION	N/A
CATALOG NO.	BRYANT CS 8369
POWER	13,500 WATTS
WIDTH	48 INCHES
DEPTH	30 1/2 INCHES
HEIGHT	88 INCHES
WEIGHT(WITH WATER)	300 LBS.
WATER CAPACITY(APX.)	7 GALLONS
WATER USAGE(APX.)	1/2 GALLONS PER HOUR

DREAMSTEAMER DETAIL

3/4" = 1'-0" | 05D-E0404-J00-DRMS | J | 07/29/11

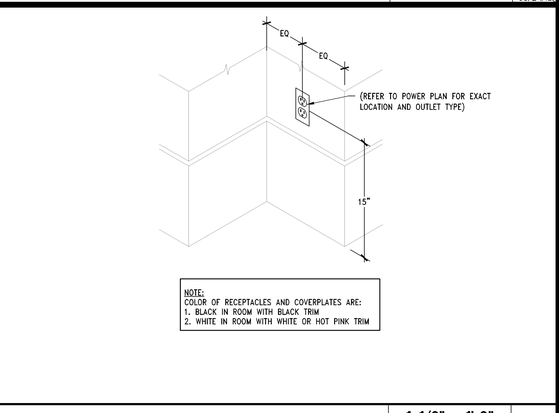

NOTE: COLOR OF RECEPTACLES AND COVERPLATES ARE:
1. BLACK IN ROOM WITH BLACK TRIM
2. WHITE IN ROOM WITH WHITE OR HOT PINK TRIM

CORNER RECEPTACLE MOUNTING DETAIL

1 1/2" = 1'-0" | 05D-E0404-C00-RECP | F | 09/12/14

NOTE: THERE MAY BE A MAXIMUM OF (3) SENSORS (T, CO2, & H).
1. IF ONLY (T) THEN MOUNT IT AS SHOWN ON THIS ELEVATION.
2. IF (T) & (CO2) OR (T) & (H) THEN MOUNT (T) AS SHOWN. MOUNT (CO2) OR (H) DIRECTLY ABOVE @+4" FROM TOP OF (T) TO BOTTOM OF EITHER (CO2) OR (H).
3. IF (T), (CO2) & (H) THEN MOUNT (T) AS SHOWN. MOUNT (CO2) & (H) AT HEIGHT SHOWN IN NOTE-2 EQUIDISTANT FROM FRONT AND BACK OF THE CABINET AND BETWEEN EACH DEVICE.

NOTE: JUNCTION BOX AND 1/2" CONDUIT IN WALL TO ABOVE CEILING FOR T-STAT(S)/SENSOR(S)

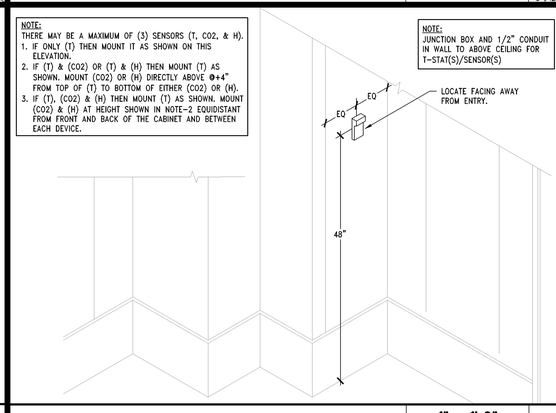

TEMPERATURE SENSOR MOUNTING DETAIL

1" = 1'-0" | 05D-E0404-B00-TSMD | B | 09/12/14

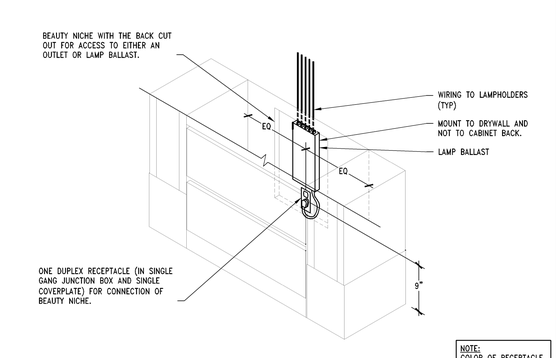

NOTE: COLOR OF RECEPTACLE AND COVERPLATE SHALL BE WHITE.

BEAUTY NICHE REC. MOUNTING DETAIL

1" = 1'-0" | 05D-E0404-N00-BNRC | N | 07/25/11

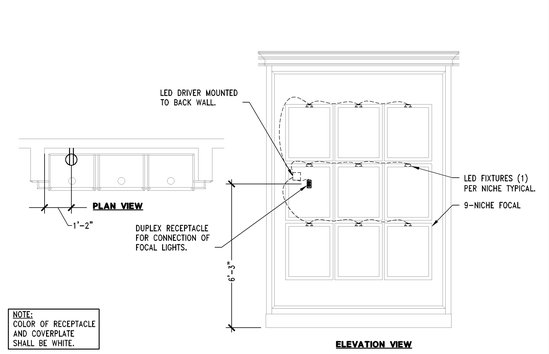

NOTE: COLOR OF RECEPTACLE AND COVERPLATE SHALL BE WHITE.

VSS FOCAL REC. MOUNTING DETAIL

3/8" = 1'-0" | 05D-E0404-E00-LTRC | E | 10/24/14

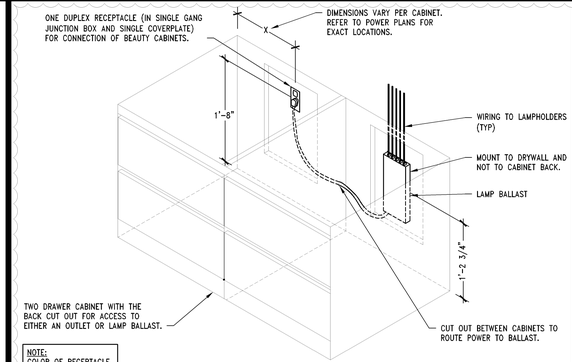

NOTE: COLOR OF RECEPTACLE AND COVERPLATE SHALL BE WHITE.

BEAUTY CABINET REC. MOUNTING DETAIL

1" = 1'-0" | 05D-E0404-A00-RECP | A | 02/21/14

TBA
Thorson • Baker + Associates
CONSULTING ENGINEERS
3030 West Streetsboro Road (330) 659-6688 Ph.
Richfield, Ohio 44286 (330) 659-6675 Fax

Lbrands

STORE DESIGN & CONSTRUCTION

Three Limited Parkway · Columbus, Ohio 43230
Telephone: 614.415.7000 · Fax: 614.415.7349

THESE DRAWINGS AND SPECIFICATIONS ARE COPYRIGHTED AND SUBJECT TO COPYRIGHT PROTECTION AS AN "ARCHITECTURAL WORK" UNDER SEC. 102 OF THE COPYRIGHT ACT, 17 U.S.C. AS AMENDED DECEMBER 1990. THE OWNER AND USER OF A BUILDING CONSTRUCTED FROM THESE PLANS MAY MAKE REASONABLE USES OF THE PLANS FOR THE PURPOSES OF CONSTRUCTION, USE AND MAINTENANCE OF THE BUILDING, BUT ANY REPRODUCTION, PUBLICATION, SALE OR OTHER USE OF THESE PLANS, WITHOUT THE PRIOR WRITTEN CONSENT OF TBA, IS PROHIBITED. TITLE, ARRANGEMENT AND COMPILATION OF SHEETS, AND THE DESIGNS AND ARRANGEMENTS OF ALL BUILDING ELEMENTS DEPICTED THEREIN ARE ALSO PROTECTED UNDER THE COPYRIGHT ACT. ALL RIGHTS RESERVED. © TBA 2014

010500587

VICTORIA'S SECRET
NORTH POINT MALL
SPACE #1050
1000 NORTH POINT CIRCLE
ALPHARETTA, GA 30022

PROJECT INFORMATION:
FULL REMODEL | PACKAGE: PKG II
NMA GENERATION: SPRING 2015 (142FG)
00059876 A/E PROJECT #: 140332
SCOPE:
DESIGN TYPE: LSDAC PROJECT #:

REVISIONS:

REQUIRED BY:	DESCRIPTION	DATE
1	BID ADDENDUM - LANDLORD COMMENTS & WASTED UPDATES (E015LG1 & E15A)	01/02/2015

ELITE CONSTRUCTION GROUP
LAKE JACKSON, TX
PHONE: 979-285-0712
NOTE: THESE PRINTS HAVE BEEN REDUCED BY 50 PERCENT. SCALE WILL BE 50 PERCENT OF WHAT IS NOTED ON PLANS

DATE ISSUED: 09/19/14
DESIGNED BY: RDW
DRAWN BY: TBA
CHECKED BY: JDM

ELECTRICAL DETAILS

DRAWING NUMBER:
E04.04