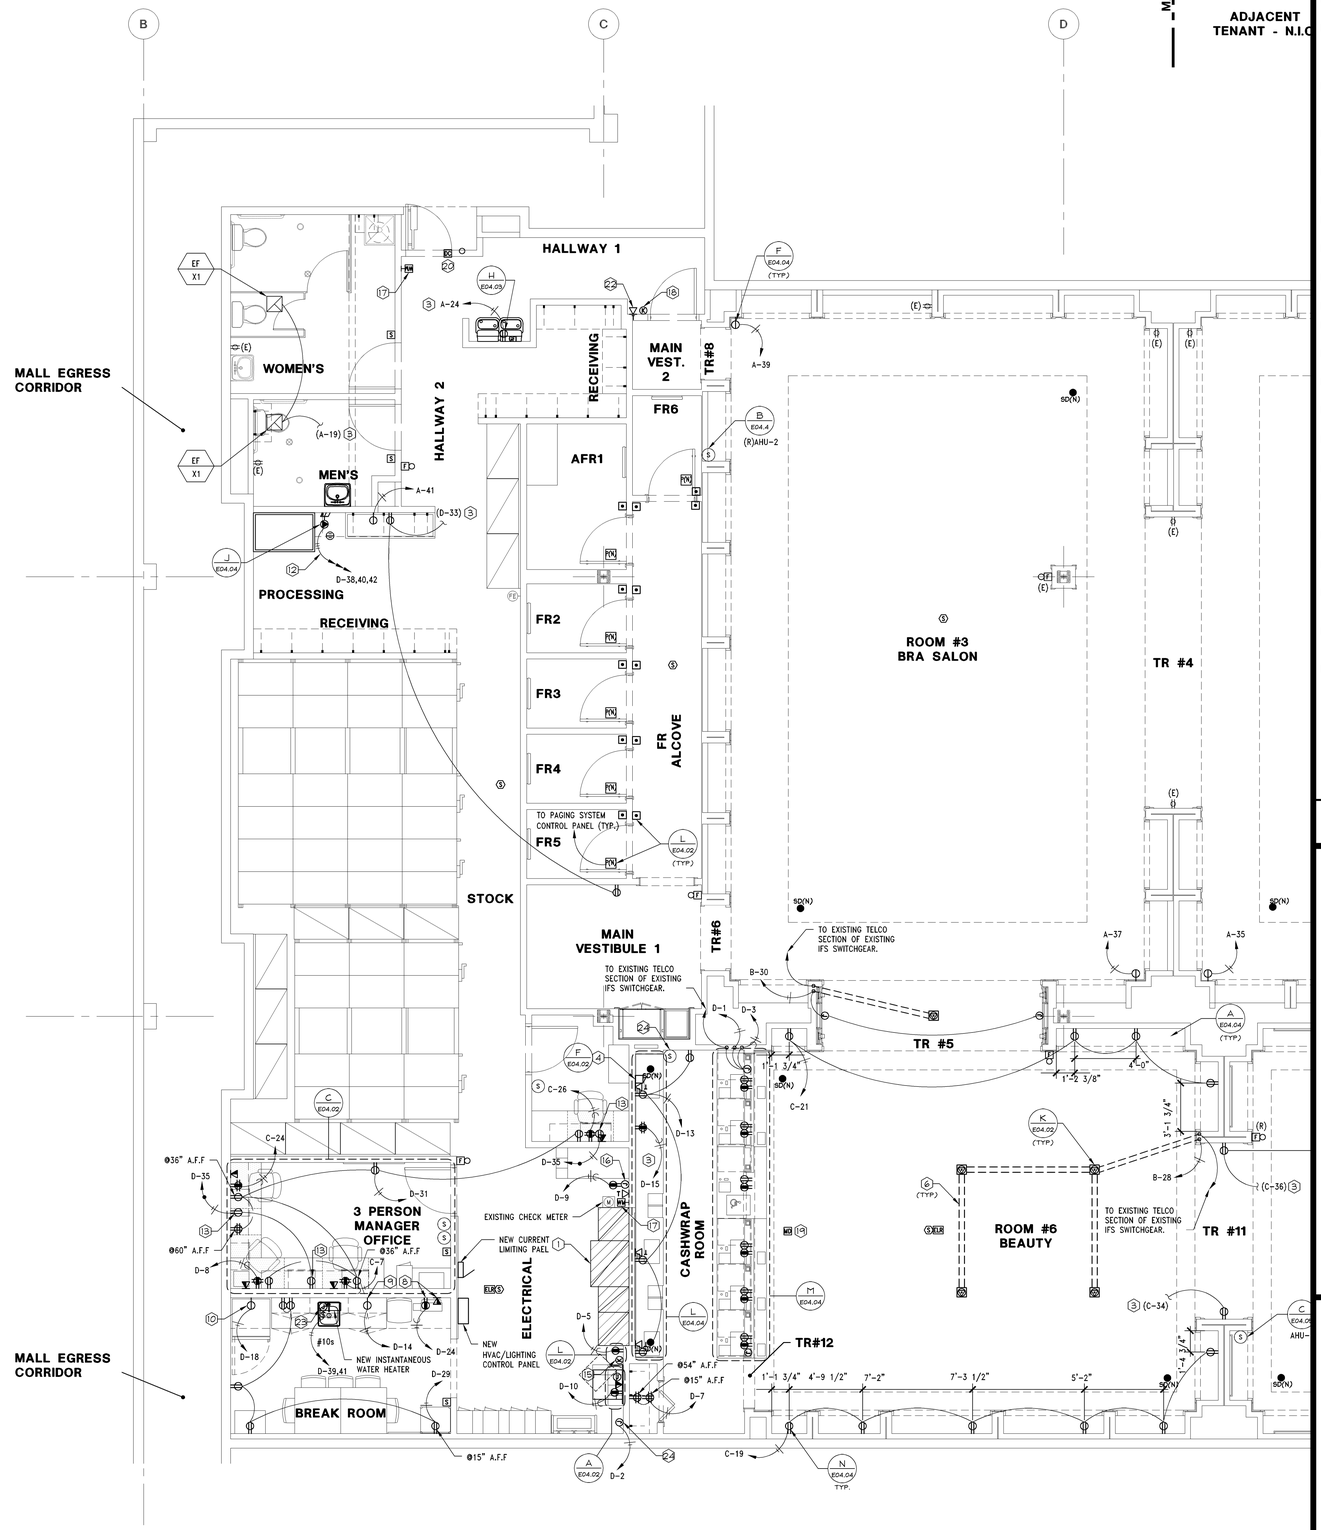

N

"VERIFY ALL FIELD CONDITIONS PRIOR TO BID"

ADJACENT TENANT - N.I.C.

MATCH LINE

ELECTRICAL POWER AND FIRE ALARM PLAN

1/4" = 1'-0"

E

1. EXISTING ELECTRICAL PANELS, TRANSFORMER, DISCONNECT SWITCHES, CONTACTORS, ETC.
2. ~~ALL ELECTRICAL DEVICES AND EQUIPMENT IN THIS SPACE ARE EXISTING TO REMAIN. NO ELECTRICAL WORK REQUIRED. FIELD VERIFY.~~
3. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ALL JUNCTION BOXES, CONDUIT AND CONDUCTORS TO CONNECT RECEPTALE(S) TO NEAREST CIRCUIT INDICATED ON THE PLAN. FILED VERIFY. REFER TO "AS-BUILT' DRAWINGS, AND THE EXISTING PANEL BOARD SCHEDULE. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY THE WATTAGE AND CONDUCT A FIELD TEST TO AVOID CIRCUIT OVERLOADS. ELECTRICAL CONTRACTOR SHALL NOT EXCEED 1600 WATTS FOR ANY SINGLE CIRCUIT.
4. INSTALL DELIVERY BUZZER TO EXISTING DELIVERY BUZZER SYSTEM AS SHOWN ON DRAWINGS. LSD&C SHALL FURNISH BUZZERS. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL NECESSARY JUNCTION BOXES, CONDUIT, AND WIRE TO COMPLETELY INSTALL DELIVERY BUZZER SYSTEM. JUNCTION BOXES SHALL BE MOUNTED VERTICALLY. FIELD VERIFY.
5. ~~HOME RUN SECURITY CAMERA TO EXISTING DVR. FIELD VERIFY EXACT LOCATION.~~
6. SAW CUT/CORE DRILL AND PATCH FLOOR SLAB AS REQUIRED FOR UNDERSLAB CONDUIT.
7. CLOCK RECESSED SIMPLEX RECEPTACLES FOR EACH ILLUMINATED LETTER OF PINK SIGN. PROVIDED BY OWNER INSTALLED BY ELECTRICAL CONTRACTOR. SEE ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS.
8. PROVIDE DEDICATED ISOLATED GROUND DUPLEX RECEPTACLE AND DATA BOX AT 48" AFF FOR A.L.L SYSTEM.
9. 20 AMP MICROWAVE RECEPTACLE @ 42" AFF WHEN COUNTER IS PRESENT, 18" FOR ALL OTHER CASES. IF PLAN LOCATION IS NOT ACCEPTABLE, IMMEDIATELY CONTACT LSD&C PROJECT MANAGER FOR DIRECTION.
10. 20 AMP RECEPTACLE @ 18" AFF FOR REFRIGERATOR OR VENDING MACHINE. IF PLAN LOCATION IS NOT ACCEPTABLE, IMMEDIATELY CONTACT LSD&C PROJECT MANAGER FOR DIRECTION.
11. PROVIDE JUNCTION BOX WITH TOGGLE SWITCH DISCONNECT FOR SIGN POWER. REFER TO ARCHITECTURAL DETAILS FOR EXACT LOCATION.
12. REFER TO ELECTRICAL EQUIPMENT DATA ON SHEET E05.01 FOR CONDUIT AND WIRE SIZE.
13. PROVIDE DUPLEX RECEPTACLE FOR UNDER CABINET LIGHTING. REFER TO DETAIL C/E04.02 FOR MOUNTING HEIGHT AND CIRCUITING INFORMATION.
14. MOUNT RECEPTACLE VERTICALLY AT 15" AFF AND CENTERED IN WALL. SEE ARCHITECTURAL DRAWINGS FOR LOCATION. RECEPTACLE MAY BE SHOWN AWAY FROM WALL FOR CLARITY.
15. KEYPAD FOR PAGING SYSTEM, MOUNTED AT 48" AFF, ON WALL AND CONNECTED TO MODEM PANEL. REFER TO RESPONSIBILITY SCHEDULE FOR INSTALLATION.
16. 4"X4" JUNCTION BOX MOUNTED AT 60" AFF WITH 1-1/4" CONDUIT (WITH BUSHING) TO CEILING FOR BURGLAR ALARM. VERIFY EXACT LOCATION WITH LSD&C PRIOR TO WORK COMMENCEMENT.
17. INSTALL WALL MOUNTED MOTION DETECTOR AT REAR EXIT AND NEXT TO BURGLAR ALARM AT 7' AFF. VERIFY EXACT LOCATIONS WITH LSD&C PROJECT MANAGER PRIOR TO WORK COMMENCEMENT.
18. KEYPAD FOR SECURITY SYSTEM, MOUNTED AT 54" AFF, ON WALL, ON HANDLE-SIDE OF NON-SALES DOOR LEADING TO SALES AREA, AND 3/4" CONDUIT FROM JUNCTION BOX TO ABOVE CEILING.
19. INSTALL CEILING MOUNTED MOTION DETECTOR IN EACH STOREFRONT ROOM WITH AN ENTRANCE AND IN FRONT OF EVERY CASHWRAP. VERIFY EXACT COLOR AND LOCATIONS WITH LSD&C PROJECT MANAGER PRIOR TO WORK COMMENCEMENT.
20. DOOR CONTACT. GENERAL CONTRACTOR SHALL FURNISH AND INSTALL JUNCTION BOX AND 3/4" CONDUIT FROM ABOVE CEILING TO 6" FROM DOOR, ALIGNED WITH TOP OF DOOR FOR SWING DOORS.
21. INSTALL CURTAIN WALL MOUNTED MOTION DETECTOR AT EACH ENTRY/ROLLING GRILLE. VERIFY EXACT LOCATIONS WITH LSD&C PROJECT MANAGER PRIOR TO WORK COMMENCEMENT.
22. TELEPHONE OUTLET IN WALL. INSTALL EMPTY 3/4" CONDUIT, WITH PULLWIRE, BACK TO TELCO SECTION OF IFS ENCLOSURE. TELEPHONE WIRE AND #RJ14C JACK FOR TWO LINE TELEPHONE BY OTHERS. MOUNT AT 48" AFF, EXCEPT AS NOTED ON PLANS.
23. JUNCTION BOX AND TOGGLE DISCONNECT SWITCH FOR 208V, 1# WATER HEATER ELECTRICAL CONNECTION. COORDINATE EXACT LOCATION AND RELATED REQUIREMENTS WITH PLUMBING CONTRACTOR PRIOR TO WORK COMMENCEMENT.
24. MONITORING SENSOR MOUNTED AT 48" AFF. SENSOR TO BE ROUTED BACK TO MONITOR CIRCUIT BOARD. PROVIDE JUNCTION BOX NEXT TO IFS PANEL FOR MONITOR CIRCUIT BOARD . PROVIDE AND INSTALL 24 VOLT 150VA TRANSFORMER COMPATIBLE WITH TRANE TRACER MP503 WITH CODE REQUIRED DISCONNECT SWITCH.

ELECTRICAL POWER PLAN KEY NOTES

NTS

C 10/26/11

Thorson • Baker + Associates
CONSULTING ENGINEERS
3030 West Streetsboro Road (330) 659-6688 Ph.
Richfield, Ohio 44286 (330) 659-6675 Fax

Limitedbrands
LIMITED STORE PLANNING, INC.
d/b/a STORE DESIGN & CONSTRUCTION
Three Limited Parkway · Columbus, Ohio 43230
Telephone: 614.415.7000 · Fax: 614.415.7349

PROHIBITION OF RESALE:
THESE DRAWINGS AND SPECIFICATIONS WERE PREPARED FOR USE ON A SPECIFIC SITE, CONTEMPORANEOUSLY WITH THEIR ISSUE DATE, THEY ARE NOT INTENDED FOR USE ON A DIFFERENT PROJECT OR AT A DIFFERENT TIME. ANY REPRODUCTION OF THESE DRAWINGS AND SPECIFICATIONS, OR ANY REPRODUCTION THEREOF, ON ANOTHER PROJECT IS PROHIBITED AND CONTRARY TO LAW UNLESS EXPRESSLY AUTHORIZED IN WRITING BY LSD&C. LIMITED STORE PLANNING, INC. ("LSD&C"), LIMITED STORE DESIGN AND CONSTRUCTION ("LSD&C").

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY OF LSD&C AND SHALL NOT BE DEPLOYED IN ANY MANNER WITHOUT THE EXPRESS WRITTEN PERMISSION OF LSD&C. THEY SHALL NOT BE ASSIGNED OR SOLD, AND REPRODUCTION OF THESE DRAWINGS AND SPECIFICATIONS SHALL BE MADE WITHOUT THE WRITTEN PERMISSION OF LSD&C. ALL COMMON LAW AND STATUTORY RIGHTS INCLUDING COPYRIGHT ARE RESERVED. THESE DRAWINGS AND SPECIFICATIONS MUST BE RETURNED TO LSD&C UPON COMPLETION OF THEIR INTENDED USE, UNLESS OTHERWISE AGREED BY THE LSD&C.

SHEET DRAWINGS AND SPECIFICATIONS ARE COPYRIGHTED AND SUBJECT TO COPYRIGHT PROTECTION AS AN "ARCHITECTURAL WORK" UNDER SEC. 102 OF THE COPYRIGHT ACT, 17 U.S.C. AS AMENDED DECEMBER 1990. THE OWNER AND ARCHITECT AGREE THAT LIMITED STORE PLANNING, INC. IS THE AUTHOR OF THIS WORK, WHICH INCLUDES, WITHOUT LIMITATION, THE OVERALL FORM, ARRANGEMENT AND COMPOSITION OF SPACES AND ELEMENTS IN THE DESIGN. ALL RIGHTS IN THE ARCHITECTURAL WORK ARE RESERVED. USE OF THESE DRAWINGS AND SPECIFICATIONS MAY RESULT IN CESSATION OF CONSTRUCTION, BUILDING SEIZURE, AND/OR MONETARY LIABILITY.

PROJECT INFORMATION:

010500485

VICTORIA'S SECRET
CAROLINA PLACE
11025 CAROLINA PLACE PKWY
SPACE B-14
PINEVILLE, NC 28134

SCOPE: REFRESH | PACKAGE: PKG II
DESIGN TYPE: NMA/ANGELS | GENERATION: 2013 (R13ISo)/142Fo
LSD&C PROJECT #: 00059286 | A/E PROJECT #: 2007684009

REVISIONS:

REQUIRED BY:	DATE

ELITE CONSTRUCTION GROUP
LAKE ~~JACKSON, TX~~
PHONE: 979-285-0712
NOTE: ~~THESE PRINTS HAVE BEEN~~ REDUCED BY 50 PERCENT. SCALE WILL ~~BE 50 PERCENT OF WHAT IS~~ NOTED ON PLANS

DATE ISSUED: 9/26/14
DESIGNED BY: RDW
DRAWN BY: TBA
CHECKED BY: JDM

ELECTRICAL POWER & FIRE ALARM PLAN

DRAWING NUMBER:
E02.02