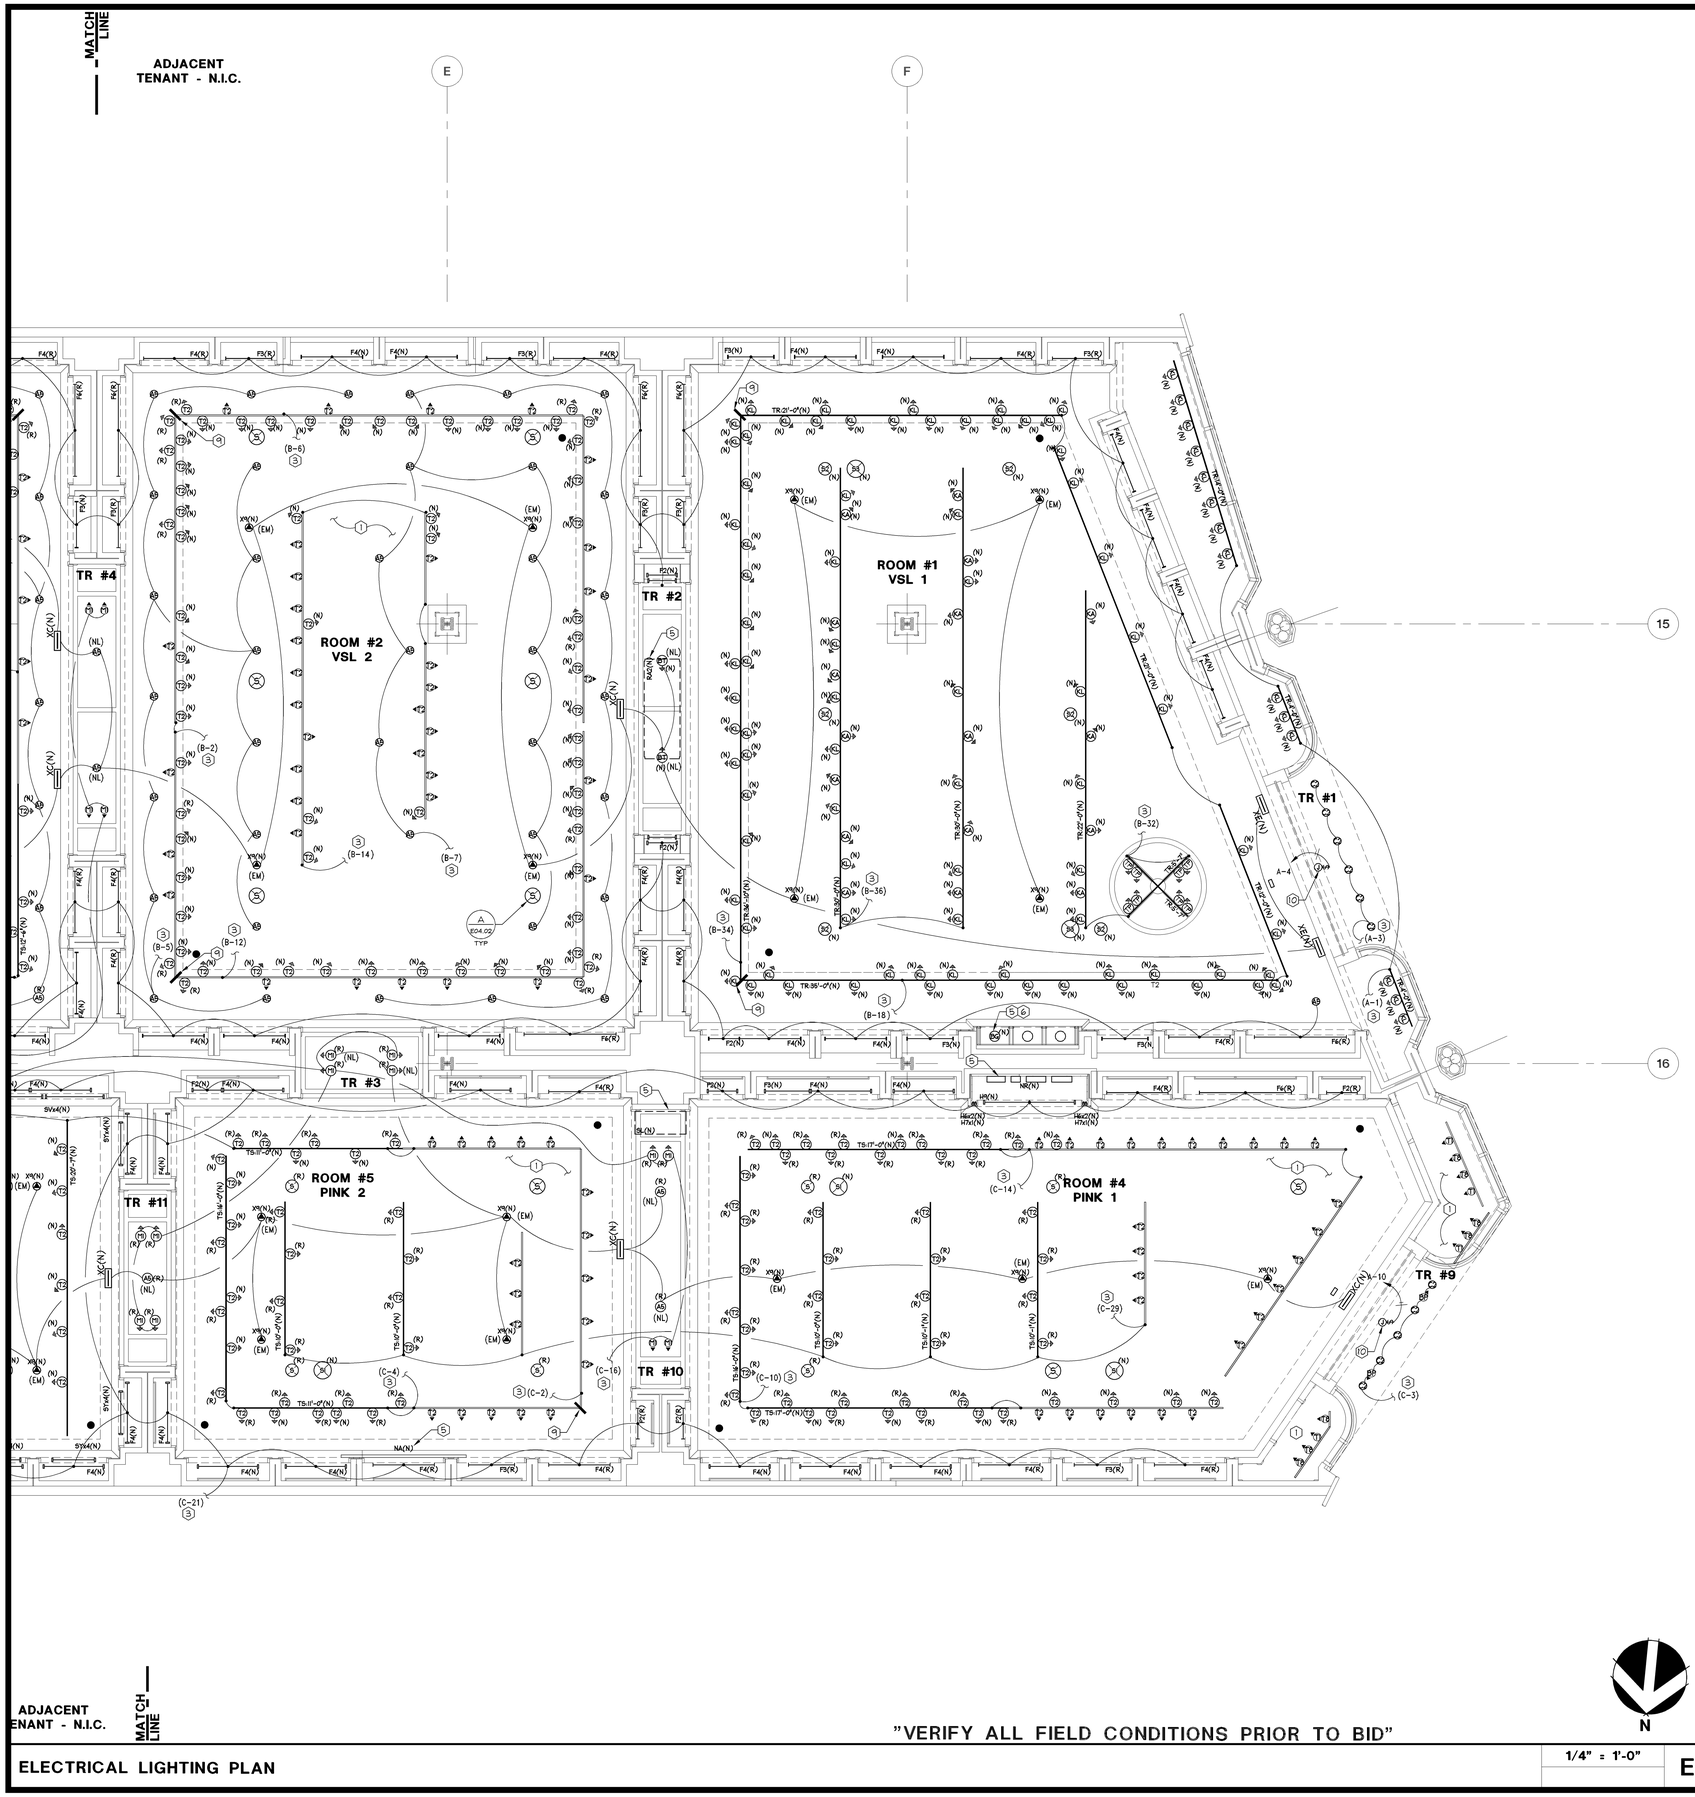

"VERIFY ALL FIELD CONDITIONS PRIOR TO BID"

ELECTRICAL LIGHTING PLAN

1/4" = 1'-0"

E

1. EXISTING LIGHT FIXTURES AND DEVICES IN CEILING ARE TO REMAIN, UNLESS NOTED OTHERWISE. FIELD VERIFY.
2. ~~NEW LIGHT FIXTURES, SPEAKERS, ETC FURNISHED BY LSD&C AND INSTALLED BY ELECTRICAL CONTRACTOR. VERIFY EXACT LOCATIONS WITH ARCHITECT AND LSD&C PROJECT MANAGER PRIOR TO WORK COMMENCEMENT.~~
3. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ALL JUNCTION BOXES, CONDUIT AND CONDUCTORS TO CONNECT LIGHT FIXTURE(S) TO NEAREST LIGHTING CIRCUIT INDICATED ON THE PLAN. FIELD VERIFY. REFER TO "AS-BUILT" DRAWINGS, AND THE EXISTING PANEL BOARD SCHEDULE. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY THE FIXTURE WATTAGE AND CONDUCT A FIELD TEST TO AVOID CIRCUIT OVERLOADS. ELECTRICAL CONTRACTOR SHALL NOT EXCEED 1600 WATTS FOR ANY SINGLE LIGHTING CIRCUIT.
4. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ALL JUNCTION BOXES, CONDUIT AND CONDUCTORS TO CONNECT LIGHT FIXTURE(S) TO NEAREST EMERGENCY/EXIT LIGHTING CIRCUIT INDICATED ON THE PLAN. FIELD VERIFY. REFER TO "AS-BUILT" DRAWINGS, AND THE EXISTING PANEL BOARD SCHEDULE. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY THE FIXTURE WATTAGE AND CONDUCT A FIELD TEST TO AVOID CIRCUIT OVERLOADS. ELECTRICAL CONTRACTOR SHALL NOT EXCEED 1600 WATTS FOR ANY SINGLE LIGHTING CIRCUIT.
5. REFER TO SHEET E02.1 FOR POWER REQUIREMENTS.
6. LIGHT FIXTURES TO BE INSTALLED IN MILLWORK FIXTURE, NOT IN CEILING. VERIFY WITH LSD&C.
7. ELECTRICAL CONTRACTOR SHALL INSTALL OCCUPANCY MOTION SENSOR SWITCH FOR CONTROL OF LIGHTS AS SHOWN. ELECTRICAL CONTRACTOR SHALL SET SWITCH FOR 15 MINUTES. MOUNT AT 44"AFF.
8. JUNCTION BOX INSTALLED AT THE CENTERLINE OR MOUNTING PLATE OF WALL SCONCE. SEE ARCHITECTURAL DRAWINGS FOR MOUNTING HEIGHTS.
9. BREAK-OFF CIRCUIT.
10. FURNISH AND INSTALL JUNCTION BOX, TOGGLE DISCONNECT SWITCH IN NON-VISIBLE LOCATION, FINAL CONNECTION FOR 120 VOLT SIGN AND CONDUIT PER DETAIL. SIGN IS FURNISHED WITH INTERNAL GROUND FAULT PROTECTION BY SIGN MANUFACTURER PER N.E.C. ARTICLE 600-23B. VERIFY EXACT LOCATION OF JUNCTION BOX WITH SIGN MANUFACTURER. (REUSE EXISTING JUNCTION BOX AND CONDUIT INTO SPACE IF ALREADY INSTALLED. VERIFY IN FIELD EXACT LOCATION ON CANOPY).

NOTE:
THE CIRCUIT FOR SIGNAGE MUST BE A DEDICATED ISOLATED 3-LINE CIRCUIT CONSISTING OF HOT, NEUTRAL, AND GROUND WIRES LEADING DIRECTLY TO THE PANEL.

NOTE:
LENGTH OF FLEXIBLE METAL CONDUIT OR AC90(CANADA) IS NOT TO EXCEED 6'-0".

NOTE:
REFER TO SHEET E04.1 FOR ELECTRICAL LIGHTING SCHEDULE, LIGHT DESCRIPTIONS. AND CONSTRUCTION NOTES.

NOTE:
REFER TO SHEET E05.1 FOR PANEL SCHEDULE AND LIGHTING ZONE DESIGNATIONS.

NOTE:
ELECTRICAL CONTRACTOR SHALL REFER TO ARCHITECTURAL SHEETS FOR MOUNTING HEIGHTS AND INSTALLATION DETAILS FOR SUSPENDED LIGHTING IN NON-SALES AREA.

NOTE:
GENERAL CONTRACTOR SHALL VERIFY CEILING FIRE RATING WITH ARCHITECT, AND BOX OR TENT ALL RECESSED LIGHT FIXTURES, IF REQUIRED, TO MAINTAIN CEILING FIRE RATING.

NOTE:
LIGHT FIXTURES THAT HAVE AN (N) ARE NEW. LIGHT FIXTURES WITH AN (R) ARE RELOCATED AND ALL OTHER LIGHT FIXTURES ARE EXISTING TO REMAIN. FOR LIGHT FIXTURES THAT ARE RELOCATED E.C. SHALL FURNISH AND INSTALL ALL J-BOXES ETC NEEDED TO RELOCATED DEVICES SHOWN. E.C. SHALL VERIFY ALL DEVICES AND EQUIPMENT ARE FUNCTIONAL/OPERATIONAL AND CLEAN ALL TO A NEW-LINE CONDITION. FURNISH AND INSTALL NEW DEVICES IF EXISTING ARE NOT OPERATIONAL INCLUDE ALL COSTS IN BID.

NOTE:
WE ARE REMOVING LESS THAN 50% OF THE LIGHTS. WE REMOVED 20,495 WATTS OF LIGHTS AND ARE ADDING BACK 17,399 WATTS. SO WE ADDED LESS WATTAGE THAN WE REMOVED.

ELECTRICAL LIGHTING PLAN KEYNOTES

NTS

C 10/28/11

Thorson • Baker + Associates
CONSULTING ENGINEERS
3030 West Streetsboro Road (330) 659-6688 Ph.
Richfield, Ohio 44286 (330) 659-6675 Fax

Limitedbrands
LIMITED STORE PLANNING, INC.
d/b/a STORE DESIGN & CONSTRUCTION
Three Limited Parkway · Columbus, Ohio 43230
Telephone: 614.415.7000 · Fax: 614.415.7349

PROHIBITION ON REUSE:
THESE DRAWINGS AND SPECIFICATIONS WERE PREPARED FOR USE ON A SPECIFIC SITE, CONTEMPORANEOUSLY WITH THEIR ISSUE DATE. THEY ARE NOT INTENDED FOR USE ON A DIFFERENT PROJECT OR SITE. THE USE OF THESE DRAWINGS AND SPECIFICATIONS ON ANY OTHER PROJECT IS PROHIBITED AND CONTRARY TO LAW UNLESS EXPRESSLY REPRODUCTION THEREOF, OR ANOTHER PROJECT IS PROHIBITED AND CONTRARY TO LAW UNLESS EXPRESSLY AUTHORIZED BY THE LSDC. ALL RIGHTS RESERVED UNDER FEDERAL COPYRIGHT LAWS.
CONSTRUCTION ("LSDC").

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY OF LSDC AND SHALL NOT BE DEPLOYED IN WHOLE OR IN PART FOR ANY PURPOSE WHATSOEVER EXCEPT WITH THE PRIOR WRITTEN CONSENT OF LSDC AND SHALL NOT BE LOANED, COPIED OR DISCLOSED TO ANY UNAUTHORIZED PERSON UNDER ANY CIRCUMSTANCES WITHOUT THE WRITTEN PERMISSION OF LSDC. THE VISUAL CONTENTS OF THESE DRAWINGS AND SPECIFICATIONS SHALL NOT BE USED IN WHOLE OR IN PART FOR MARKETING OR PROMOTIONAL PURPOSES WITHOUT THE WRITTEN CONSENT OF LSDC. APPLICATION OF ARCHITECTURAL OR ENGINEERING SEAL MAY NOT CONSTITUTE PUBLICATION OF THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE WRITTEN CONSENT OF LSDC. UPON COMPLETION OF THEIR INTENDED USE, UNLESS OTHERWISE AGREED TO BY LSDC.

THESE DRAWINGS AND SPECIFICATIONS ARE COPYRIGHTED AND SUBJECT TO COPYRIGHT PROTECTION AS AN "ARCHITECTURAL WORK" UNDER SEC. 102 OF THE COPYRIGHT ACT, 17 U.S.C. §1 AMENDED DECEMBER 1990. THE OWNER AND USER OF A BUILDING CONSTRUCTED FROM THESE DRAWINGS AND SPECIFICATIONS INCLUDES, WITHOUT LIMITATION, THE INTERNAL FORM, ARRANGEMENT AND COMPOSITION OF SPACES AND ELEMENTS SUCH AS WALLS AND DOORS. REPRODUCTION OF THESE DRAWINGS AND SPECIFICATIONS BY ANY MEANS INCLUDING BUT NOT LIMITED TO ELECTRONIC MEDIA, OR FOR ANY PURPOSE WITHOUT THE WRITTEN PERMISSION OF LSDC UPON COMPLETION OF THEIR INTENDED USE, UNLESS OTHERWISE AGREED TO BY LSDC.

010500485

PROJECT INFORMATION:

VICTORIA'S SECRET
CAROLINA PLACE
11025 CAROLINA PLACE PKWY
SPACE B-14
PINEVILLE, NC 28134

SCOPE: REFRESH | PACKAGE: PKG II
DESIGN TYPE: NMA/ANGELS | GENERATION: 2013 (R13Sa)/142Fa
LSD&C PROJECT #: 00059286 | A/E PROJECT #: 2007684009

REVISIONS:

REQUIRED BY:	DATE

ELITE CONSTRUCTION GROUP
LAKE ~~JACKSON, TX~~
PHONE: 979-285-0712
NOTE: ~~THESE PRINTS HAVE BEEN REDUCED BY 50 PERCENT. SCALE WILL BE 50 PERCENT OF WHAT IS~~ NOTED ON PLANS

DATE ISSUED: 9/26/14
DESIGNED BY: RDW
DRAWN BY: TBA
CHECKED BY: JDM

ELECTRICAL LIGHTING PLAN

DRAWING NUMBER:
E03.01