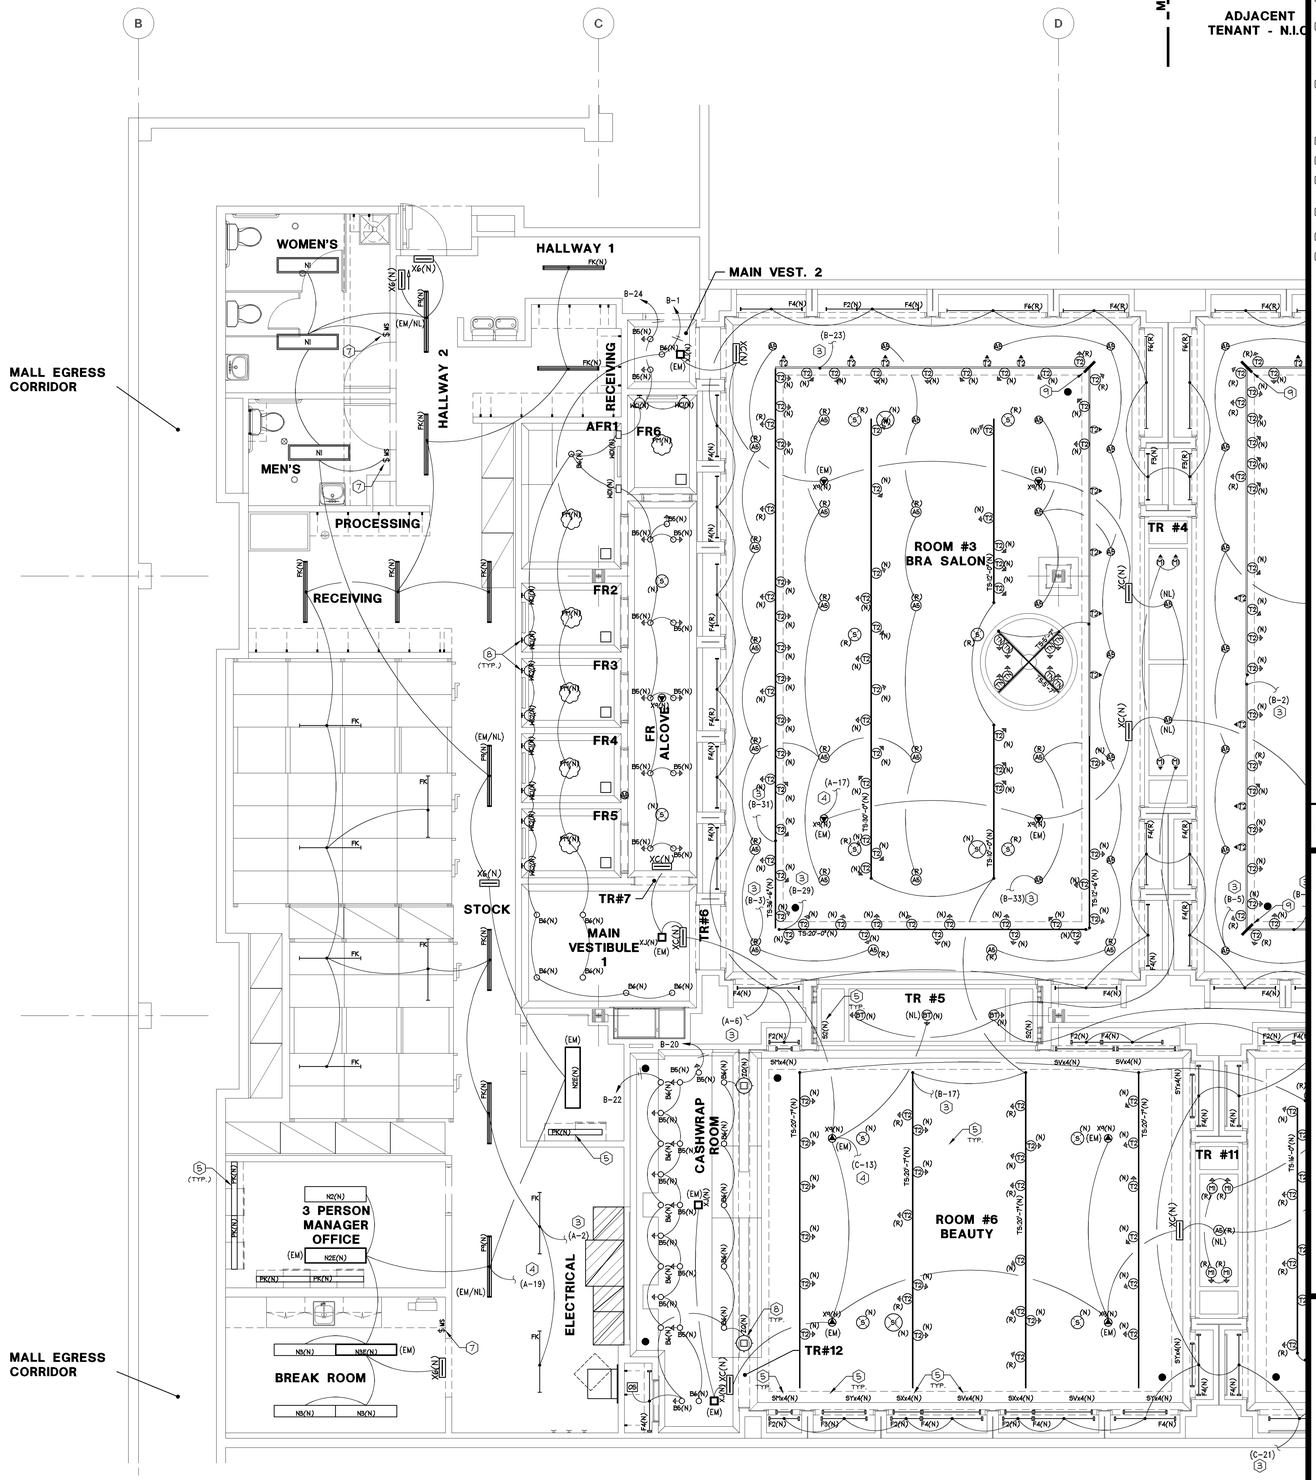

1. EXISTING LIGHT FIXTURES AND DEVICES IN CEILING ARE TO REMAIN, UNLESS NOTED OTHERWISE. FIELD VERIFY.
2. ~~NEW LIGHT FIXTURES, SPEAKERS, ETC FURNISHED BY LSD&C AND INSTALLED BY ELECTRICAL CONTRACTOR. VERIFY EXACT LOCATIONS WITH ARCHITECT AND LSD&C PROJECT MANAGER PRIOR TO WORK COMMENCEMENT.~~
3. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ALL JUNCTION BOXES, CONDUIT AND CONDUCTORS TO CONNECT LIGHT FIXTURE(S) TO NEAREST LIGHTING CIRCUIT INDICATED ON THE PLAN. FIELD VERIFY. REFER TO "AS-BUILT" DRAWINGS, AND THE EXISTING PANEL BOARD SCHEDULE. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY THE FIXTURE WATTAGE AND CONDUCT A FIELD TEST TO AVOID CIRCUIT OVERLOADS. ELECTRICAL CONTRACTOR SHALL NOT EXCEED 1600 WATTS FOR ANY SINGLE LIGHTING CIRCUIT.
4. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ALL JUNCTION BOXES, CONDUIT AND CONDUCTORS TO CONNECT LIGHT FIXTURE(S) TO NEAREST EMERGENCY/EXIT LIGHTING CIRCUIT INDICATED ON THE PLAN. FIELD VERIFY. REFER TO "AS-BUILT" DRAWINGS, AND THE EXISTING PANEL BOARD SCHEDULE. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY THE FIXTURE WATTAGE AND CONDUCT A FIELD TEST TO AVOID CIRCUIT OVERLOADS. ELECTRICAL CONTRACTOR SHALL NOT EXCEED 1600 WATTS FOR ANY SINGLE LIGHTING CIRCUIT.
5. REFER TO SHEET E02.1 FOR POWER REQUIREMENTS.
6. LIGHT FIXTURES TO BE INSTALLED IN MILLWORK FIXTURE, NOT IN CEILING. VERIFY WITH LSD&C.
7. ELECTRICAL CONTRACTOR SHALL INSTALL OCCUPANCY MOTION SENSOR SWITCH FOR CONTROL OF LIGHTS AS SHOWN. ELECTRICAL CONTRACTOR SHALL SET SWITCH FOR 15 MINUTES. MOUNT AT 44"AFF.
8. JUNCTION BOX INSTALLED AT THE CENTERLINE OR MOUNTING PLATE OF WALL SCONCE. SEE ARCHITECTURAL DRAWINGS FOR MOUNTING HEIGHTS.
9. BREAK-OFF CIRCUIT.
10. FURNISH AND INSTALL JUNCTION BOX, TOGGLE DISCONNECT SWITCH IN NON-VISIBLE LOCATION, FINAL CONNECTION FOR 120 VOLT SIGN AND CONDUIT PER DETAIL. SIGN IS FURNISHED WITH INTERNAL GROUND FAULT PROTECTION BY SIGN MANUFACTURER PER N.E.C. ARTICLE 600-23B. VERIFY EXACT LOCATION OF JUNCTION BOX WITH SIGN MANUFACTURER. (REUSE EXISTING JUNCTION BOX AND CONDUIT INTO SPACE IF ALREADY INSTALLED. VERIFY IN FIELD EXACT LOCATION ON CANOPY).

NOTE:
THE CIRCUIT FOR SIGNAGE MUST BE A DEDICATED ISOLATED 3-LINE CIRCUIT CONSISTING OF HOT, NEUTRAL, AND GROUND WIRES LEADING DIRECTLY TO THE PANEL.

NOTE:
LENGTH OF FLEXIBLE METAL CONDUIT OR AC90(CANADA) IS NOT TO EXCEED 6'-0".

NOTE:
REFER TO SHEET E04.1 FOR ELECTRICAL LIGHTING SCHEDULE, LIGHT DESCRIPTIONS. AND CONSTRUCTION NOTES.

NOTE:
REFER TO SHEET E05.1 FOR PANEL SCHEDULE AND LIGHTING ZONE DESIGNATIONS.

NOTE:
ELECTRICAL CONTRACTOR SHALL REFER TO ARCHITECTURAL SHEETS FOR MOUNTING HEIGHTS AND INSTALLATION DETAILS FOR SUSPENDED LIGHTING IN NON-SALES AREA.

NOTE:
GENERAL CONTRACTOR SHALL VERIFY CEILING FIRE RATING WITH ARCHITECT, AND BOX OR TENT ALL RECESSED LIGHT FIXTURES, IF REQUIRED, TO MAINTAIN CEILING FIRE RATING.

NOTE:
LIGHT FIXTURES THAT HAVE AN (N) ARE NEW. LIGHT FIXTURES WITH AN (R) ARE RELOCATED AND ALL OTHER LIGHT FIXTURES ARE EXISTING TO REMAIN. FOR LIGHT FIXTURES THAT ARE RELOCATED E.C. SHALL FURNISH AND INSTALL ALL J-BOXES ETC NEEDED TO RELOCATED DEVICES SHOWN. E.C. SHALL VERIFY ALL DEVICES AND EQUIPMENT ARE FUNCTIONAL/OPERATIONAL AND CLEAN ALL TO A NEW-LIKE CONDITION. FURNISH AND INSTALL NEW DEVICES IF EXISTING ARE NOT OPERATIONAL INCLUDE ALL COSTS IN BID.

NOTE:
WE ARE REMOVING LESS THAN 50% OF THE LIGHTS. WE REMOVED 20,495 WATTS OF LIGHTS AND ARE ADDING BACK 17,399 WATTS. SO WE ADDED LESS WATTAGE THAN WE REMOVED.

ELECTRICAL LIGHTING PLAN KEYNOTES

NTS

C 10/28/11

N

"VERIFY ALL FIELD CONDITIONS PRIOR TO BID"

ELECTRICAL LIGHTING PLAN

1/4" = 1'-0"

E

Thorson • Baker + Associates
CONSULTING ENGINEERS
3030 West Streetsboro Road (330) 659-6688 Ph.
Richfield, Ohio 44286 (330) 659-6675 Fax

Limitedbrands
LIMITED STORE PLANNING, INC.
d/b/a STORE DESIGN & CONSTRUCTION
Three Limited Parkway · Columbus, Ohio 43230
Telephone: 614.415.7000 · Fax: 614.415.7349

PROHIBITION OF REUSE:
THESE DRAWINGS AND SPECIFICATIONS WERE PREPARED FOR USE ON A SPECIFIC SITE, CONTEMPORANEOUSLY WITH THEIR ISSUE DATE; THEY ARE NOT INTENDED FOR USE ON A DIFFERENT PROJECT OR SITE. ANY REUSE WITHOUT THE WRITTEN VERIFICATION OR ADAPTATION BY THE LIMITED BRANDS, INC. FOR THE SPECIFIC PURPOSE INTENDED WILL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO THE LIMITED BRANDS, INC. AND ITS CONSULTANTS. ANY REPRODUCTION OF THESE DRAWINGS AND SPECIFICATIONS, IN WHOLE OR IN PART, OR ANY REPRODUCTION OF THESE DRAWINGS AND SPECIFICATIONS SHALL BE MADE WITHOUT THE WRITTEN PERMISSION OF THE LIMITED BRANDS, INC. AND BEAR THE FOLLOWING COPYRIGHT NOTICE: "© 2013 LIMITED BRANDS, INC. ALL RIGHTS RESERVED." ANY REUSE OF THESE DRAWINGS AND SPECIFICATIONS