


ELECTRICAL LIGHTING PLAN

"VERIFY ALL FIELD CONDITIONS PRIOR TO BID"

- ELECTRICAL CONTRACTOR SHALL INSTALL OCCUPANCY MOTION SENSOR SWITCH FOR CONTROL OF LIGHTS AS SHOWN. ELECTRICAL CONTRACTOR SHALL SET SWITCH FOR 15 MINUTES. MOUNT AT 44" AFF.
 - BREAK-OFF CIRCUIT.
 - JUNCTION BOX INSTALLED AT THE CENTERLINE OR MOUNTING PLATE OF WALL SCONCE. SEE ARCHITECTURAL DRAWINGS FOR MOUNTING HEIGHTS.
 - LOCATE RF ANTENNA ABOVE CEILING IN ACCESSIBLE LOCATION WITHIN REACH OF ACCESS POINT. MOUNT TO BOTTOM OF STRUCTURE IF POSSIBLE. PROVIDE 1/2" CONDUIT TO RF ANTENNA.
 - EXISTING JUNCTION BOX, TOGGLE DISCONNECT SWITCH IN NON-VISIBLE LOCATION. FINAL CONNECTION FOR 120 VOLT SIGN AND CONDUIT PER DETAIL. SIGN IS FURNISHED WITH INTERNAL GROUND FAULT PROTECTION BY SIGN MANUFACTURER PER N.E.C. ARTICLE 600-238. VERIFY EXACT LOCATION OF JUNCTION BOX WITH SIGN MANUFACTURER. (REUSE EXISTING JUNCTION BOX AND CONDUIT INTO SPACE IF ALREADY INSTALLED. VERIFY IN FIELD EXACT LOCATION ON CANOPY).
- NOTE:
THE CIRCUIT FOR SIGNAGE MUST BE A DEDICATED ISOLATED 3-LINE CIRCUIT CONSISTING OF HOT, NEUTRAL, AND GROUND WIRES LEADING DIRECTLY TO THE PANEL.
- REFER TO SHEET E02.1 AND E02.2 FOR POWER REQUIREMENTS.
 - LIGHT FIXTURES TO BE INSTALLED IN MILLWORK FIXTURE, NOT IN CEILING. VERIFY WITH LS&C.
 - LIGHT FIXTURES ARE MOUNTED TO A MOVABLE ACCESS PANEL. INSTALL WITH ENOUGH SLACK TO ALLOW THE PANEL TO FULLY OPEN AND NOT PUT EXCESS TENSION ON THE WIRE. REFER TO ARCHITECTURAL DRAWINGS FOR MORE INFORMATION.

- NEW CKT
EXISTING CKT
- NOTE:
REFER TO SHEET E04.1 AND E08.1 FOR ELECTRICAL LIGHTING SCHEDULE AND LIGHT DESCRIPTIONS.
- NOTE:
REFER TO SHEET E05.1 FOR PANEL SCHEDULE AND LIGHTING ZONE DESIGNATIONS.
- NOTE:
LENGTH OF FLEXIBLE METAL CONDUIT, MC TYPE CABLE, OR AC90(CANADA) IS NOT TO EXCEED 6'-0".
- NOTE:
ELECTRICAL CONTRACTOR SHALL REFER TO ARCHITECTURAL SHEETS FOR MOUNTING HEIGHTS AND INSTALLATION DETAILS FOR SUSPENDED LIGHTING IN NON-SALES AREA.
- NOTE:
GENERAL CONTRACTOR SHALL VERIFY CEILING FIRE RATING WITH ARCHITECT, AND BOX OR TENT ALL RECESSED LIGHT FIXTURES, IF REQUIRED, TO MAINTAIN CEILING FIRE RATING.

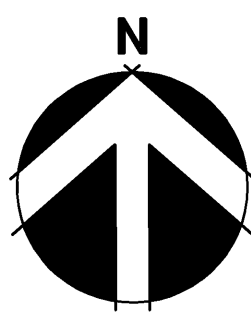

1/4" = 1'-0"

A



Limitedbrands

LIMITED STORE PLANNING, INC.
d/b/a STORE DESIGN & CONSTRUCTION
Three Limited Parkway Columbus, Ohio 43230
Telephone: 614.415.7000 Fax: 614.415.7349

010500133

VICTORIA'S SECRET
QUAIL SPRINGS MALL
SPACE NO. 119
2501 WEST MEMORIAL RD.
OKLAHOMA CITY, OK 73134

REVISIONS:
REQUIRED BY: DATE:
DESIGNED BY: ASB
DRAWN BY: ASB
CHECKED BY: DFG

PROJECT INFORMATION:

REVISIONS:
REQUIRED BY: DATE:
DESIGNED BY: ASB
DRAWN BY: ASB
CHECKED BY: DFG

ELITE CONSTRUCTION GROUP
LAKE JACKSON, TX
PHONE: 979.385.0715
NOTE: THESE PRINTS HAVE BEEN
REDUCED BY 50 PERCENT SCALE
WILL BE 50 PERCENT OF WHAT IS
NOTED ON PLANS

DATE ISSUED: 05.30.2014
DESIGNED BY: ASB
DRAWN BY: ASB
CHECKED BY: DFG

ELECTRICAL
LIGHTING
PLAN

DRAWING NUMBER:

E03.2