

ELECTRICAL LANDLORD'S COMMENTS:  
ALL HOME RUNS TO TENANT'S PANELS SHALL BE STEEL CONDUIT OR EMT.  
ALL EXPOSED WIRING IN CEILINGS OR INTERIOR WALLS MUST BE IN RIGID STEEL CONDUIT OR EMT.  
ALL WIRING IN LANDLORD'S DEMISING WALLS MUST BE IN RIGID STEEL CONDUIT OR EMT.  
CONDUIT SHALL NOT BE SUPPORTED FROM THE ROOF DECK.  
COORDINATE ALL FLOOR CUT MEANS AND METHODS OR ROUTING CONDUIT THROUGH THE FLOOR THE MALL OPERATIONS.  
VERIFY ALL FIELD CONDITIONS PRIOR TO BID.  
TENANT SUPPLIED 24/7 TIMELOCK SHALL CONTROL THE FOLLOWING: STOREFRONT SIGNAGE, SHOW WINDOW LIGHTS, SHOW WINDOW RECEPTACLES AND ENTRY LIGHTS.  
COORDINATE ALL NEW ROUTING OF CONDUIT, FEEDER CABLES AND CONNECTIONS TO LANDLORDS MAIN ELECTRICAL GEAR WITH MALL OPERATIONS.


- ① ELECTRICAL CONTRACTOR SHALL INSTALL OCCUPANCY MOTION SENSOR SWITCH FOR CONTROL OF LIGHTS AS SHOWN. ELECTRICAL CONTRACTOR SHALL SET SWITCH FOR 15 MINUTES. MOUNT AT 44" AFF.
- ② CIRCUIT SALES EXIT AND EMERGENCY/NIGHT LIGHT BATTERY BACK-UP BALLAST TO CIRCUIT A-1
- ③ ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL 4" JUNCTION BOX FOR INTERNALLY ILLUMINATED LED GINGHAM ABOVE CANOPY, CONNECTION TO TRANSFORMER. REFER TO ARCHITECTURAL DRAWINGS FOR MORE INFORMATION.
- ④ ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL 4" JUNCTION BOX FOR INTERNALLY ILLUMINATED LED GINGHAM TRANSOM STOREFRONT, CONNECTION TO TRANSFORMER. REFER TO ARCHITECTURAL DRAWINGS FOR MORE INFORMATION.
- ⑤ CONTRACTOR TO ROTATE FIXTURES SO THAT UL LABELS ARE NOT VISIBLE TO CUSTOMER.
- ⑥ ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL 4" JUNCTION BOX FOR SHADOW BOXES. MOUNT JUNCTION BOX BELOW SHADOW BOX FOR CONNECTION TO TRANSFORMER. REFER TO ARCHITECTURAL DRAWINGS FOR MORE INFORMATION.
- ⑦ PROVIDE JUNCTION BOX FOR BLADE SIGN MOUNTED ON INTERIOR OF STORE, ACCESSIBLE ABOVE CEILING.
- ⑧ FURNISH AND INSTALL JUNCTION BOX, TOGGLE DISCONNECT SWITCH IN NON-VISIBLE LOCATION, AND FINAL CONNECTION FOR 120 VOLT SIGN. SIGN IS FURNISHED WITH INTERNAL GROUND FAULT PROTECTION BY SIGN MANUFACTURER (PER N.E.C. ARTICLE 600-235). VERIFY EXIST LOCATION OF JUNCTION BOX WITH SIGN MANUFACTURER. (REUSE EXISTING JUNCTION BOX AND CONDUIT INTO SPACE IF ALREADY INSTALLED. VERIFY IN FIELD EXIST LOCATION ON CANOPY). FOR CANOPY POWER SEE SHEET A06.01 FOR WALL PENETRATION IN ROUTING CONDUIT.  
NOTE:  
THE CIRCUIT FOR SIGNAGE MUST BE A DEDICATED ISOLATED 3-LINE CIRCUIT CONSISTING OF HOT, NEUTRAL, AND GROUND WIRES LEADING DIRECTLY TO THE PANEL.
- ⑨ LIGHT FIXTURES TO BE INSTALLED IN MILLWORK FIXTURE, NOT IN CEILING, VERIFY WITH LSD&C. REFER TO SHEET E02.01 FOR POWER REQUIREMENTS.
- ⑩ AA' LIGHTS ARE REMODEL HOUSING AND DO NOT INSTALL DURING ROUGH FRAMING.
- ⑪ PROVIDE OCCUPANCY SENSOR TO AUTOMATICALLY TURN OFF WITHIN 30 MINUTES OF ALL OCCUPANTS LEAVING THE SPACE.
- ⑫ CIRCUIT NONSALES EXIT AND EMERGENCY/NIGHT LIGHT BATTERY BACKUP BALLAST TO LOCAL CIRCUIT AHEAD OF ALL SWITCHING.

**NTS**


---

**E0301-D00-NOTE**

D

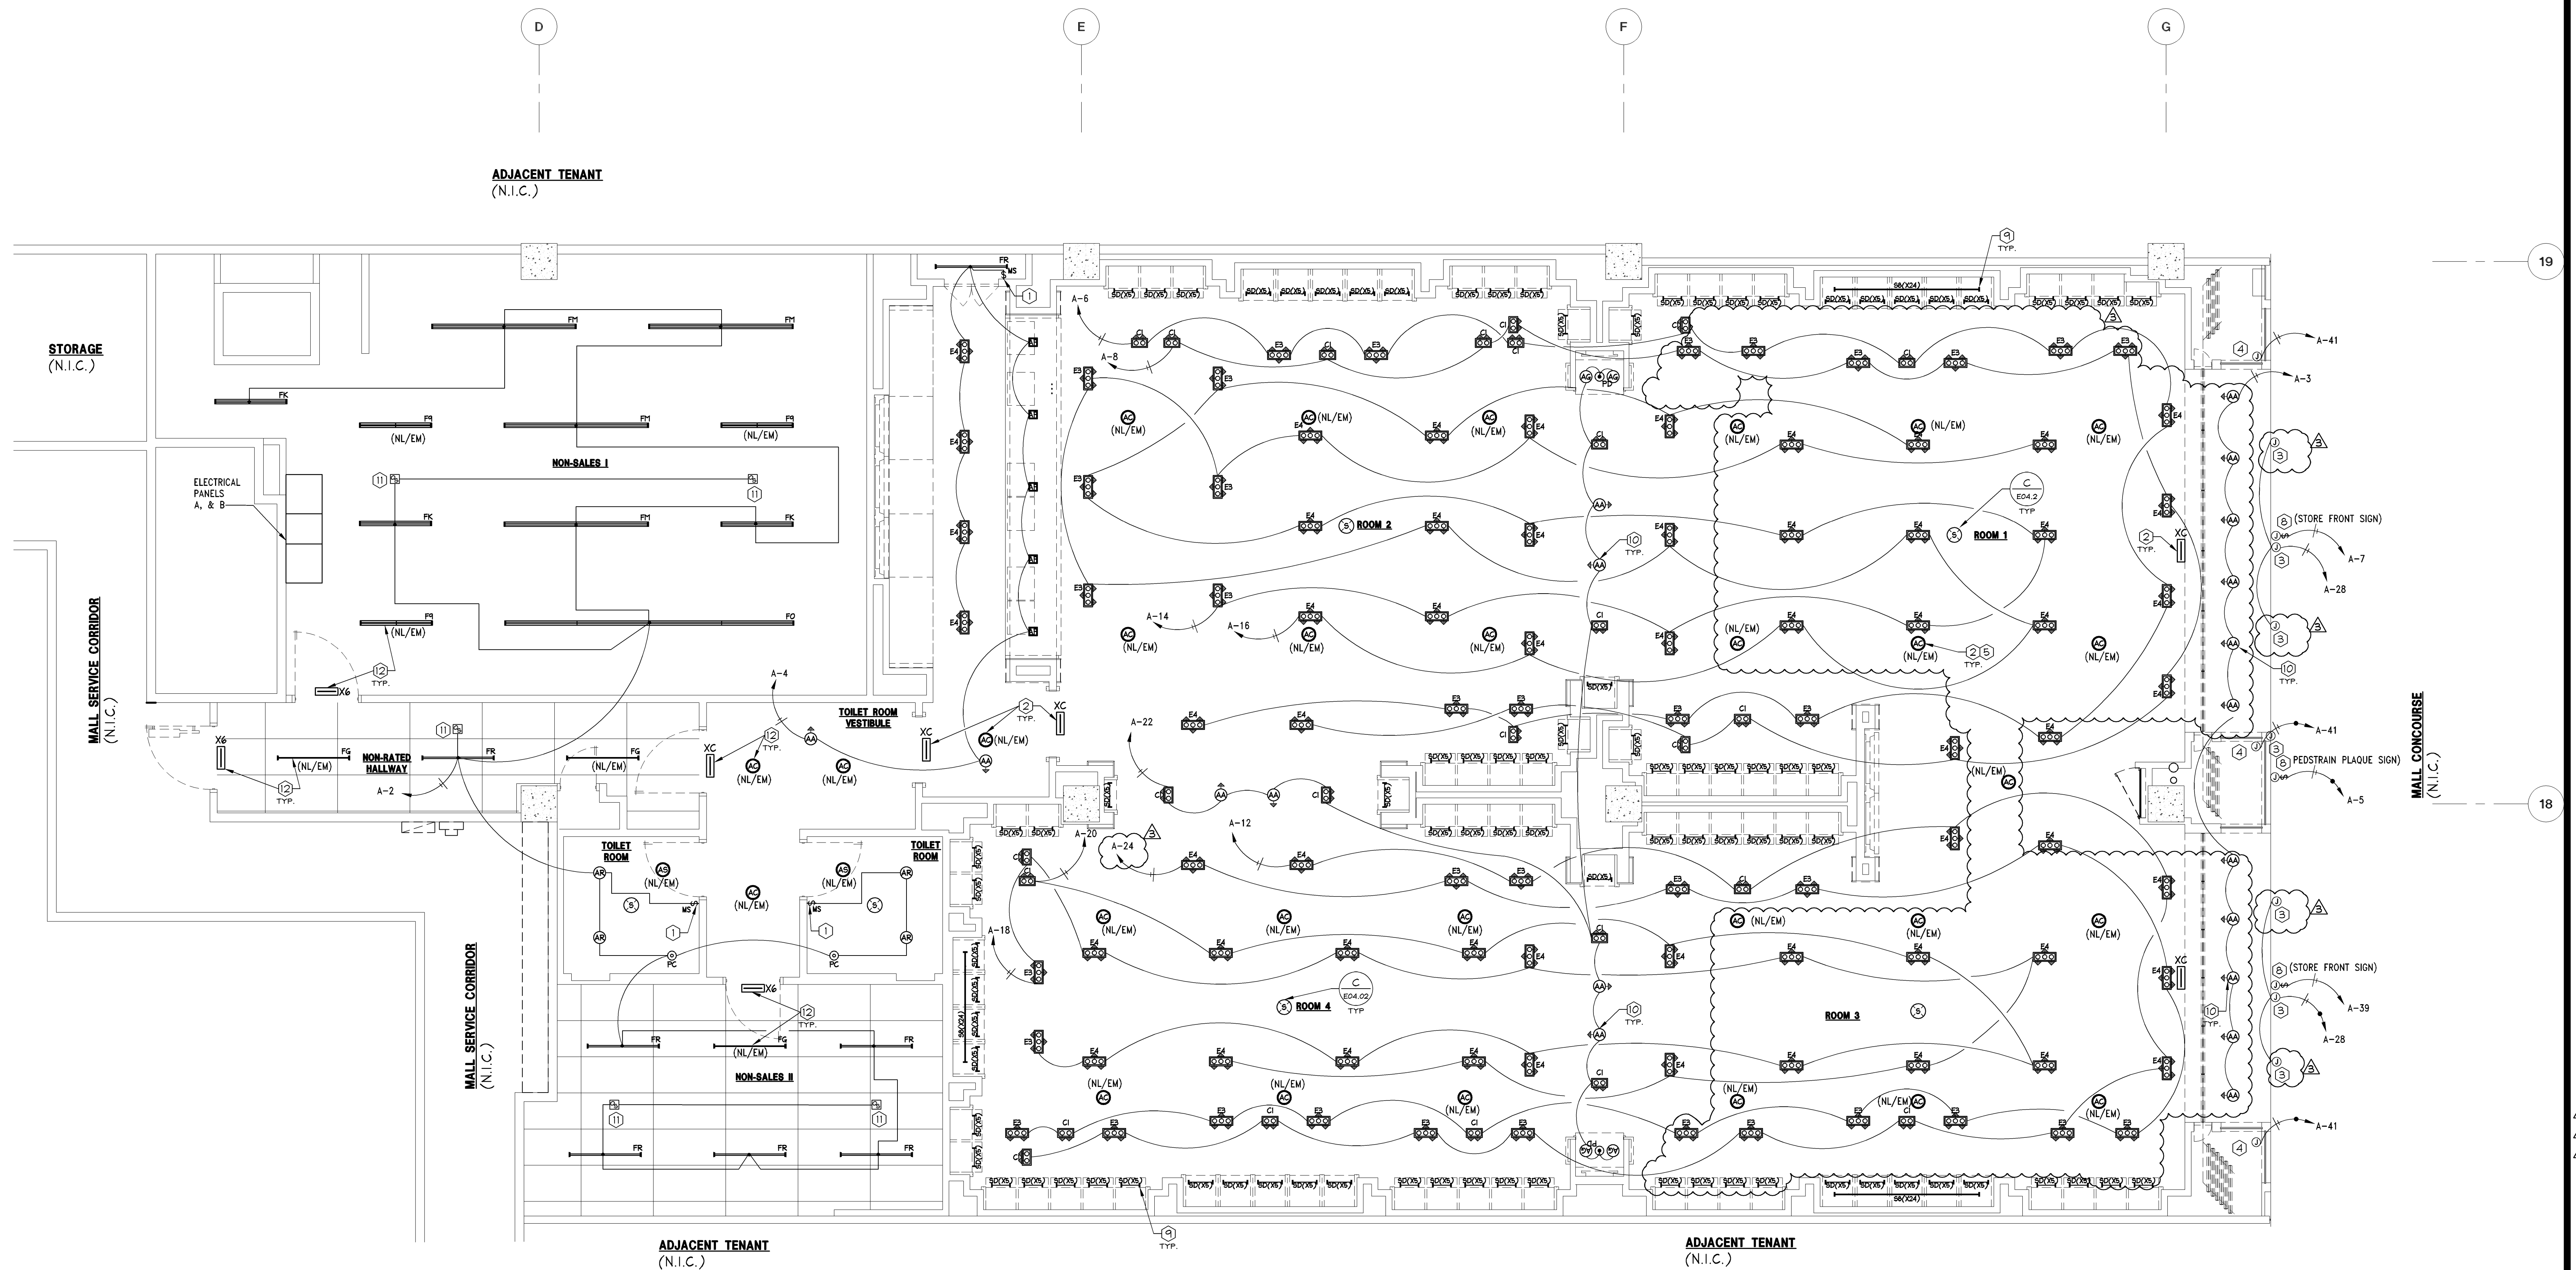

**"VERIFY ALL FIELD CONDITIONS PRIOR TO BID"**

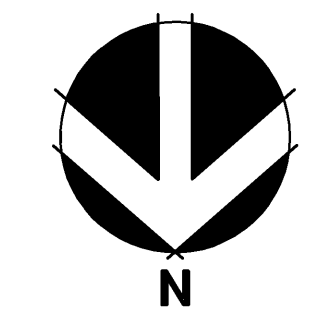

---

**1/4" = 1'-0"**

**A**

**Limitedbrands**  
**LIMITED STORE PLANNING, INC.**  
**d/b/a STORE DESIGN & CONSTRUCTION**  
 Three Limited Parkway • Columbus, Ohio 43230  
 Telephone: 614.415.7000 • Fax: 614.415.7949

THESE DRAWINGS AND SPECIFICATIONS ARE PREPARED ON USE ON A SPECIFIC PROJECT, AND ARE NOT TO BE USED FOR ANY OTHER PROJECT. ANY REUSE OF THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT IS PROHIBITED. ANY REUSE OF THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT IS PROHIBITED. ANY REUSE OF THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT IS PROHIBITED.

PROJECT INFORMATION:

2420016

BATH & BODY WORKS

THE GALLERIA II

SPACE NO. B3680

5085 WESTHEIMER RD.

HOUSTON, TX 77056

SCOPE: TYPE: FULL REMODEL

USMC PROJECT #: 0006/216

PACKAGE: K/E PROJECT #: 13084C

PKG 1+1

REVISIONS:		DATE
1	BUILDING DEPARTMENT COMMENTS	04/11/14
2	BUILDING DEPARTMENT COMMENTS	05/8/14
3	DESIGN CHANGES/ LANDLORD COMMENTS/ MASTERS UPDATES	05/28/14

ELITE CONSTRUCTION GROUP  
LAKE JACKSON, TX  
PHONE: 979-285-0712  
NOTE: THESE PRINTS HAVE BEEN  
REDUCED BY 50 PERCENT. SCALE  
WILL BE 50 PERCENT OF WHAT IS  
NOTED ON PLANS

DATE ISSUED: 3/7/14  
DESIGNED BY: JEH  
DRAWN BY: JEH  
CHECKED BY: RAP

## ELECTRICAL LIGHTING PLAN

DRAWING NUMBER:  
E03.01