

- 1 RECEPTABLES AND COVERPLATES DESIGNATED "5F" SHALL BE WHITE IN COLOR AND CEILING MOUNTED. REFER TO ARCHITECTURAL PLANS SUPPORT BOX FROM STRUCTURE.
- 2 RECEPTABLES AND COVERPLATES IN "NON-SALES" SHALL BE WHITE IN COLOR. MOUNT ALL RECEPTABLES AT 15" A.F.F., EXCEPT AS NOTED ON PLAN.
- 3 CONDUIT FOR TRAFFIC COUNTER. INSTALL 1" CONDUIT FROM IFS ENCLOSURE TO J-BOX AT THE MAIN ENTRY OF STORE. LOCATE J-BOX WITHIN 18" OF SOFFIT FOR FUTURE INSTALLATION OF THE TRAFFIC COUNTER.
- 4 INSTALL A DELIVERY BUZZER SYSTEM AS SHOWN ON DRAWINGS. L&D&C SHALL FURNISH A COMPLETE EDWARDS DELIVERY BUZZER SYSTEM, COMPLETE WITH TRANSFORMER, BUZZERS, LOWVOLT COVERPLATES, AND PUSHBUTTON (WEATHERPROOF FOR OUTSIDE LOCATIONS). THE ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ALL NECESSARY JUNCTION BOXES, CONDUIT, AND WIRE TO COMPLETELY INSTALL THE DELIVERY BUZZER SYSTEM. ALL JUNCTION BOXES SHALL BE MOUNTED VERTICALLY. REFER TO SHEET A11.01, DETAIL E FOR MORE INFORMATION.
- 5 TELEPHONE OUTLET IN WALL FOR SECURITY SYSTEM. INSTALL EMPTY 3/4" CONDUIT, WITH PULLWIRE, BACK TO TELCO SECTION OF IFS ENCLOSURE. TELEPHONE WIRE AND #14-6 JACK FOR TWO-LINE TELEPHONE BY OTHERS. SEE PLAN FOR HEIGHT.
- 6 EXTEND 1" TELEPHONE CONDUIT FROM SERVICE ENTRANCE AT DEMISING WALL TO TELEPHONE/DATA SECTION OF IFS ENCLOSURE.
- 7 SOUND SYSTEM. E.C. TO FURNISH AND INSTALL ALL CONDUIT AND JUNCTION BOXES, AND PERFORM ALL WORK AS INDICATED IN THE DETAIL.
- 8 FURNISH AND INSTALL A 3/4" CONDUIT WITH PULLWIRE FROM HVAC SECTION OF IFS ENCLOSURE, UP TO ABOVE CEILING. COORDINATE EXACT REQUIREMENT WITH MECHANICAL CONTRACTOR.
- 9 JUNCTION BOX FOR DATA, TELEPHONE, FAX, AND POLLING. INSTALL EMPTY 1" CONDUIT, WITH PULLWIRE, BACK TO TELCO SECTION OF IFS ENCLOSURE. DATA/TELEPHONE WIRE AND COVERPLATE BY OTHERS.
- 10 20 AMP, 120 VOLT, DEDICATED CIRCUIT, #16-30-0-0 RECEPTACLE, WITH ISOLATED THIRD WIRE GROUND, IN A 1/2" CONDUIT BACK TO PANELBOARD SECTION OF IFS ENCLOSURE FOR COMPUTER TERMINAL. DO NOT SHARE ANY PART OF THIS CIRCUIT WITH ANY OTHER BRANCH CIRCUITS. CONNECT TO CIRCUIT SHOWN ON POWER PLAN.
- 11 20 AMP, 120 VOLT CIRCUIT AND DUPLEX WHITE RECEPTACLE AND COVERPLATE FOR UTILITY POWER, IN A SINGLE 1/2" CONDUIT BACK TO PANELBOARD SECTION OF IFS ENCLOSURE. CONNECT TO CIRCUIT SHOWN ON POWER PLAN.
- 12 20 AMP, 120 VOLT CIRCUIT AND QUAD RECEPTACLE FOR UTILITY POWER, IN A SINGLE 1/2" CONDUIT BACK TO PANELBOARD SECTION OF IFS ENCLOSURE. CONNECT TO CIRCUIT SHOWN ON POWER PLAN. REFER TO N/E04.02 FOR OUTLET LOCATIONS. DO NOT SCALE FROM THIS SHEET.
- 13 IFS ENCLOSURE. ALL CONDUITS STUBBED INTO IFS ENCLOSURE SHALL BE INSTALLED IN A CLEAN AND NEAT MANNER. ANCHOR IFS ENCLOSURE ACCORDING TO MANUFACTURERS SPECIFICATIONS AND LOCAL CODES IN SEISMIC AREAS. REFER TO SPECIFICATIONS AND E03.01 FOR MORE INFORMATION.


- 14 HOME RUN TO VIDEO DRIVER CABINET.
- 15 JUNCTION BOX INSTALLED AT 48" A.F.F. WITH FACE FLUSH TO DRYWALL AND 1/2" CONDUIT UP IN WALL TO ABOVE CEILING FOR TEMPERATURE T-STAT(S)/SENSOR(S). COORDINATE EXACT REQUIREMENTS WITH MECHANICAL CONTRACTOR. MECHANICAL CONTRACTOR SHALL INSTALL L&D&C FURNISHED CONTROL CABLE FROM JUNCTION BOX TO HVAC UNITS.
- 16 MECHANICAL CONTRACTOR SHALL FURNISH AND INSTALL AIR DEVICE OR ACCESS PANEL TO BE USED AS ACCESS TO EQUIPMENT LOCATED ABOVE THE CEILING. THIS CONTRACTOR SHALL BE RESPONSIBLE TO ENSURE THAT A MINIMUM UNOBSTRUCTED FREE AREA OF 3-FEET VERTICALLY AND 3-FEET HORIZONTALLY IN ALL DIRECTIONS AROUND EQUIPMENT IS MAINTAINED TO ALLOW FOR INSTALLATION AND MAINTENANCE OF EQUIPMENT. IF THIS FREE AREA CANNOT BE OBTAINED, CONTACT THE L&D&C'S PROJECT MANAGER IMMEDIATELY.
- 17 20 AMP RECEPTACLE @ 42" A.F.F. FOR MICROWAVE. IF PLAN LOCATION IS NOT ACCEPTABLE, IMMEDIATELY CONTACT L&D&C PROJECT MANAGER FOR DIRECTION. SEE SHEET A14.02 FOR ADDITIONAL INFORMATION.
- 18 20 AMP RECEPTACLE @ 18" A.F.F. FOR REFRIGERATOR. IF PLAN LOCATION IS NOT ACCEPTABLE, IMMEDIATELY CONTACT L&D&C PROJECT MANAGER FOR DIRECTION. SEE SHEET A14.02 FOR ADDITIONAL INFORMATION.
- 19 JUNCTION BOX FOR WATER HEATER ELECTRICAL CONNECTION. FURNISH AND INSTALL CODE REQUIRED DISCONNECT SWITCH. COORDINATE EXACT LOCATION AND RELATED REQUIREMENTS WITH PLUMBING CONTRACTOR PRIOR TO WORK COMMENCEMENT.
- 20 JUNCTION BOX MOUNTED AT 42" A.F.F. FOR HAND DRYER ELECTRICAL CONNECTION (FOR PUBLIC ACCESSIBLE RESTROOMS ONLY). COORDINATE EXACT LOCATION WITH ARCHITECT AND L&D&C PROJECT MANAGER PRIOR TO WORK COMMENCEMENT.
- 21 DUCT MOUNTED SMOKE DETECTOR. ELECTRICAL CONTRACTOR TO CONNECT DETECTOR TO FIRE ALARM PANEL IN SPACE.
- 22 KEYPAD FOR SECURITY SYSTEM, MOUNTED AT 54" A.F.F., AND 6" MIN FROM CENTERLINE OF J-BOX TO ANY CONFLICTING ITEM ON THE WALL. MOUNT ON HANDLE-SIDE OF THE NON-SALES DOOR LEADING TO THE SALES AREA, WITH 3/4" CONDUIT FROM JUNCTION BOX TO ABOVE CEILING.
- 23 MOTION DETECTOR TO BE INSTALLED AT EACH ENTRY/ROLLING GRILLE, EVERY EXIT DOOR, ABOVE EVERY CASHWRAP, AND IN THE NON-SALES CEILING CLOSE TO THE NON-SALES/SALES DOOR. VERIFY EXACT LOCATIONS WITH L&D&C PROJECT MANAGER PRIOR TO WORK COMMENCEMENT.
- 24 JUNCTION BOX AND CODE REQUIRED DISCONNECT SWITCH FOR MOTORIZED ROLL-UP GRILLE ELECTRICAL CONNECTION. COORDINATE EXACT LOCATION AND RELATED REQUIREMENTS WITH L&D&C PROJECT MANAGER PRIOR TO WORK COMMENCEMENT.
- 25 QUADRAPLEX RECEPTACLE, DUPLEX RECEPTACLE, AND COVERPLATES FOR CCTV. SEE DETAIL A/E04.02 COORDINATE EXACT LOCATION WITH ARCHITECT PRIOR TO ROUGH-IN AND WORK COMMENCEMENT.
- 26 DUPLEX RECEPTACLE WITH COVERPLATE AND JUNCTION BOX INSTALLED ON CEILING FOR CCTV SYSTEM VIEW MONITOR. COORDINATE EXACT LOCATION SEE SHEET A04.01/A12.03.
- 27 DOOR CONTACT FOR BURGLAR ALARM. GENERAL CONTRACTOR SHALL FURNISH AND INSTALL JUNCTION BOX AND 3/4" CONDUIT FROM ABOVE CEILING TO 6" A.F.F. ON SIDE JAMB FOR ALL ROLLING GRILLE DOORS, AND/OR 6" AWAY FROM DOOR, ALIGNED WITH THE TOP OF THE DOOR FOR ALL SWING DOORS.
- 28 4"x4" JUNCTION BOX MOUNTED AT 60" A.F.F. WITH 1-1/4" CONDUIT (WITH BUSHING) UP TO CEILING. VERIFY EXACT LOCATION WITH ARCHITECT PRIOR TO WORK COMMENCEMENT.
- 29 RECEPTABLES AND COVERPLATES WITHIN SHOW WINDOW SHALL BE WHITE IN COLOR. REFER TO ARCHITECTURAL DETAILS FOR EXACT LOCATION AND MOUNTING REQUIREMENTS.
- 30 RECEPTABLES AND COVERPLATES DESIGNATED "G" SHALL BE DARK GRAY IN COLOR. EXCEPT AS NOTED ON PLAN, MOUNT AS CLOSE TO FRONT OF WALL AS POSSIBLE (TO CLEAR BASE CABINET), AT 15" A.F.F. REFER TO ARCHITECTURAL SHEET A10.01, DETAIL A FOR MORE INFORMATION.
- 31 JUNCTION BOX AND TOGGLE DISCONNECT SWITCH FOR 208V, 14 WATER HEATER ELECTRICAL CONNECTION. COORDINATE EXACT LOCATION AND RELATED REQUIREMENTS WITH PLUMBING CONTRACTOR PRIOR TO WORK COMMENCEMENT.
- 32 SAW CUT/CORE DRILL AND PATCH FLOOR SLAB AS REQUIRED FOR UNDERSLAB CONDUIT.
- 33 ELECTRICAL CONTRACTOR SHALL COORDINATE EXACT LOCATIONS OF BARREL KEY SWITCHES BEFORE WORK COMMENCEMENT. ELECTRICAL CONTRACTOR SHALL CONNECT KEY SWITCH TO THE CONTROL BOARD AND THE DOOR LOCK INTERLOCK.
- 34 FURNISH AND INSTALL HORIZONTAL DUPLEX RECEPTACLE FOR POWER TO LED STICK/TAPE LIGHTING. VERIFY EXACT MOUNTING LOCATIONS SEE THE A10 SERIES.
- 35 LANDLORD HAS PROVIDED A JUNCTION BOX WITHIN THE TENANTS SPACE. TIE INTO THE LANDLORDS FIRE ALARM SYSTEM. CONTRACTOR SHALL COORDINATE WITH THE LANDLORD ENGINEER ALL FINAL SEQUENCES OF OPERATION.
- 36 FIRE ALARM DEVICES FURNISHED AND INSTALLED BY THE FIRE ALARM CONTRACTOR (REFER TO SPECIFICATIONS FOR MOUNTING HEIGHTS OR TYPE), WIRED BY ELECTRICAL CONTRACTOR.
- 37 SEE SHEET E05.01 ELECTRICAL EQUIPMENT DATA FOR WIRE SIZE.
- 38 PROVIDE A DEDICATED ISOLATED GROUND DUPLEX RECEPTACLE AND DATA BOX AT 15" AFF FOR A.L.L. SYSTEM.
- 39 KEY PAD AT BACK DOOR AT +48" AFF. SEE DETAIL-K SHEET E04.02.
- 40 LOCATE PANIC BUTTON ADJACENT TO ALL SYSTEM. SEE DETAIL-K SHEET E04.02.

- 41 PROVIDE 1/2" EMPTY CONDUIT WITH PULL STRING BACK TO IP-CAMERA CABINET.
- 42 PROVIDE 1/2" EMPTY CONDUIT WITH PULL STRING TO DATA SECTION OF IFS PANEL.
- 43 QUADRAPLEX IG RECEPTABLES, AND COVERPLATES FOR IP CAMERA SYSTEM. SEE DETAIL K/E04.02 COORDINATE EXACT LOCATION WITH ARCHITECT PRIOR TO ROUGH-IN AND WORK COMMENCEMENT.
- 44 PROVIDE JUNCTION BOX AT 60" AFF. FOR VOLUME CONTROL. PROVIDE 1/2" EMPTY CONDUIT WITH PULL STRING TO MUSIC SYSTEM AT MANAGER'S DESK.
- 45 PROVIDE JUNCTION ABOVE CEILING FOR DRINKING FOUNTAIN CHILLER. COORDINATE REQUIREMENT WITH PLUMBING CONTRACTOR.
- 46 DUCT MOUNTED SMOKE DETECTOR IS FIELD INSTALLED BY FIRE ALARM CONTRACTOR. ELECTRICAL CONTRACTOR SHALL INTERLOCK SMOKE DETECTOR WITH HVAC UNIT, REMOTE TEST ALARM STATION AND LANDLORDS FIRE ALARM SYSTEM. MAKE ALL FINAL CONNECTIONS AS REQUIRED FOR A COMPLETE SYSTEM. HVAC UNIT TO SHUT DOWN UPON ACTIVATION OF SMOKE DETECTOR. COORDINATE WITH LANDLORD TO AVOID CONFLICTS IN FIELD.
- 47 DEDICATED CIRCUIT WITH ISOLATED GROUND IN 1/2" CONDUIT BACK TO PANELBOARD AND EMPTY 1/2" EMPTY CONDUIT WITH PULL STRING BACK TO TELEPHONE BOARD FOR SENSORMATIC ANTI THEFT SYSTEM. COORDINATE EXACT REQUIREMENTS AND LOCATIONS WITH VENDOR. ENCLOSURE WITH SENSORMATIC POWER PACK AND DUPLEX RECEPTACLE MOUNTED ON VERTICAL FACE OF SOFFIT ABOVE CEILING WITH DEDICATED CIRCUIT. ALARM SHALL BE POSITIONED SO IT CAN BE HEARD THROUGH RETURN GRILL. COORDINATE SENSORMATIC FREQUENCY WITH ADJACENT TENANT SENSORMATIC SYSTEMS.
- 48 RECEPTACLE MOUNTED ABOVE COUNTERTOP. COORDINATE MOUNTING HEIGHT WITH MILLWORK VENDOR IN FIELD.
- 49 DEDICATED CIRCUIT WITH ISOLATED GROUND IN 1/2" CONDUIT BACK TO PANELBOARD AND EMPTY 1/2" EMPTY CONDUIT WITH PULL STRING BACK TO IP-CAMERA CABINET FOR "FOCAL" CABINET DISPLAY. COORDINATE WITH VENDOR FOR EXACT MOUNTING LOCATIONS REQUIREMENTS.
- 50 PLUG INTO QUAD OUTLET FOR SCENT-AIR DEVICE CONNECT TO CIRCUIT AS SHOWN.
- 51 QUAD OUTLET TO BE MOUNTED ABOVE CABINET AT 96-1/2" A.F.F.

NOTE:
REFER TO RESPONSIBILITY SCHEDULE FOR
CONTRACTOR'S RESPONSIBILITIES.

ELECTRICAL POWER PLAN KEYNOTES

ELECTRICAL LANDLORD'S COMMENTS:
ALL HOME RUNS TO TENANT'S PANELS SHALL BE STEEL CONDUIT OR EMT.
ALL EXPOSED WIRING IN CEILINGS OR INTERIOR WALLS MUST BE IN RIGID STEEL CONDUIT OR EMT.
ALL WIRING IN LANDLORD'S DEMISING WALLS MUST BE IN RIGID STEEL CONDUIT OR EMT.
CONDUIT SHALL NOT BE SUPPORTED FROM THE ROOF DECK.
COORDINATE ALL FLOOR CUT MEANS AND METHODS OR ROUTING CONDUIT THROUGH THE FLOOR THE WALL OPERATIONS.
VERIFY ALL FIELD CONDITIONS PRIOR TO BID.
TENANT SUPPLIED 24/7 TIMECLOCK SHALL CONTROL THE FOLLOWING: STOREFRONT SIGNAGE, SHOW WINDOW LIGHTS, SHOW WINDOW RECEPTABLES AND ENTRY LIGHTS.
COORDINATE ALL NEW ROUTING OF CONDUIT, FEEDER CABLES AND CONNECTIONS TO LANDLORDS MAIN ELECTRICAL GEAR WITH WALL OPERATIONS.

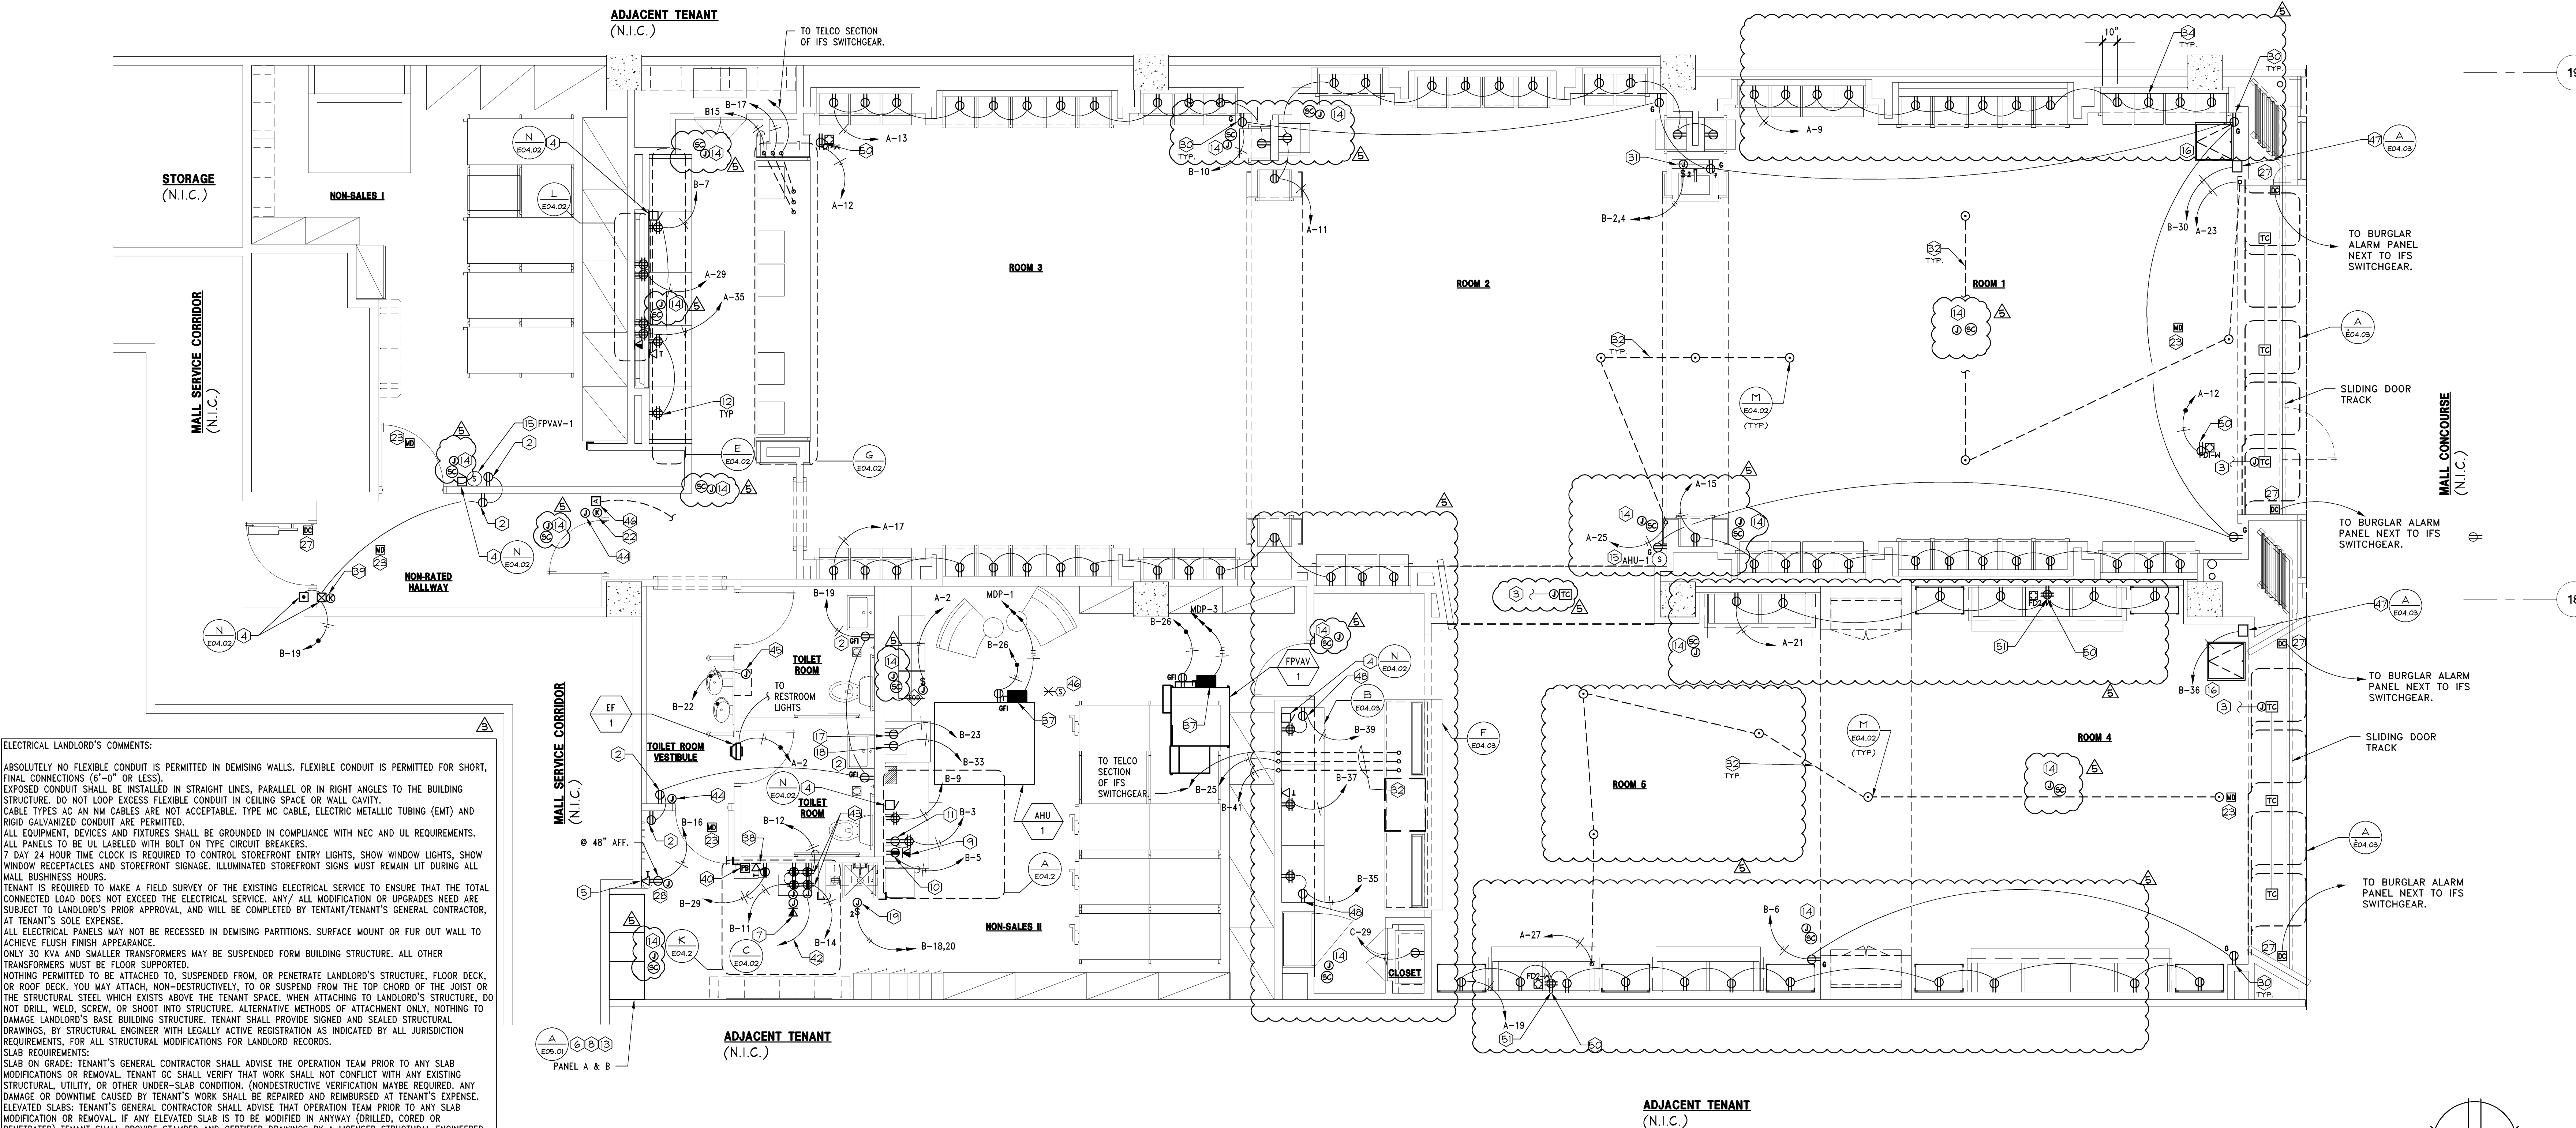

ELECTRICAL LANDLORD'S COMMENTS:
ABSOLUTELY NO FLEXIBLE CONDUIT IS PERMITTED IN DEMISING WALLS. FLEXIBLE CONDUIT IS PERMITTED FOR SHORT, FINAL CONNECTIONS (6"-0" OR LESS).
EXPOSED CONDUIT SHALL BE INSTALLED IN STRAIGHT LINES, PARALLEL OR IN RIGHT ANGLES TO THE BUILDING STRUCTURE. DO NOT LOOP EXCESS FLEXIBLE CONDUIT IN CEILING SPACE OR WALL CAVITY.
CABLE TYPES AC AN NM CABLES ARE NOT ACCEPTABLE. TYPE MC CABLE, ELECTRIC METALLIC TUBING (EMT) AND RIGID GALVANIZED CONDUIT ARE PERMITTED.
ALL EQUIPMENT, DEVICES AND FIXTURES SHALL BE GROUNDED IN COMPLIANCE WITH NEC AND UL REQUIREMENTS. ALL PANELS TO BE UL LABELED WITH BOLT ON TYPE CIRCUIT BREAKERS.
7 DAY 24 HOUR TIME CLOCK IS REQUIRED TO CONTROL STOREFRONT ENTRY LIGHTS, SHOW WINDOW LIGHTS, SHOW WINDOW RECEPTABLES AND STOREFRONT SIGNAGE. ILLUMINATED STOREFRONT SIGNS MUST REMAIN LIT DURING ALL MALL BUSINESS HOURS.
TENANT IS REQUIRED TO MAKE A FIELD SURVEY OF THE EXISTING ELECTRICAL SERVICE TO ENSURE THAT THE TOTAL CONNECTED LOAD DOES NOT EXCEED THE ELECTRICAL SERVICE. ANY ALL MODIFICATION OR UPGRADES NEED ARE SUBJECT TO LANDLORD'S PRIOR APPROVAL AND WILL BE COMPLETED BY TENANT/TENANT'S GENERAL CONTRACTOR, AT TENANT'S SOLE EXPENSE.
ALL ELECTRICAL PANELS MAY NOT BE RECESSED IN DEMISING PARTITIONS. SURFACE MOUNT OR FUR OUT WALL TO ACHIEVE FLUSH FINISH APPEARANCE.
ONLY 50 KVA AND SMALLER TRANSFORMERS MAY BE SUSPENDED FROM BUILDING STRUCTURE. ALL OTHER TRANSFORMERS MUST BE FLOOR SUPPORTED.
NOTHING PERMITTED TO BE ATTACHED TO, SUSPENDED FROM, OR PENETRATE LANDLORD'S STRUCTURE, FLOOR DECK, OR ROOF DECK. YOU MAY ATTACH, NON-DESTRUCTIVELY, TO OR SUSPEND FROM THE TOP CHORD OF THE JOIST OR THE STRUCTURAL STEEL WHICH EXISTS ABOVE THE TENANT SPACE. WHEN ATTACHING TO LANDLORD'S STRUCTURE, DO NOT DRILL, WELD, SCREW, OR SHOOT INTO STRUCTURE. ALTERNATIVE METHODS OF ATTACHMENT ONLY, NOTHING TO DAMAGE LANDLORD'S BASE BUILDING STRUCTURE. TENANT SHALL PROVIDE SIGNED AND SEALED STRUCTURAL DRAWINGS, BY STRUCTURAL ENGINEER WITH LEGALLY ACTIVE REGISTRATION AS INDICATED BY ALL JURISDICTION REQUIREMENTS, FOR ALL STRUCTURAL MODIFICATIONS FOR LANDLORD RECORDS.
SLAB REQUIREMENTS:
SLAB ON GRADE: TENANT'S GENERAL CONTRACTOR SHALL ADVISE THE OPERATION TEAM PRIOR TO ANY SLAB MODIFICATIONS OR REMOVAL. TENANT GC SHALL VERIFY THAT WORK SHALL NOT CONFLICT WITH ANY EXISTING STRUCTURAL, UTILITY, OR OTHER UNDER-SLAB CONDITION. (NONDESTRUCTIVE VERIFICATION MAYBE REQUIRED. ANY DAMAGE OR DOWNTIME CAUSED BY TENANT'S WORK SHALL BE REPAIRED AND REIMBURSED AT TENANT'S EXPENSE.
ELEVATED SLABS: TENANT'S GENERAL CONTRACTOR SHALL ADVISE THAT OPERATION TEAM PRIOR TO ANY SLAB MODIFICATION OR REMOVAL. IF ANY ELEVATED SLAB IS TO BE MODIFIED IN ANYWAY (DRILLED, CORED OR PENETRATED) TENANT SHALL PROVIDE STAMPED AND CERTIFIED DRAWINGS BY A LICENSED STRUCTURAL ENGINEER CERTIFIED IN THE LOCAL JURISDICTION. ALL PENETRATIONS SHALL BE CORE BORED ONLY, SAW CUTTING, JACK HAMMERING, AND TRENCHING IS STRICTLY PROHIBITED. ALL PENETRATIONS SHALL BE SLEEVED, SEALED, FIRE STOPPED, AND WATERPROOFED. THE PENETRATION SLEEVE SHALL EXTEND A MINIMUM OF 4" ON EITHER SIDE OF THE SLAB AND BE LABELED WITH THE REQUIRED NFPA RATINGS. TENANT GC SHALL VERIFY THAT WORK SHALL NOT CONFLICT WITH ANY EXISTING STRUCTURAL, UTILITY, OR OTHER UNDER-SLAB CONDITION. (NONDESTRUCTIVE VERIFICATION MAYBE REQUIRED.) ANY DAMAGE OR DOWNTIME CAUSED BY TENANT'S WORK SHALL BE REPAIRED AND REIMBURSED AT TENANT'S EXPENSE.

ELECTRICAL POWER PLAN

"VERIFY ALL FIELD CONDITIONS PRIOR TO BID"

1/4" = 1'-0"

A

SHREMSHOCK
Shremshock Engineering, Inc.
6130 S. Sundry Rd., Westerville, OH 43081
t: 614 545 4550 | f: 614 545 4555 | shremshock.com
TX Registration Number: #F-6966

ELITE CONSTRUCTION GROUP
LANCE JACKSON, P.E.
PHONE: 979-283-0712
NOTE: THESE PRINTS HAVE BEEN
REDUCED BY 50 PERCENT. SCALE
WILL BE 50 PERCENT OF WHAT IS
NOTED ON PLANS

Limitedbrands
LIMITED STORE PLANNING, INC.
d/b/a STORE DESIGN & CONSTRUCTION
Three Limited Parkway • Columbus, Ohio 43230
Telephone: 614.415.7000 • Fax: 614.415.7349

PROJECT INFORMATION:
24200161
BATH & BODY WORKS
THE GALLERIA II
SPACE INC., 15060
HOUSTON, TX 77056
FULL REMODEL | PACKAGE:
EASTON-G | GENERATION:
00061216 | A/E PROJECT #:
SCORE: 14159
DESIGN TYPE: 130940
L&D&C PROJECT #:

REVISIONS:		DATE
1	BUILDING DEPARTMENT COMMENTS	04/11/14
2	DESIGN CHANGES/ LANDLORD COMMENTS	05/06/14
3	MASTERS UPDATES	06/26/14
4	DESIGN CHANGES	06/27/14
5	DESIGN CHANGES	07/24/14

DATE ISSUED: 3/7/14
DESIGNED BY: JEH
DRAWN BY: JEH
CHECKED BY: RAP

ELECTRICAL POWER PLAN

DRAWING NUMBER:
E02.01