


NOTE: REFER TO COIL PIPING DETAILS FOR ADDITIONAL REQUIREMENTS.


CHILLED WATER
AHU MOUNTING DETAIL

NTS
00D-M0301-H02-UNIT
09/13/13

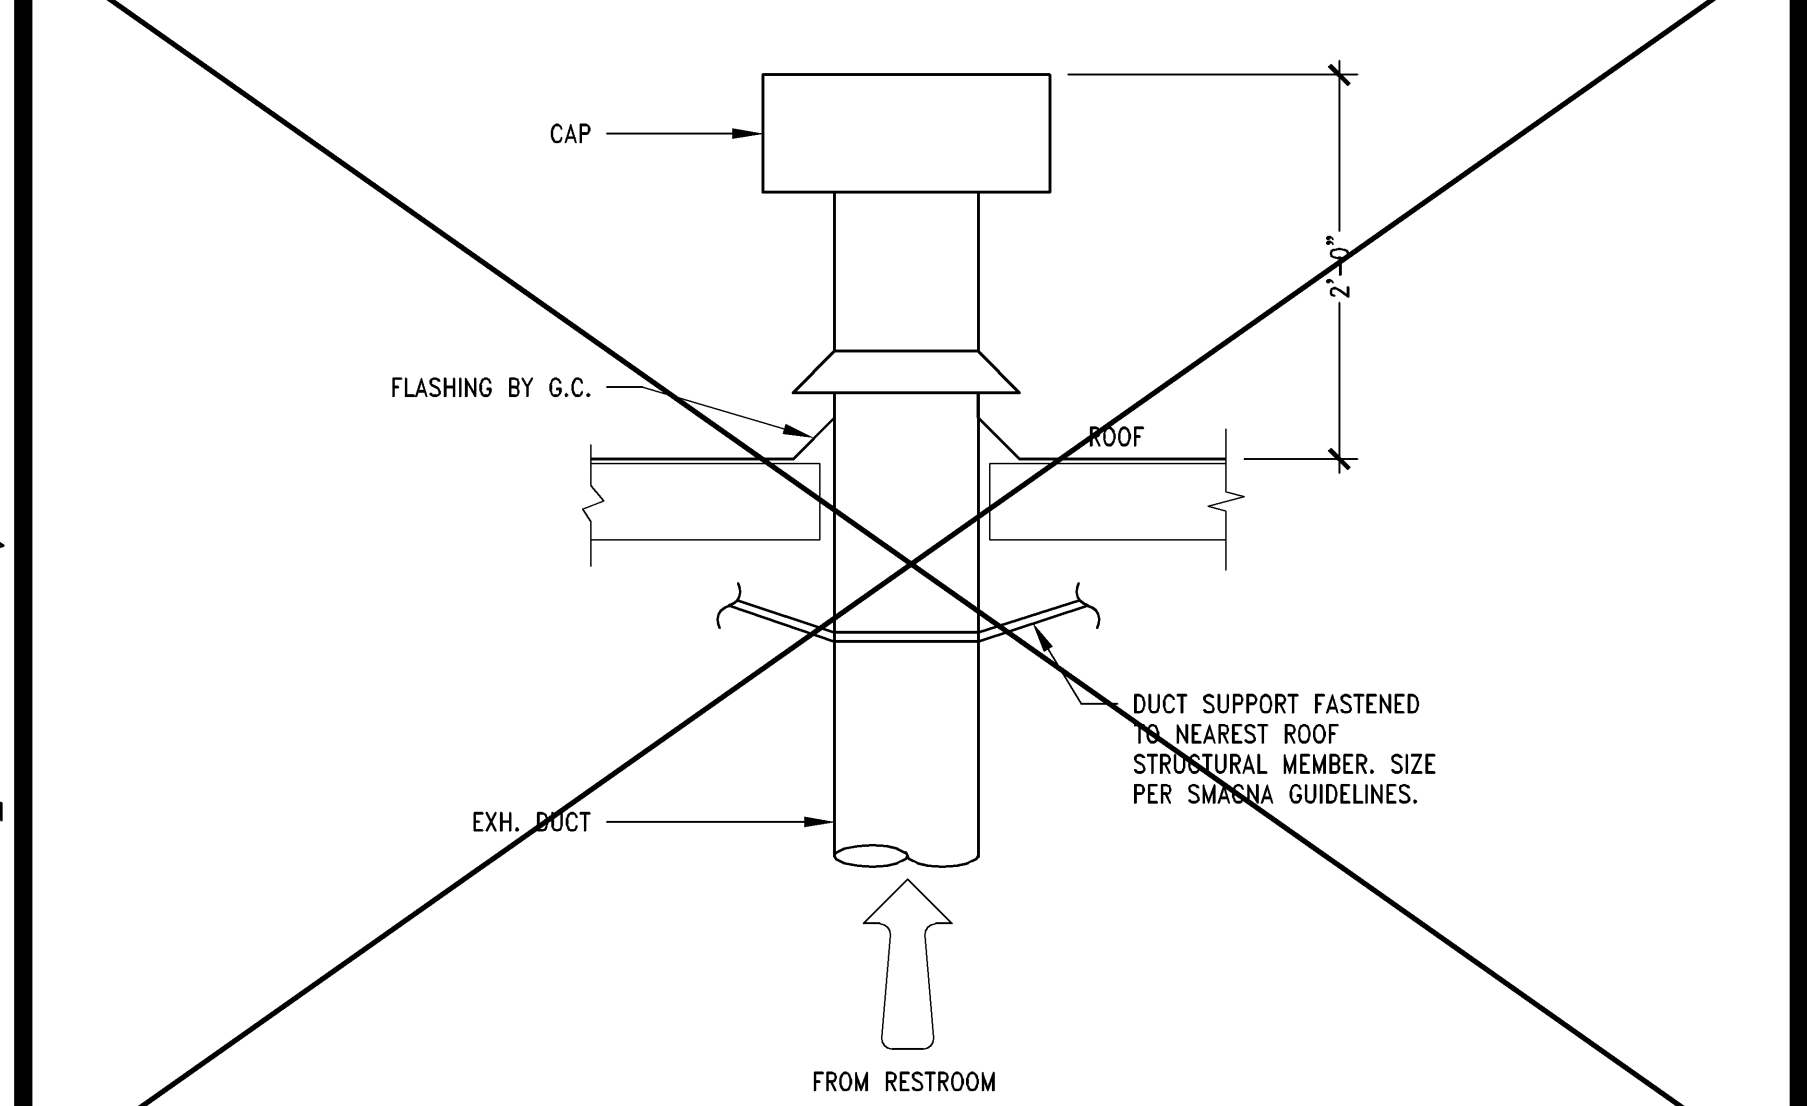


EXHAUST AIR DUCT ASSEMBLY DETAIL

1" = 1'-0"
00D-M0301-D00-EXDT
09/13/13

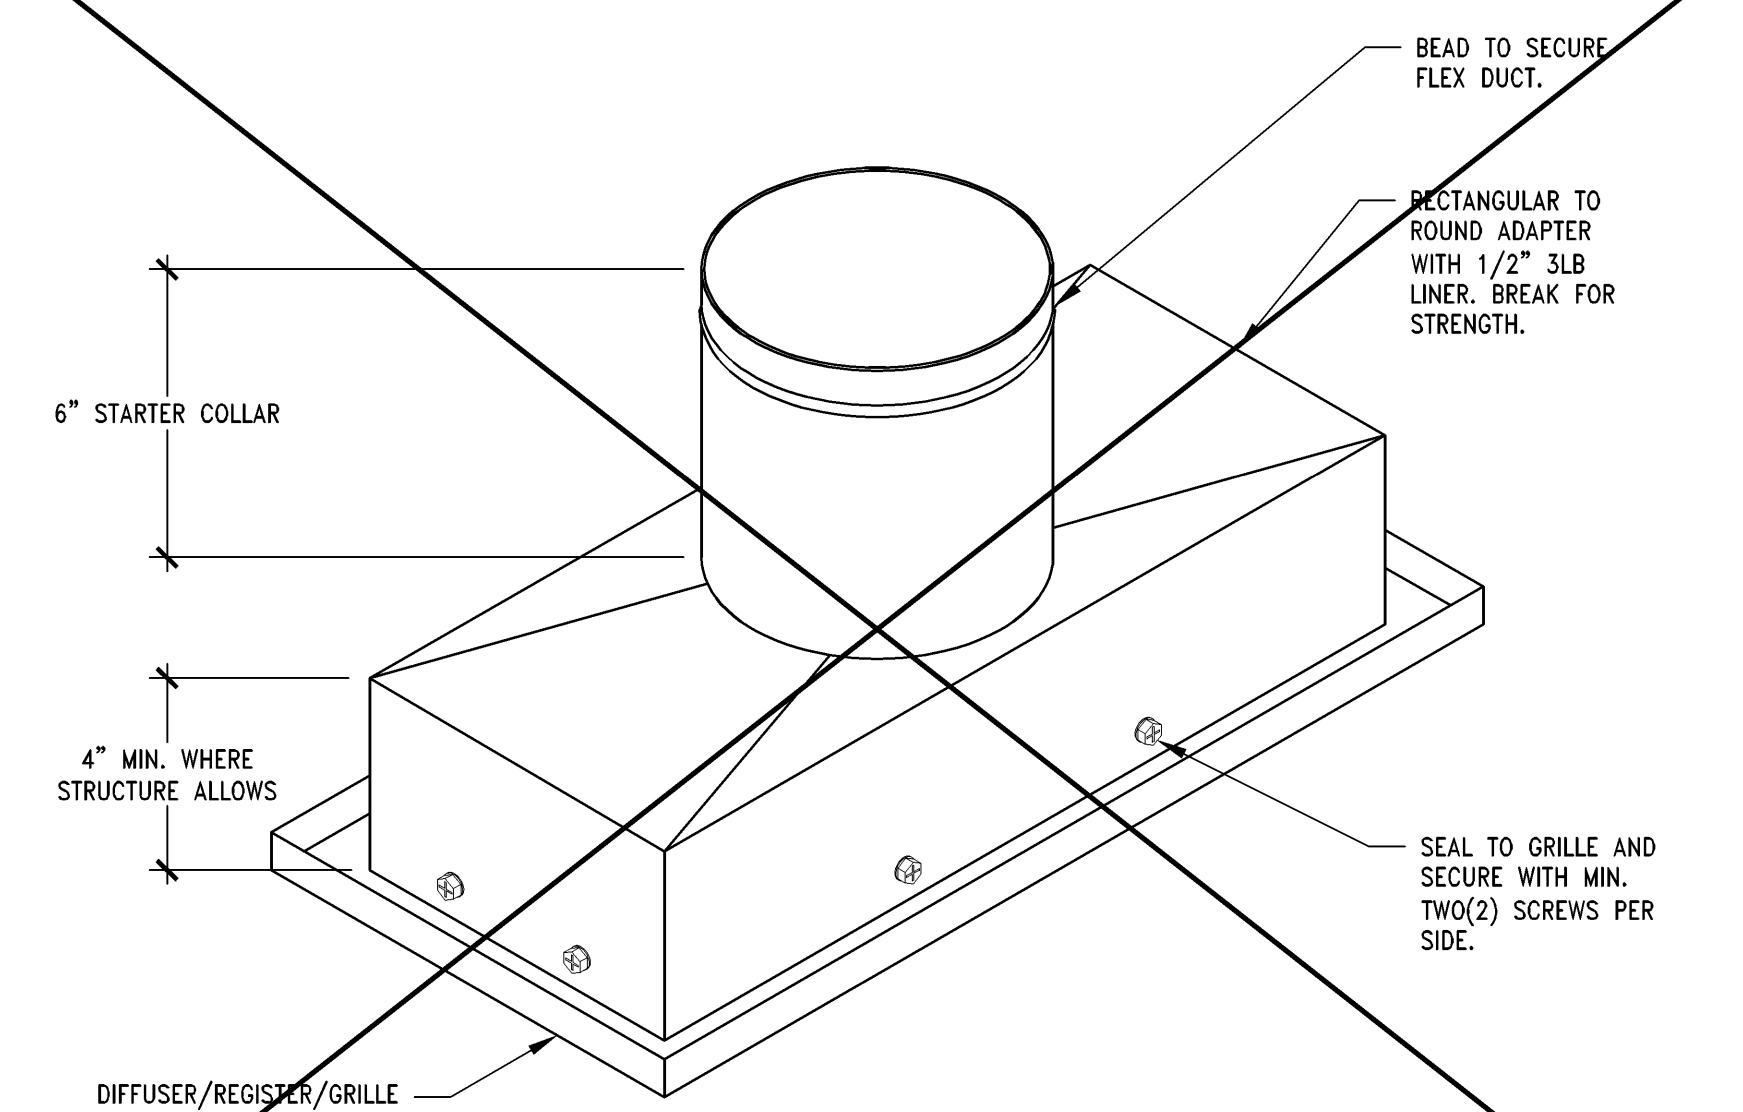


DUCTED GRILLE DETAIL

3" = 1'-0"
00D-M0301-G00-GRIL
09/13/13

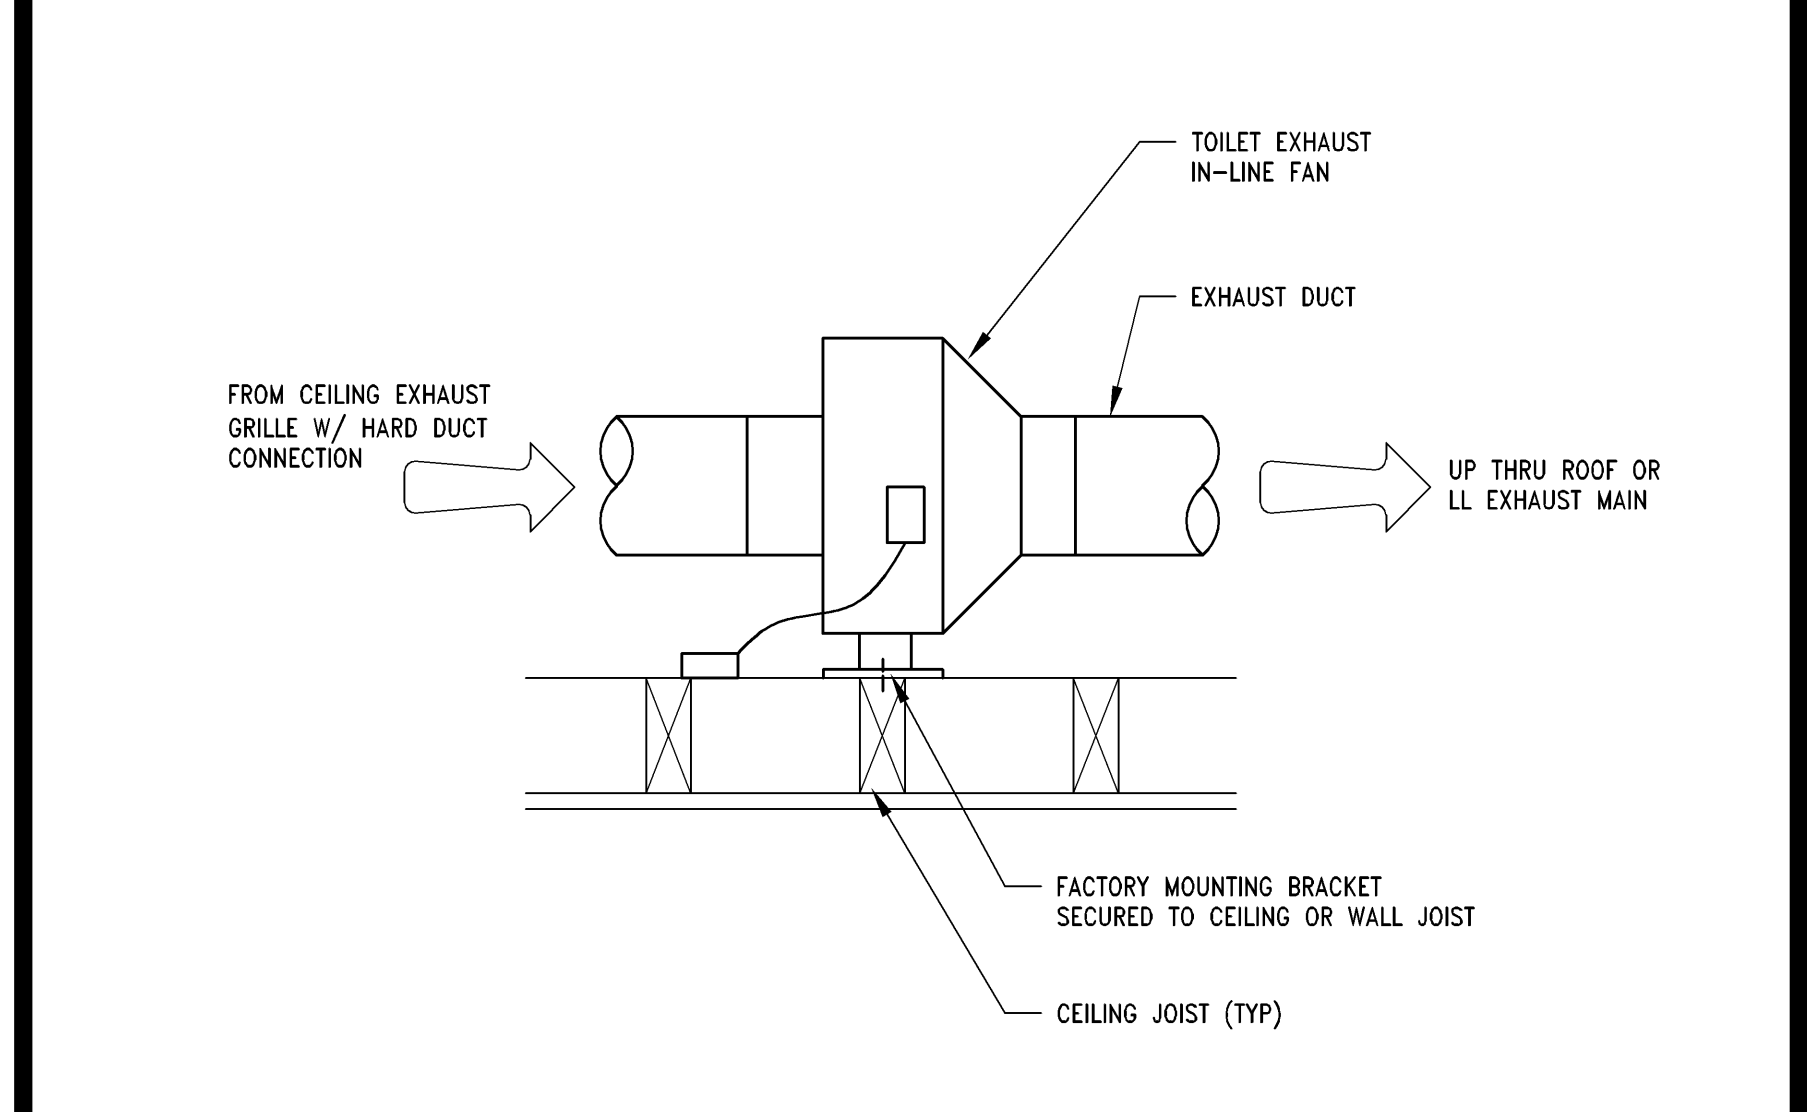


TOILET EXHAUST
IN-LINE MOUNTING DETAIL

NTS
00D-M0301-C00-EFAN
09/13/13

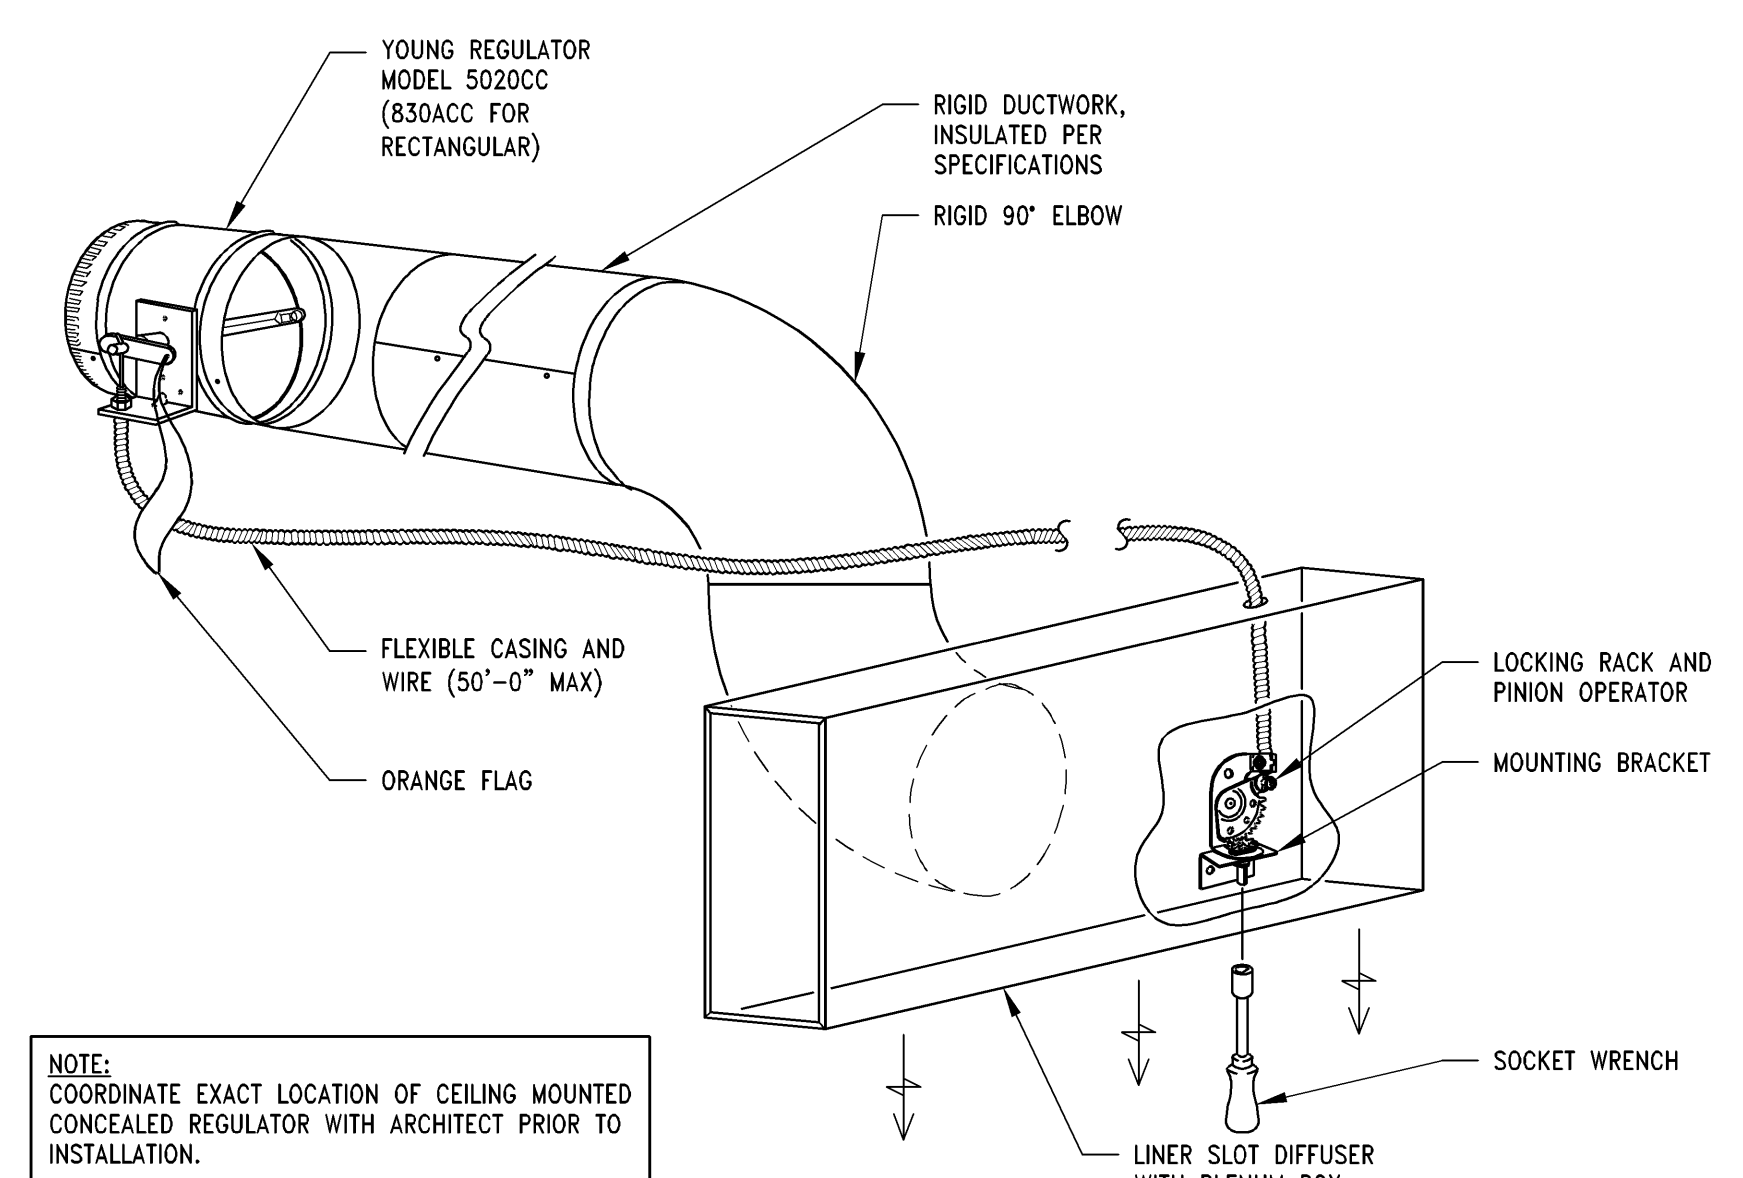


YOUNG REGULATOR REMOTE DAMPER

NTS
00D-M0301-F01-DAMP
09/13/13

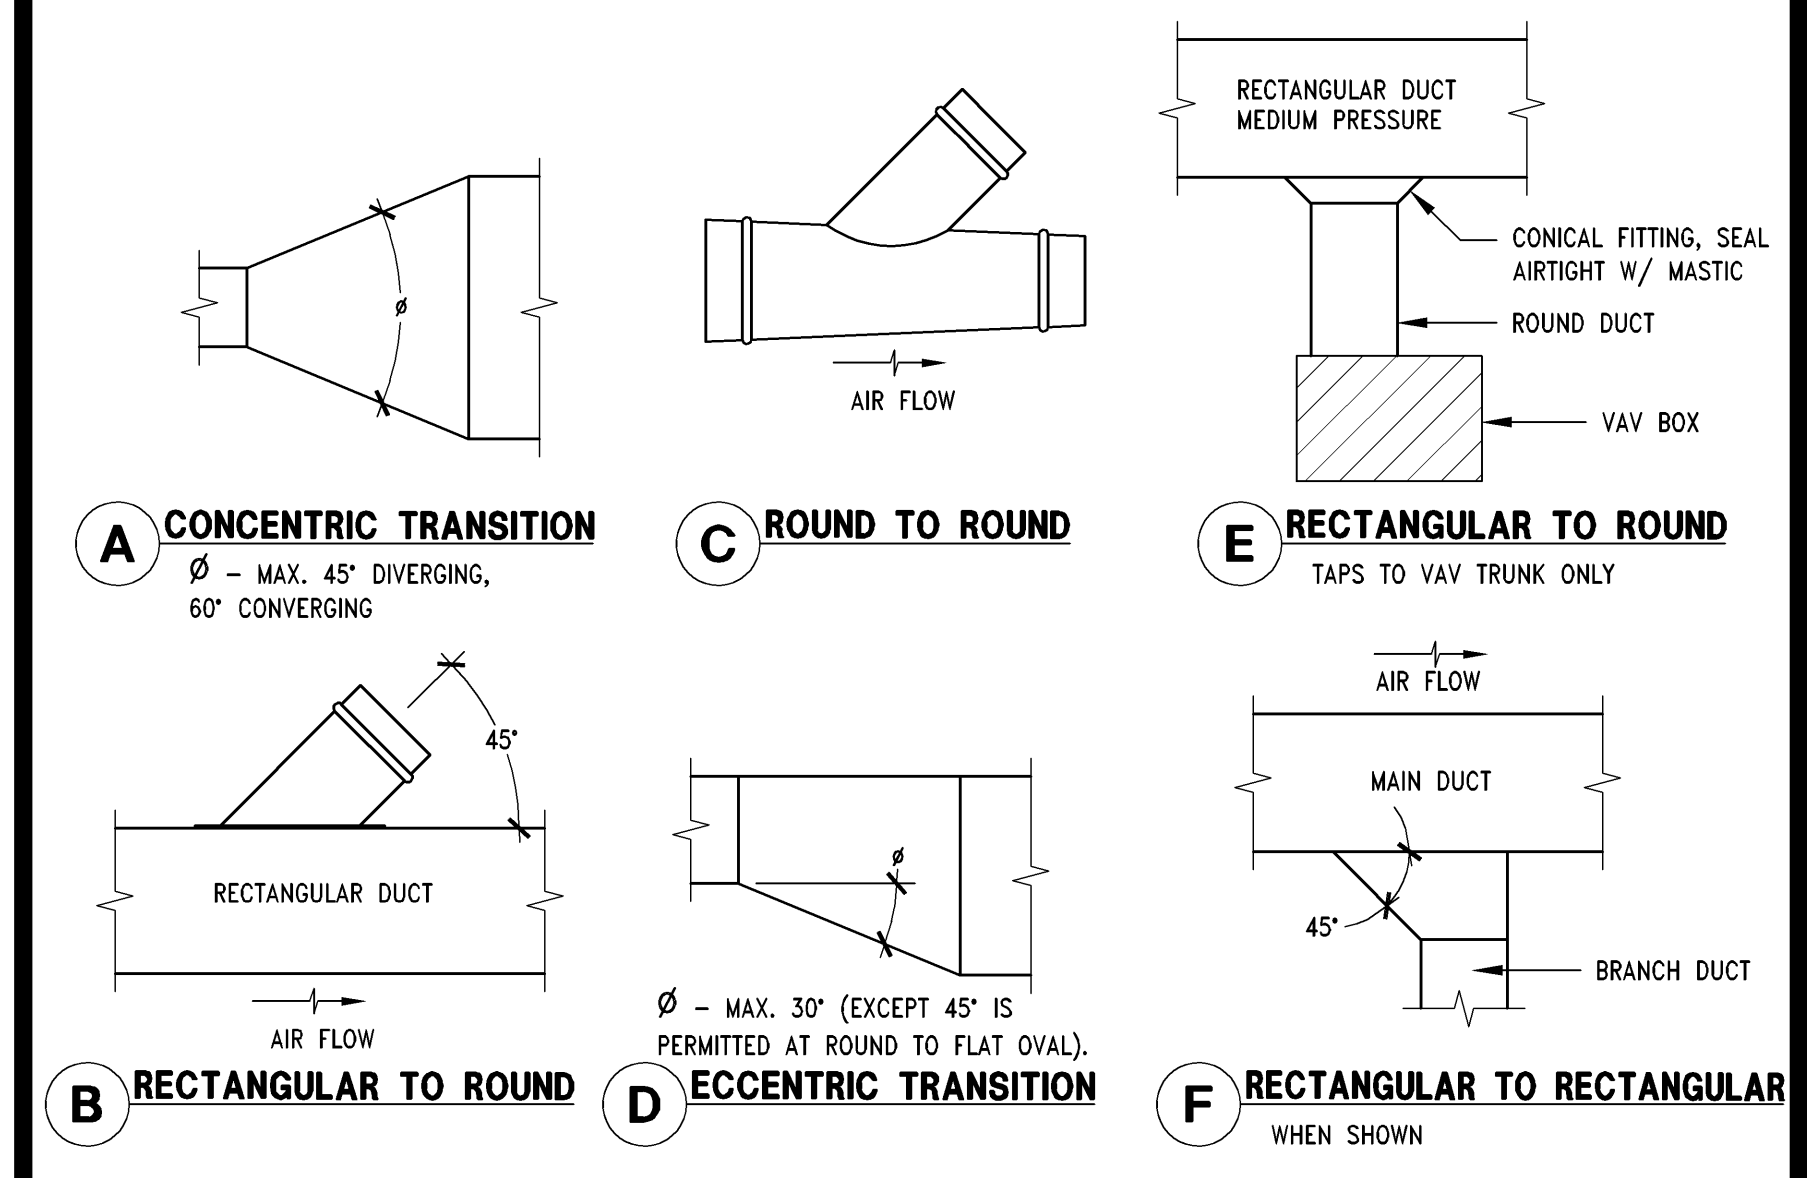


DUCT DETAILS

NTS
00D-M0301-B00-DUCT
09/13/13

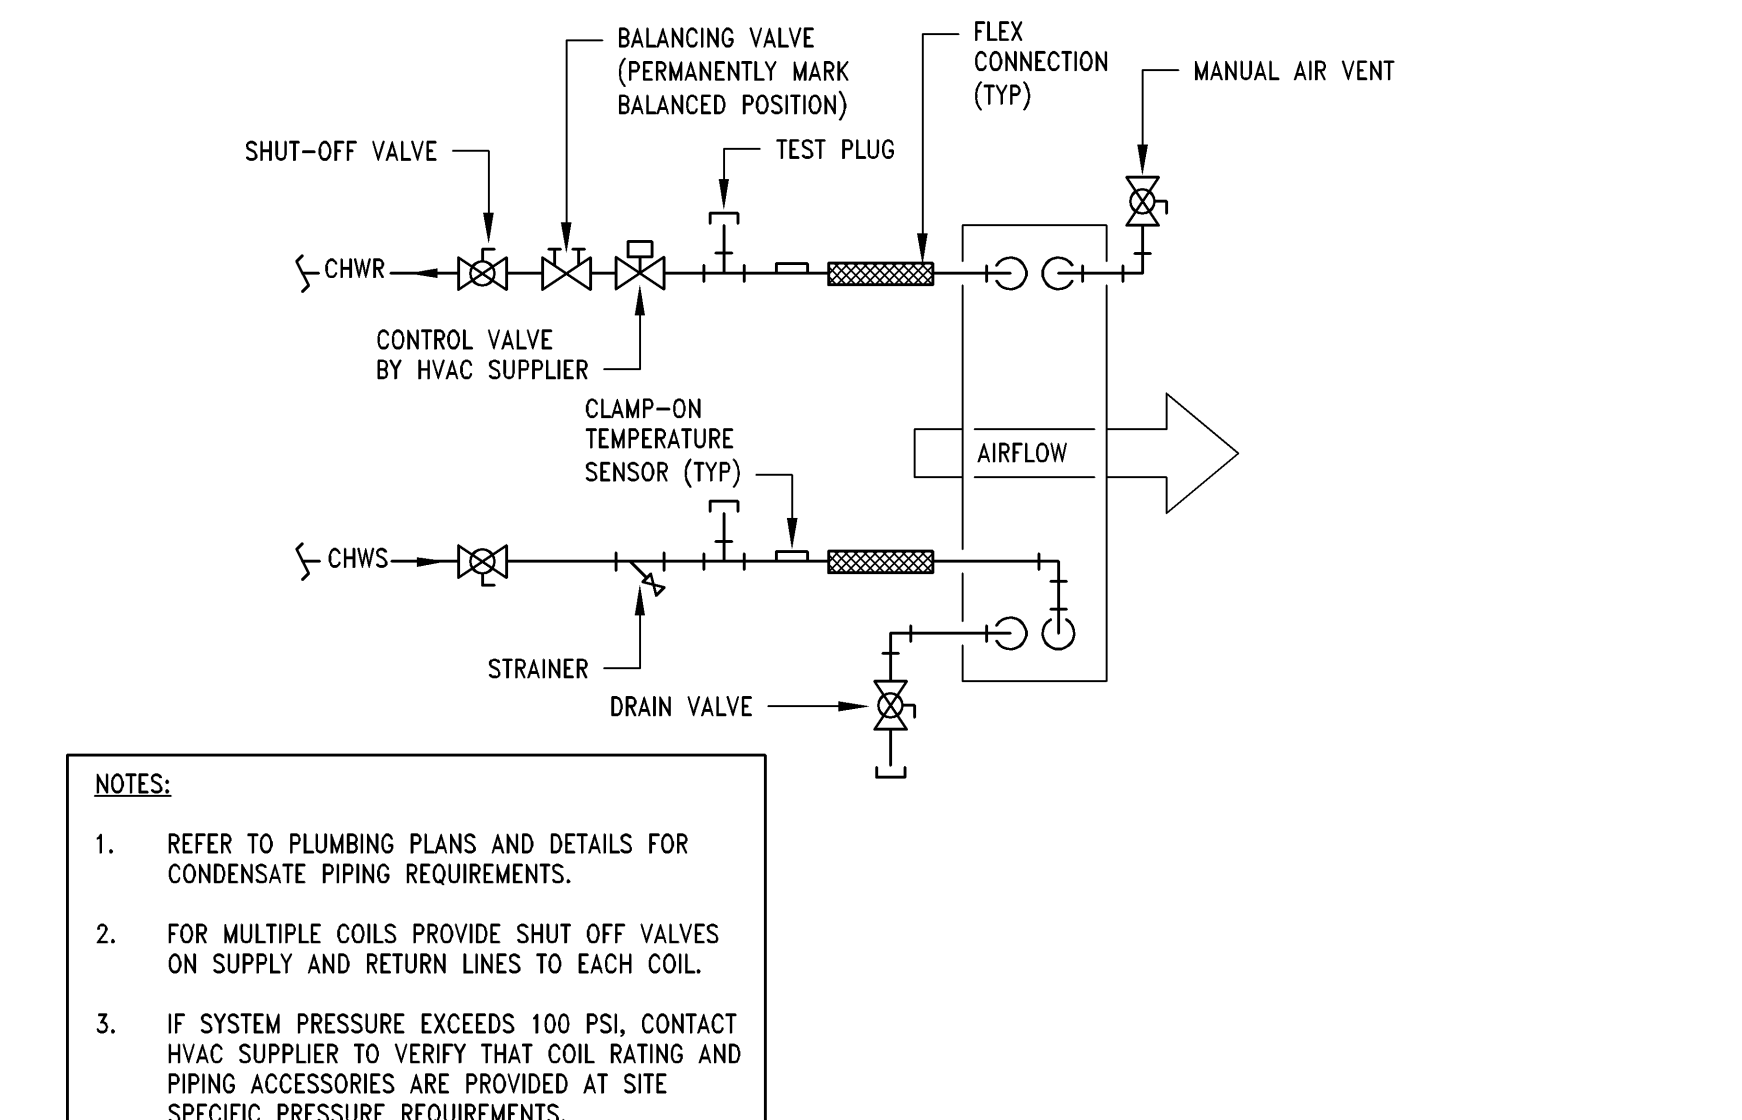


CHW COIL PIPING
DIAGRAM (2-WAY VALVE)

NTS
00D-M0301-J02-PIPE
09/13/13

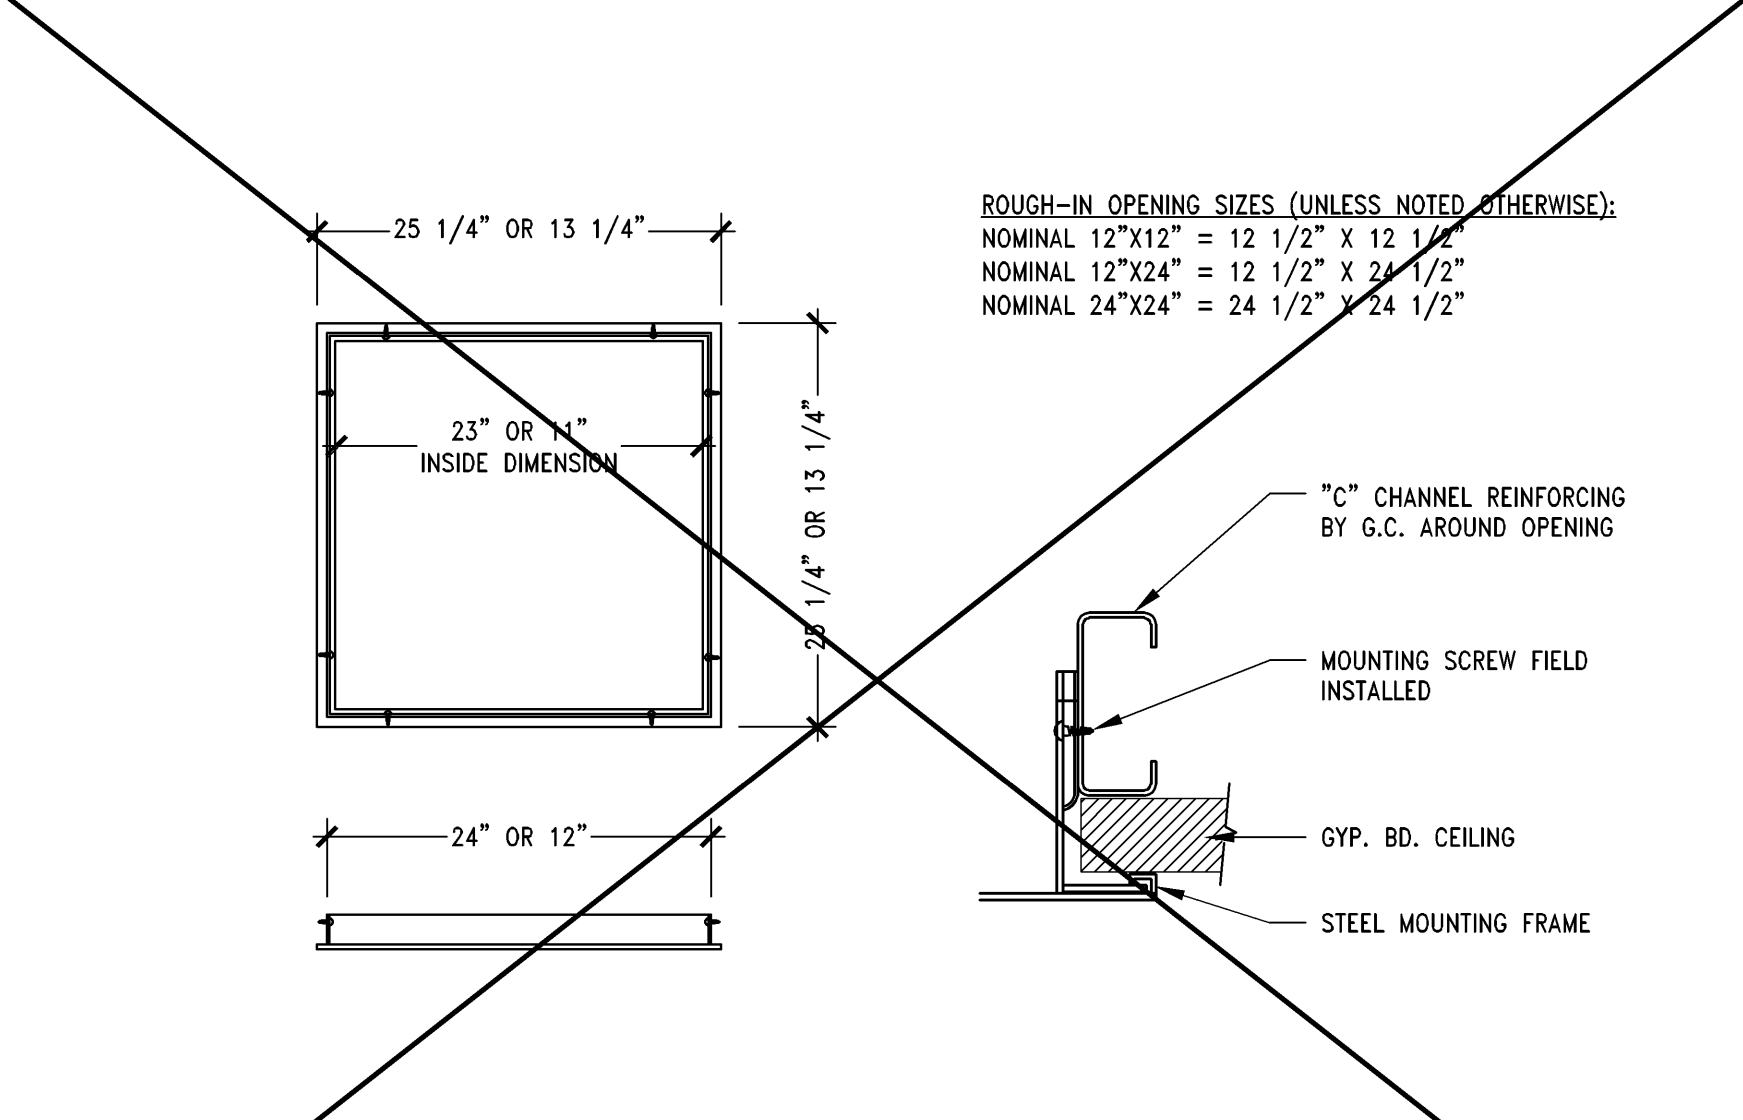

DRYWALL CEILING DIFFUSER
MOUNTING FRAME DETAIL

1" = 1'-0"
00D-M0301-E00-FRME
09/13/13

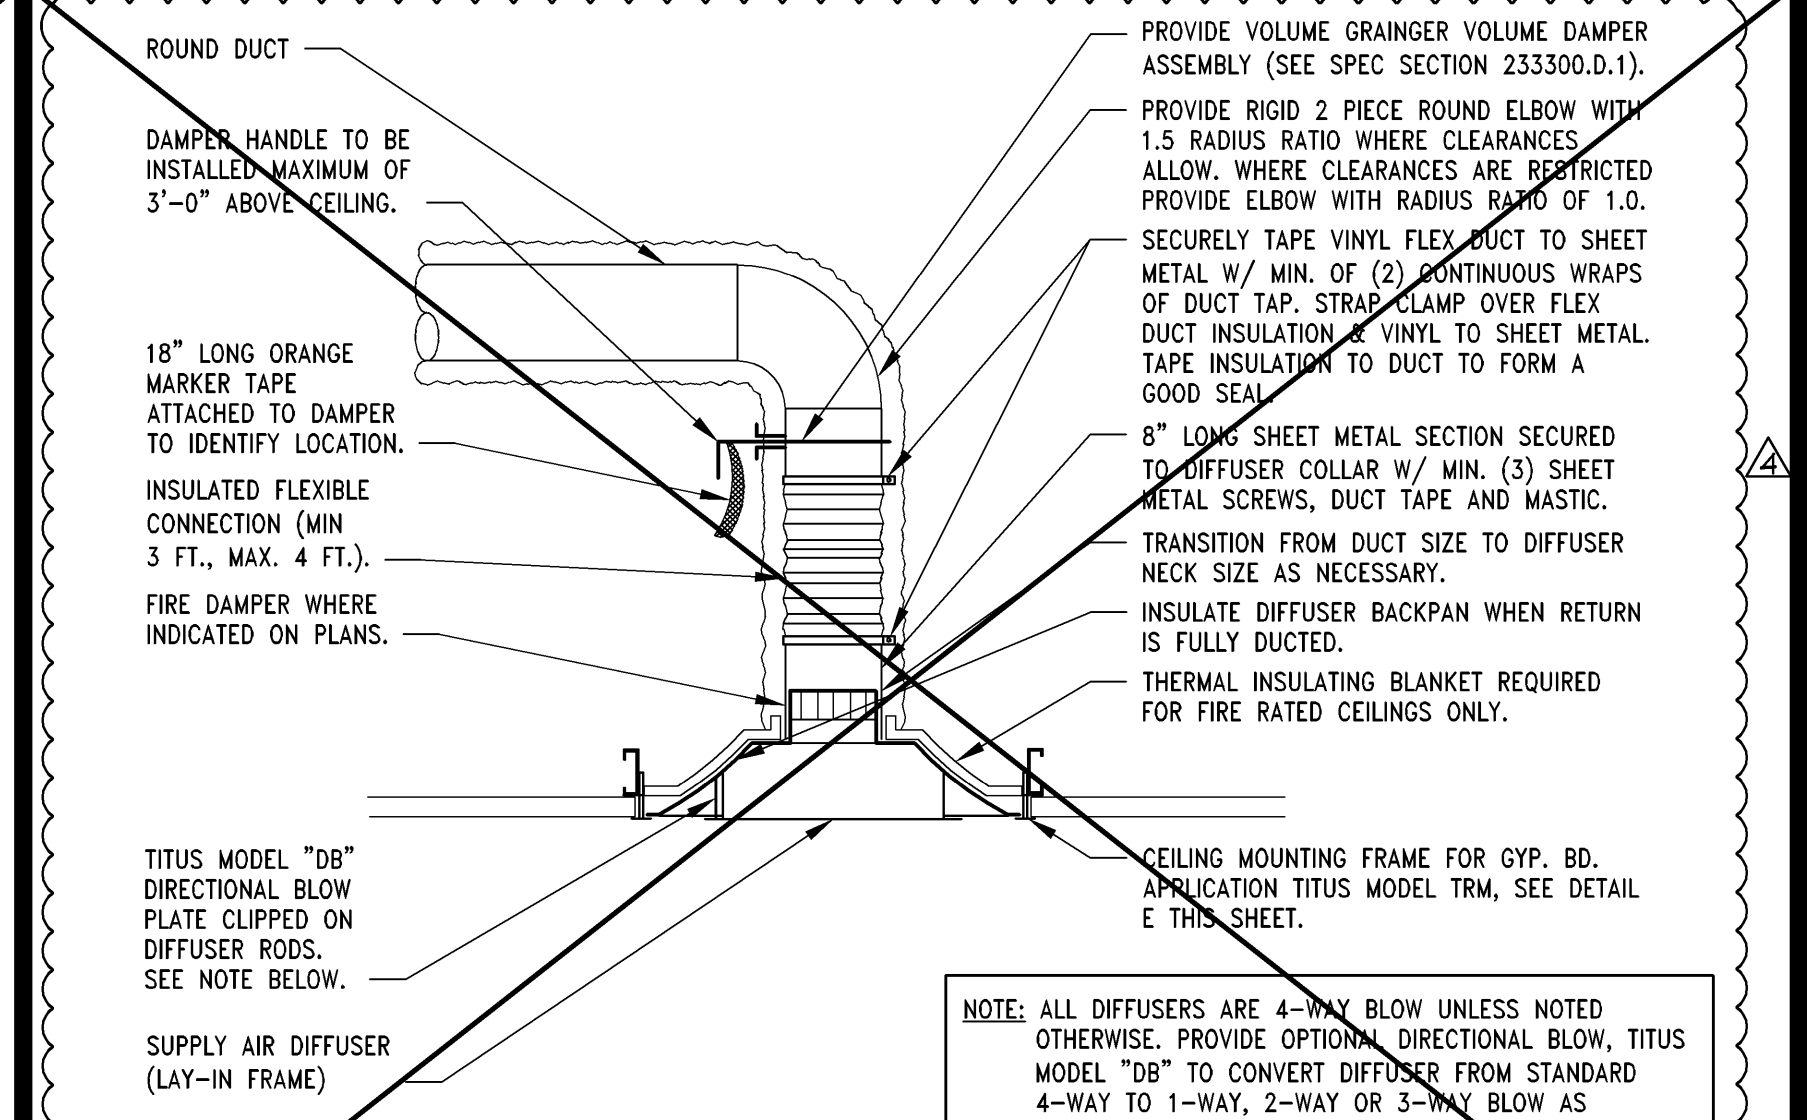

CEILING DIFFUSER MOUNTING DETAIL

NTS
00D-M0301-A00-DIFF
09/13/13