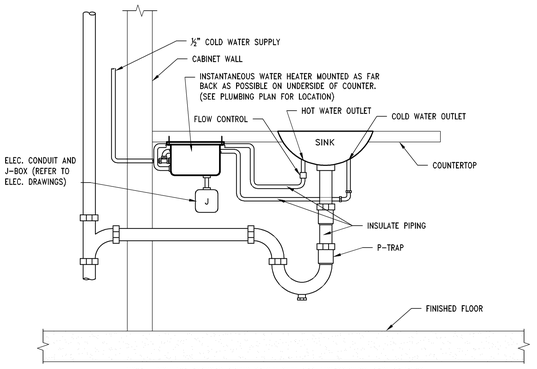

NOTE: INSULATE EXPOSED PIPING BELOW SINK PER ACCESSIBILITY REQUIREMENTS.

DEMONSTRATION SINK DETAIL | NTS | 42D-P0301-H02-DEMO | H | 09/03/2015

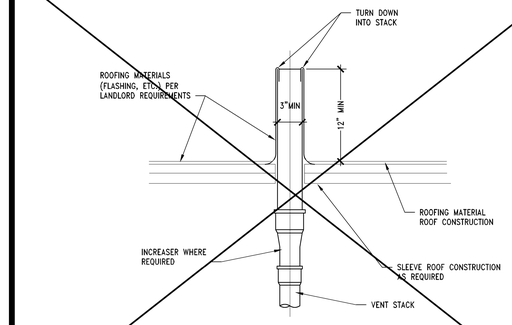

VENT THRU ROOF DETAIL | 1-1/2"=1'-0" | 00D-P0301-D00-VTR | D | 09/03/2015

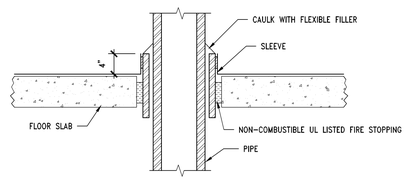

NOTE:
ALL FLOOR PENETRATIONS MUST BE SLEEVED AND LIQUID TIGHT.

PIPE FLOOR PENETRATION DETAIL | NTS | 00D-P0301-G00-PPEN | G | 09/03/2015

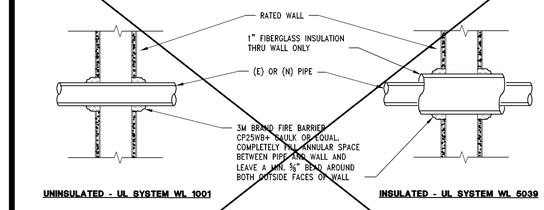

NOTE:
INSTALLATION TO FOLLOW UL SYSTEM WL 1001 OR WL 5039 AND BE A UL TESTED ASSEMBLY.

PIPE THRU FIRE WALL PENETRATION DETAIL | NTS | 00D-P0301-C00-PTFW | C | 09/03/2015

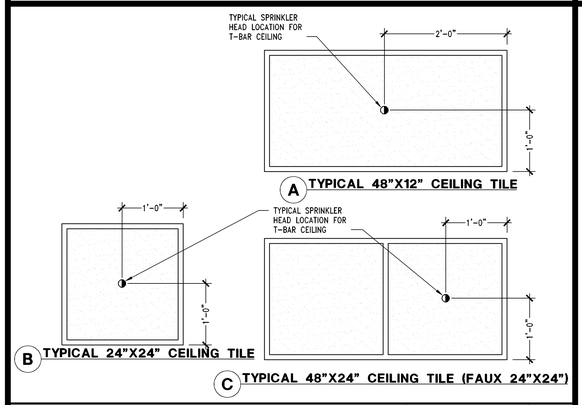

FIRE SPRINKLER HEAD LOCATION DETAILS | 1" = 1'-0" | 00D-P0301-P00-FSHL | P | 09/03/2015

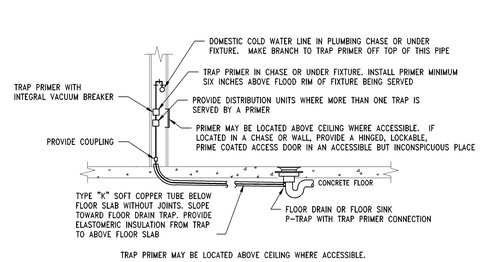

TRAP PRIMER | 1" = 1'-0" | 00D-P0301-F01-TRAP | F | 09/03/2015

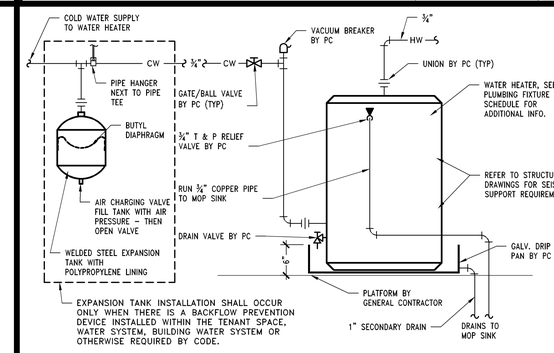

NOTE:
INSULATE ALL PIPING IN ACCORDANCE WITH SPECIFICATIONS. PIPING ARRANGEMENT SHOWN IS SCHEMATIC. ADJUST TO SUIT FIELD CONDITIONS. MAKE PIPE SAME SIZE AS TANK FITTING. FOLLOW MANUFACTURER'S INSTRUCTIONS FOR INSTALLATION PROCEDURE. VERIFY PROPER OPERATION WHEN INSTALLED.

WATER HEATER DETAIL | 1" = 1'-0" | 00D-P0301-B00-WTHR | B | 09/03/2015

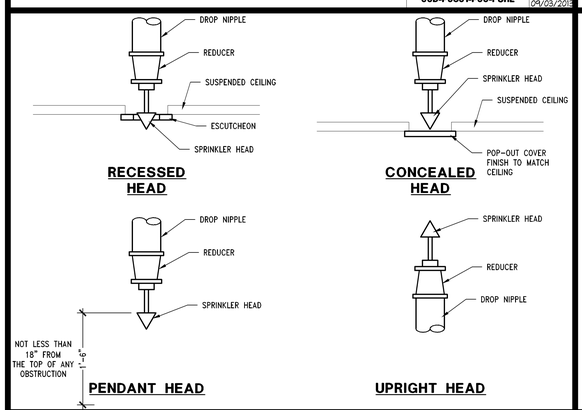

FIRE SPRINKLER HEAD DETAILS | NTS | 00D-P0301-N00-FSHD | N | 09/03/2015

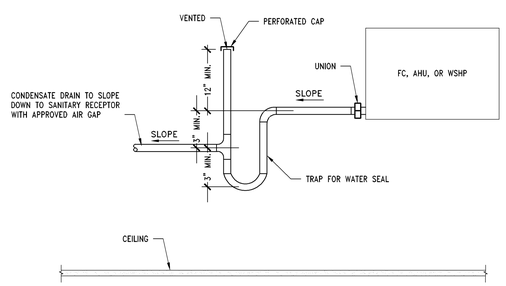

CONDENSATE DRAIN DETAIL | 1" = 1'-0" | 00D-P0301-J02-COND | J | 09/03/2015

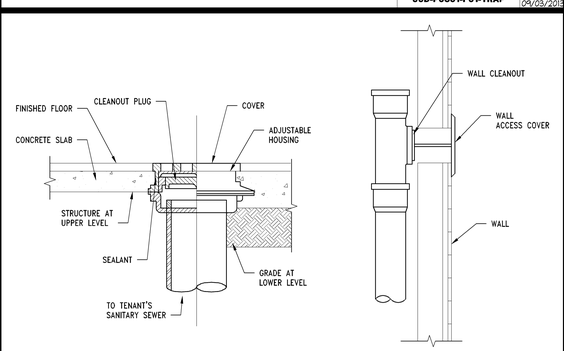

CLEANOUT DETAILS | NTS | 00D-P0301-E00-FWCO | E | 09/03/2015

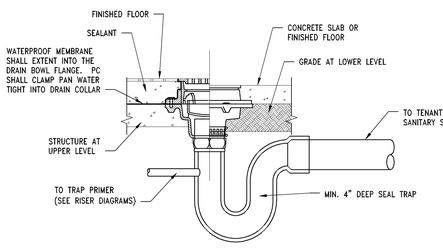

FLOOR DRAIN DETAIL | NTS | 00D-P0301-A00-FDRN | A | 09/03/2015

SHREMSHOCK
Shremshock Engineering, Inc.
6130 S. Sunbury Rd. Westerville, OH 43081
t: 614 545 4550 | f: 614 545 4555 | shremshock.com
TX Registration Number: #F-9566

Limitedbrands
LIMITED STORE PLANNING, INC.
d/b/a STORE DESIGN & CONSTRUCTION
Three Limited Parkway · Columbus, Ohio 43230
Telephone: 614.415.7000 · Fax: 614.415.7349

PROHIBITION ON REUSE
THESE DRAWINGS AND SPECIFICATIONS WERE PREPARED FOR USE ON A SPECIFIC SITE CONTEMPORANEOUSLY WITH THEIR ISSUE DATE. THEY ARE NOT INTENDED FOR USE ON A DIFFERENT PROJECT OR SITE AND MAY NOT BE SUITABLE FOR REUSE BY OTHERS ON EXTENSIONS OF THIS PROJECT OR ON ANY OTHER PROJECT. ANY REUSE WITHOUT WRITTEN VERIFICATION OR ADAPTATION BY LSDAC FOR THE SPECIFIC PURPOSE INTENDED WILL BE AT USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO LSDAC. USER SHALL INDEMNIFY AND HOLD HARMLESS LSDAC FROM ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES ARISING OUT OF OR RESULTING THEREFROM. ANY SUCH VERIFICATION OR ADAPTATION WILL ENTITLE LSDAC TO FURTHER COMPENSATION AT RATES TO BE AGREED UPON BY USER AND LSDAC.
THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY OF LSDAC AND SHALL NOT BE DISPLAYED IN PUBLICATIONS NOR REPRODUCED IN WHOLE OR IN PART, IN ANY MEDIUM, EXCEPT AS AGREED TO IN WRITING BY LSDAC. ANY REPRODUCTION OF THESE DRAWINGS AND SPECIFICATIONS SHALL BE MADE WITHOUT THE WRITTEN PERMISSION OF LSDAC AND SHALL BEAR THE COPYRIGHT NOTICE OF LSDAC AS SHOWN HEREON. THESE DRAWINGS AND SPECIFICATIONS MUST BE RETURNED TO LSDAC UPON COMPLETION OF THEIR INTENDED USE, UNLESS OTHERWISE AGREED TO BY THE LSDAC.
THESE DRAWINGS AND SPECIFICATIONS ARE COPYRIGHTED AND SUBJECT TO COPYRIGHT PROTECTION AS AN "ARCHITECTURAL WORK" UNDER SEC. 102 OF THE COPYRIGHT ACT, 17 U.S.C. 101 AS AMENDED DECEMBER 1990. THE ARCHITECT DESIGNER OF THESE PLANS AND SPECIFICATIONS ASSUMES NO RESPONSIBILITY FOR BUILDING CODE VIOLATIONS THAT MAY BE CREATED BY CHANGES MADE IN THESE PLANS AND SPECIFICATIONS AFTER THEY LEAVE THE ARCHITECT DESIGNER'S OFFICE. THIS RESPONSIBILITY INCLUDES, WITHOUT LIMITATION, THE INTERNAL FLOW, ARRANGEMENT AND COMPOSITION OF SPACES, AND ALL EXTERIOR AND INTERIOR CONSTRUCTION, FINISHES, EQUIPMENT AND SYSTEMS DESIGNED OR SPECIFIED. ANY SUCH CHANGES MADE IN THESE PLANS AND SPECIFICATIONS MAY RESULT IN CESSATION OF CONSTRUCTION, BUILDING SEIZURE, AND/OR MONETARY LIABILITY.

24200161

PROJECT INFORMATION:

BATH & BODY WORKS
THE GALLERIA II
SPACE NO. B3680
5085 WESTHEIMER RD.
HOUSTON, TX 77056

FULL REMODEL | PACKAGE:
EASTON-G | GENERATION:
000612.16 | A/E PROJECT #:

SCOPE:
DESIGN TYPE:
LSDAC PROJECT #:

PKG 1+
1415a
130840

REVISIONS:

REQUIRED BY:	DATE

ELITE CONSTRUCTION GROUP
LAKE JACKSON, TX
PHONE: 979.285.9713
NOTE: THESE PRINTS HAVE BEEN REDUCED BY 50 PERCENT. SCALE WILL BE 50 PERCENT OF WHAT IS NOTED ON PLANS

DATE ISSUED: 3/7/14
DESIGNED BY: JPM
DRAWN BY: JPM
CHECKED BY: WRG

PLUMBING AND FIRE PROTECTION DETAILS

DRAWING NUMBER:
P03.01