NOTE:
REFER TO SHEET E04.01 FOR ELECTRICAL LIGHTING SCHEDULE AND LIGHT DESCRIPTIONS.

NOTE:
REFER TO SHEET E05.01 FOR PANEL SCHEDULE AND LIGHTING ZONE DESIGNATIONS.

NOTE:
ELECTRICAL CONTRACTOR SHALL REFER TO ARCHITECTURAL SHEETS FOR MOUNTING HEIGHTS AND INSTALLATION DETAILS FOR SUSPENDED LIGHTING IN NON-SALES AREA.

NOTE:
GENERAL CONTRACTOR SHALL VERIFY CEILING FIRE RATING WITH ARCHITECT, AND BOX OR TENT ALL RECESSED LIGHT FIXTURES, IF REQUIRED, TO MAINTAIN CEILING FIRE RATING.

1. ELECTRICAL CONTRACTOR SHALL INSTALL OCCUPANCY MOTION SENSOR SWITCH FOR CONTROL OF LIGHTS AS SHOWN. ELECTRICAL CONTRACTOR SHALL SET SWITCH FOR 15 MINUTES. MOUNT AT 44"AFF.
2. CIRCUIT SALES EXIT AND EMERGENCY/NIGHT LIGHT BATTERY BACK-UP BALLAST TO CIRCUIT A-1
3. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL 4" JUNCTION BOX FOR INTERNALLY ILLUMINATED LED GINGHAM ABOVE CANOPY, CONNECTION TO TRANSFORMER. REFER TO ARCHITECTURAL DRAWINGS FOR MORE INFORMATION.
4. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL 4" JUNCTION BOX FOR INTERNALLY ILLUMINATED LED GINGHAM TRANSOM STOREFRONT, CONNECTION TO TRANSFORMER. REFER TO ARCHITECTURAL DRAWINGS FOR MORE INFORMATION.
5. CONTRACTOR TO ROTATE FIXTURES SO THAT UL LABELS ARE NOT VISIBLE TO CUSTOMER.
6. ~~ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL 4" JUNCTION BOX FOR SHADOW BOXES. MOUNT JUNCTION BOX BELOW SHADOW BOX FOR CONNECTION TO TRANSFORMER. REFER TO ARCHITECTURAL DRAWINGS FOR MORE INFORMATION.~~
7. ~~PROVIDE JUNCTION BOX FOR BLADE SIGN MOUNTED ON INTERIOR OF STORE, ACCESSIBLE ABOVE CEILING.~~
8. FURNISH AND INSTALL JUNCTION BOX. TOGGLE DISCONNECT SWITCH IN NON-VISIBLE LOCATION, AND FINAL CONNECTION FOR 120 VOLT SIGN. SIGN IS FURNISHED WITH INTERNAL GROUND FAULT PROTECTION BY SIGN MANUFACTURER PER N.E.C. ARTICLE 600-23b. VERIFY EXACT LOCATION OF JUNCTION BOX WITH SIGN MANUFACTURER. (REUSE EXISTING JUNCTION BOX AND CONDUIT INTO SPACE IF ALREADY INSTALLED. VERIFY IN FIELD EXACT LOCATION ON CANOPY). FOR CANOPY POWER SEE SHEET A08.01 FOR WALL PENETRATION IN ROUTING CONDUIT.
   NOTE:
   THE CIRCUIT FOR SIGNAGE MUST BE A DEDICATED ISOLATED 3-LINE CIRCUIT CONSISTING OF HOT, NEUTRAL, AND GROUND WIRES LEADING DIRECTLY TO THE PANEL.
9. LIGHT FIXTURES TO BE INSTALLED IN MILLWORK FIXTURE, NOT IN CEILING. VERIFY WITH LSD&C. REFER TO SHEET E02.01 FOR POWER REQUIREMENTS.
10. 'AA' LIGHTS ARE REMODEL HOUSING AND DO NOT INSTALL DURING ROUGH FRAMING.
11. PROVIDE OCCUPANCY SENSOR TO AUTOMATICALLY TURN OFF WITHIN 30 MINUTES OF ALL OCCUPANTS LEAVING THE SPACE.
12. CIRCUIT NONSALES EXIT AND EMERGENCY/NIGHT LIGHT BATTERY BACKUP BALLAST TO LOCAL CIRCUIT AHEAD OF ALL SWITCHING.

## ELECTRICAL LIGHTING PLAN KEYNOTES

| NTS | D |
|---|---|
| 42N-E0301-D00-NOTE | 11/11/11 |

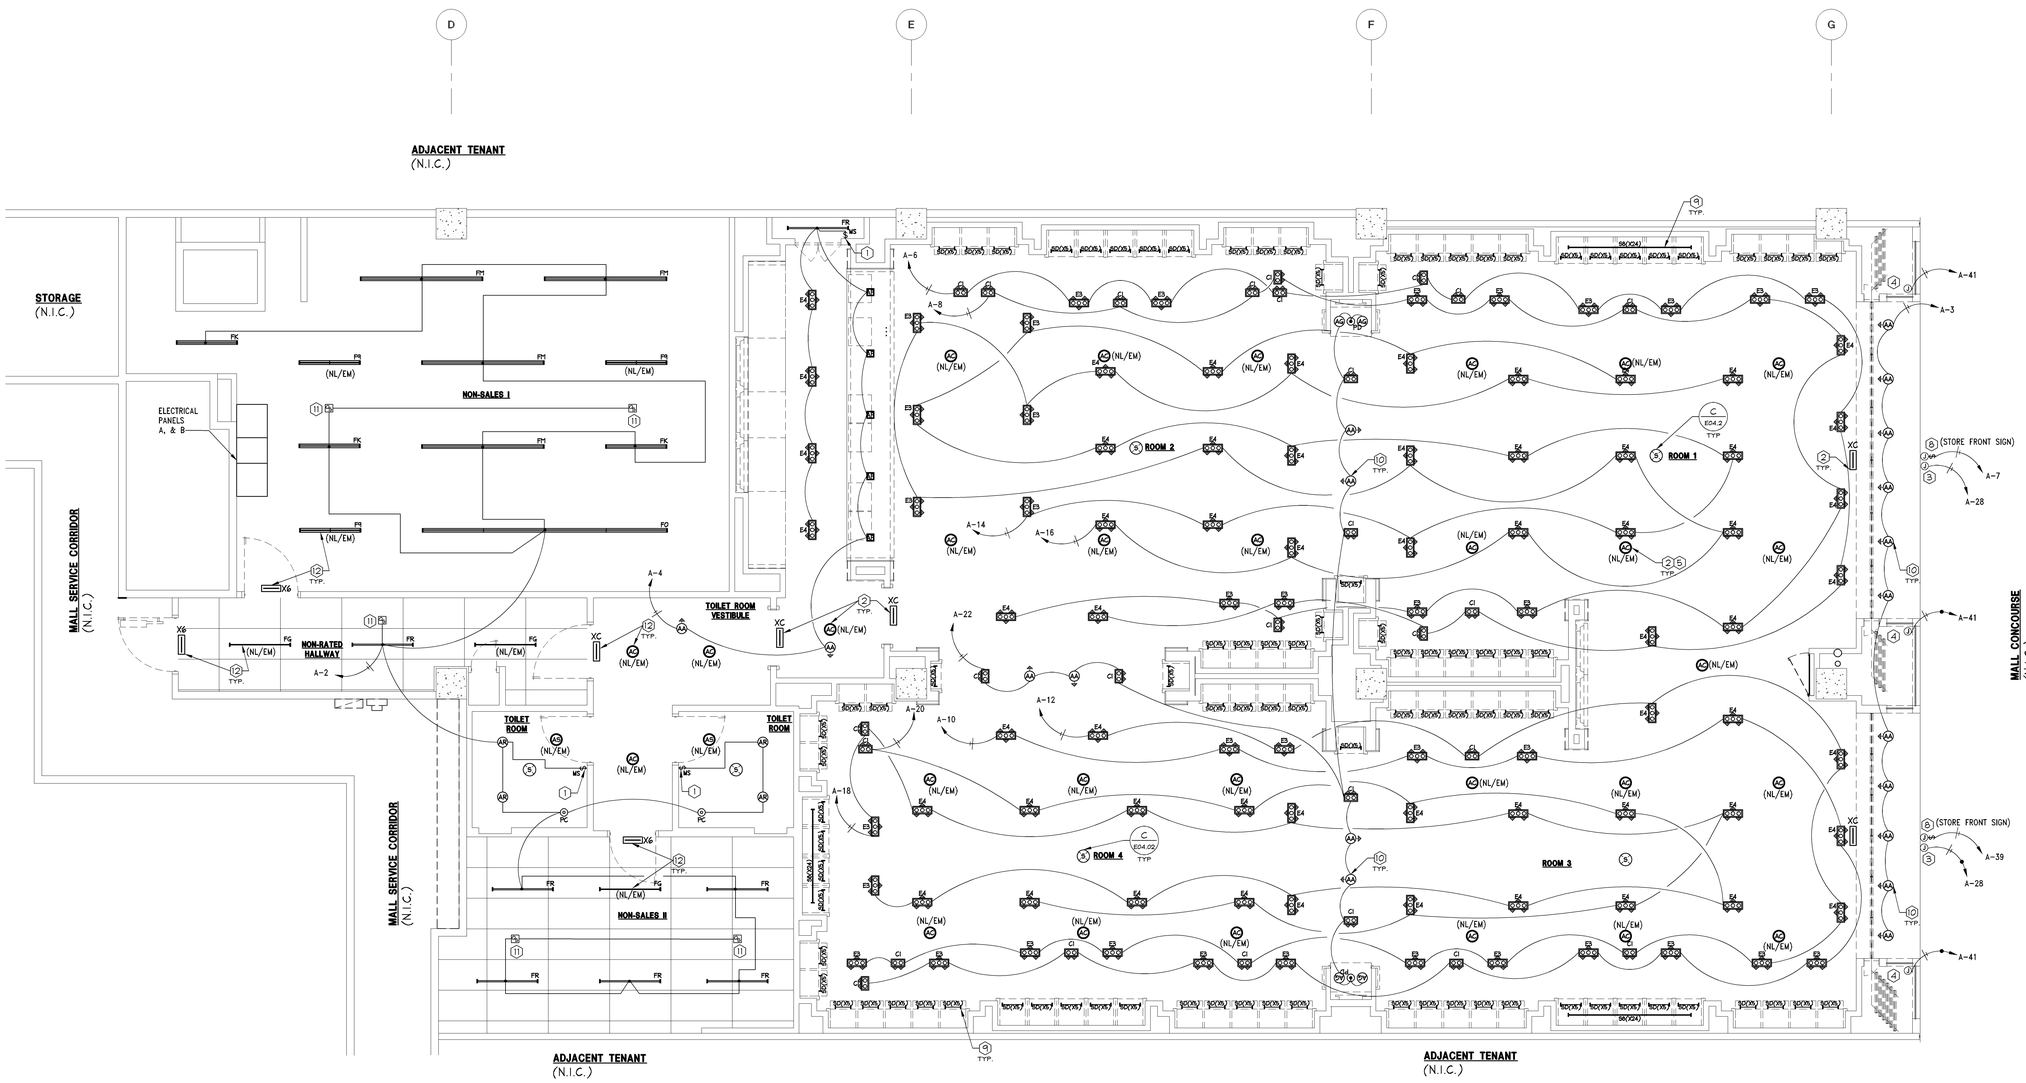


"VERIFY ALL FIELD CONDITIONS PRIOR TO BID"

## ELECTRICAL LIGHTING PLAN

| 1/4" = 1'-0" | A |
|---|---|


SHREMSHOCK
Shremshock Engineering, Inc.
6130 S. Sunbury Rd. Westerville, OH 43081
t: 614 545 4550 | f: 614 545 4555 | shremshock.com
TX Registration Number: #F-9566


Limitedbrands

**LIMITED STORE PLANNING, INC.**
**d/b/a STORE DESIGN & CONSTRUCTION**
**Three Limited Parkway · Columbus, Ohio 43230**
**Telephone: 614.415.7000 · Fax: 614.415.7240**


THESE DRAWINGS AND SPECIFICATIONS WERE PREPARED FOR USE ON A SPECIFIC SITE. IF USED, THEY ARE NOT INTENDED FOR USE ON A DIFFERENT SITE WITHOUT APPROPRIATE MODIFICATIONS TO CONFORM TO THE DIFFERENT CONDITIONS. THIS PROJECT IS PROHIBITED AND CONTRARY TO LAW UNLESS EXPRESSLY PERMITTED BY THE ARCHITECT.

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY OF LSDC AND SHALL NOT BE DISPLAYED IN PUBLICATIONS OR REPRODUCED IN WHOLE OR IN PART FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF LSDC. ANY REPRODUCTION MADE WITHOUT SUCH PERMISSION SHALL BE MADE WITHOUT THE WRITTEN CONSENT OF LSDC AND WITHOUT ANY LIABILITY TO LSDC. ALL COMMON LAW AND STATUTORY RIGHTS INCLUDING COPYRIGHT ARE RESERVED.

THESE DRAWINGS AND SPECIFICATIONS ARE COPYRIGHTED AND SUBJECT TO COPYRIGHT PROTECTION AS AN "ARCHITECTURAL WORK" UNDER SEC. 102 OF THE COPYRIGHT ACT, 17 U.S.C. §§ AS AMENDED DECEMBER 1990. THE OWNER AND USER OF A BUILDING CONSTRUCTED FROM THESE PLANS MAY MAKE REPRODUCTIONS OR PICTURES OF THE PLANS AND SPECIFICATIONS SOLELY FOR THE PURPOSE OF CONSTRUCTING, USING AND EXHIBITING THE BUILDING. ANY OTHER USE OF THESE PLANS AND SPECIFICATIONS WITHOUT THE WRITTEN PERMISSION OF LSDC IS PROHIBITED. ALL DRAWINGS AND SPECIFICATIONS MUST BE RETURNED TO LSDC UPON COMPLETION OF THEIR INTENDED USE. UNLESS OTHERWISE AGREED TO BY LSDC.


**PROJECT INFORMATION:**

**BATH & BODY WORKS**
**THE GALLERIA II**
SPACE NO. B3680
5085 WESTHEIMER RD.
HOUSTON, TX 77056

SCOPE: FULL REMODEL
DESIGN TYPE: EASTON-G
LSD&C PROJECT #: 00061216

PACKAGE: PKG 1+
GENERATION: 141Sa
A/E PROJECT #: 130840

**24200161**

**REVISIONS:**

| REQUIRED BY: | DATE: |
|---|---|

ELITE CONSTRUCTION GROUP
LAKE JACKSON, TX
PHONE: 979-285-0712
NOTE: THESE PRINTS HAVE BEEN REDUCED BY 50 PERCENT. SCALE WILL BE 50 PERCENT OF WHAT IS NOTED ON PLANS

| | |
|---|---|
| DATE ISSUED: | 3/7/14 |
| DESIGNED BY: | JEH |
| DRAWN BY: | JEH |
| CHECKED BY: | RAP |

## ELECTRICAL LIGHTING PLAN

DRAWING NUMBER:
**E03.01**