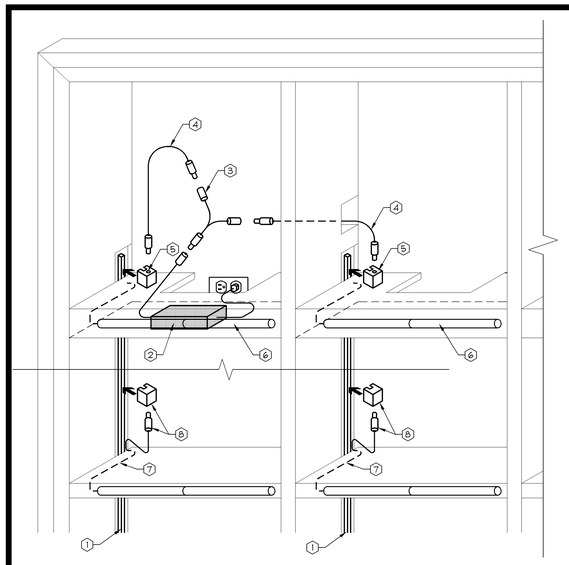

UNIT 1 AND 5 WIRING NOTES

1. GC TO INSTALL PLUG MOLD IN NOTCH IN BACK OF EACH CABINET GABLE. CENTER PLUG MOLD WITHIN NOTCH.
2. EC SHALL INSTALL TRANSFORMER WITHIN FIXED UPPER SHELF. ONE TRANSFORMER WILL POWER 2 CABINETS.
3. INSTALL "Y" CONNECTOR TO TRANSFORMER POWER WHIP.
4. INSTALL 4' WIRE TO "Y" CONNECTOR.
5. INSTALL 4' WIRE PLUG MOLD CONNECTOR AND SNAP CONNECTOR ONTO PLUG MOLD.
6. INSTALL LED STICK LIGHT TO UNDERSIDE OF SHELF(TYPICAL 5 PER CABINET INCLUDING FIXED UPPER SHELF AND ALL LOOSE SHELVES- SEE CABINET SECTIONS FOR LOCATIONS). USE TWO 8" LIGHTS AND THREE MOUNTING CLIPS PER SHELF.
7. INSTALL 24" WIRE TO LED STICK LIGHT AND RUN WIRE THRU CHASE WITHIN SHELF(TYPICAL 5 PER CABINET)
8. INSTALL WIRE TO PLUG MOLD CONNECTOR AND SNAP CONNECTOR ONTO PLUG MOLD(TYPICAL 5 PER CABINET)

UNIT 1 AND 5 WIRING DETAIL

3/4" = 1'-0" | 42D-E0402-P00-DETL | P | 1.27.2012

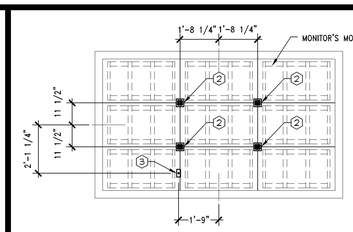

ELEVATION VIEW



PLAN VIEW

BEAUTY VIDEO WALL SYSTEM NOTES

1. PROVIDE 20 AMP, 120 VOLT 24 HOUR DEDICATED CIRCUIT FOR MONITOR POWER. REFER TO POWER PLAN FOR CIRCUITING.
2. PROVIDE QUAD RECEPTACLE WITH PLUGS ORIENTED TO FRONT.
3. WALL MOUNTED DATA OUTLET. G.C TO CONNECT TO 8X8 JUNCTION BOX ABOVE MUSIC SYSTEM WITH 1/2" CONDUIT. REFER TO DETAIL A/E04.02.

NOTE: DIMENSION OF RECEPTACLES ARE MEASURED FROM CENTER OF MONITOR GROUP. REFER TO ARCHITECTURAL DRAWINGS FOR MOUNTING HEIGHT OFF FINISH FLOOR.

NOTE: REFER TO ARCHITECTURAL SHEETS FOR ADDITIONAL INFORMATION AND LOCATION OF VIDEO WALL.

VIDEO WALL DETAIL 46"- (WALL MOUNTED)

3/8" = 1'-0" | 42D-E0403-E00-VWWM | M | 09/09/13

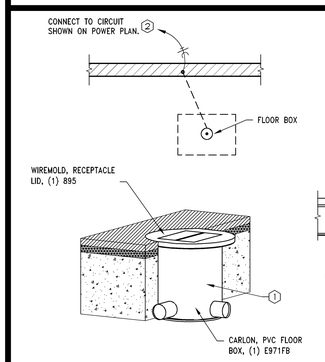

CODED NOTES

1. ROUND PVC FLOOR BOX. ELECTRICAL CONTRACTOR TO PROVIDE DUPLEX RECEPTACLE.
2. 20 AMP, 120 VOLT CIRCUIT. CUT AND PATCH FLOOR AS REQUIRED TO ROUTE CONDUIT TO WALL AS SHOWN. ROUTE UP INSIDE WALL TO CEILING SPACE AND CONNECT TO PANEL LOCATED INSIDE IFS ENCLOSURE. REFER TO POWER PLAN AND PANEL SCHEDULES FOR CIRCUIT DESIGNATIONS.



DETAIL AT EDGE - N.T.S.

GC SHALL ENSURE THAT TOP OF BOX IS FLUSH WITH TOP OF FLOOR FINISH.

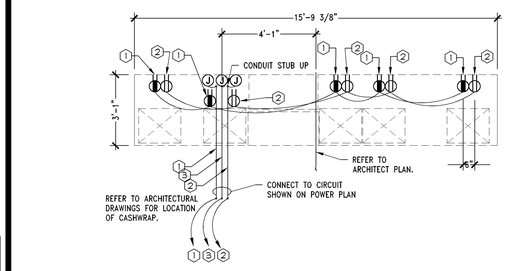

CASHWRAP COUNTER DETAIL
BATH & BODY WORKS 5 REGISTER CASHWRAP

CASHWRAP & TELE/DATA SYSTEM NOTES

1. REGISTERS SHALL SHARE A 20 AMP, 120 VOLT DEDICATED CIRCUIT WITH A SEPARATE ISOLATED NEUTRAL & 3RD WIRE GROUND. STUB UP 3/4" CONDUIT 1" (A.F.F.) WHERE SHOWN ON DETAIL. INSTALL FLEXIBLE CONDUIT FROM STUB-UP TO JUNCTION BOX AND CONNECT TO DUPLEX RECEPTACLES. THE ELECTRICAL CONTRACTOR SHALL FURNISH ORANGE #IG5362 RECEPTACLES (HUBBELL). CUT AND PATCH FLOOR AS REQUIRED TO ROUTE CONDUIT TO WALL AS SHOWN. ROUTE UP INSIDE WALL TO CEILING SPACE AND CONNECT TO PANEL LOCATED INSIDE IFS ENCLOSURE. REFER TO POWER PLAN AND PANEL SCHEDULES FOR CIRCUIT DESIGNATIONS.
2. 20 AMP, 120V, CIRCUIT FOR UTILITY POWER W/DUPLEX RECEPTACLE. STUB UP 3/4" CONDUIT 1" (A.F.F.) WHERE SHOWN ON DETAIL. INSTALL FLEXIBLE CONDUIT FROM STUB-UP TO JUNCTION BOX AND CONNECT TO DUPLEX RECEPTACLES. CUT AND PATCH FLOOR AS REQUIRED TO ROUTE UP INSIDE WALL TO CEILING SPACE AND BACK TO PANEL AS INDICATED ON POWER PLAN.
3. STUB UP 3/4" CONDUIT 1" (A.F.F.). INSTALL FLEXIBLE CONDUIT FROM STUB-UP TO 4X4 JUNCTION BOX FOR DATA AND TELEPHONE. CUT AND PATCH FLOOR AS REQUIRED TO ROUTE CONDUIT TO WALL AS SHOWN. ROUTE UP IN WALL TO CEILING SPACE AND CONNECT TO TELECO STRUCTURE PORTION OF THE IFS ENCLOSURE. WIRE FOR DATA LINES TO BE PULLED AND CONNECTED BY P.O.S. CONTRACTOR.

GENERAL NOTES

1. REFER TO ARCHITECTURAL SHEET A11.01 FOR ADDITIONAL INFORMATION.
2. WIRING DEVICES ARE SHOWN FOR REFERENCE ONLY. COORDINATE FINAL INSTALLATION LOCATION WITH LSD&C PROJECT MANAGER IN FIELD.
3. DATA TERMINALS AND CONNECTIONS BY P.O.S. CONTRACTOR.
4. RUN METAL CLAD (MC) CABLE TO EACH RECEPTACLE FROM JUNCTION BOXES THRU WIREWAY WITHIN CASHWRAP COUNTER.
5. WIRING FROM CONDUIT STUB-UPS TO JUNCTION BOXES ARE TO BE RUN IN FLEXIBLE CONDUIT.
6. LABEL AND TAG ALL PULLWIRE RUNS AT EACH END WITH ORIGIN/DESIGNATION.
7. IF FRONT PORTION OF CASHWRAP IS ADJACENT TO A WALL, CONTRACTOR SHALL ROUTE CONDUIT FROM THE BACKWRAP TO THE FRONT CASHWRAP THROUGH THE WALL ADJACENT TO CASHWRAP INSTEAD OF ROUTING THROUGH FLOOR.

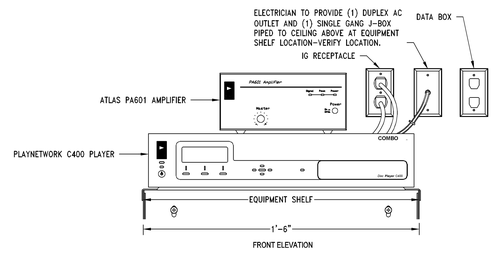

ALL SPEAKERS MUST BE SET TO CORRECT TAP POSITION
TAP SELECTOR IS LOCATED UNDER THE GRILL ON THE BOTTOM SIDE OF THE SPEAKER. USE A SCREWDRIVER TO ROTATE THE TAP SELECTOR TO THE '8' WATT SETTING ON THE '70V' SIDE.

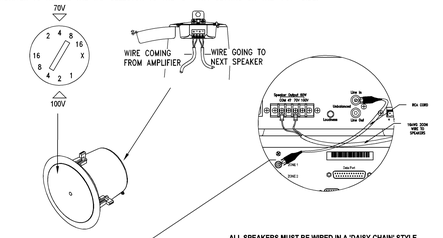

ALL SPEAKERS MUST BE WIRED IN A 'DAISY-CHAIN' STYLE
SEE DETAIL ABOVE FOR WIRING CONNECTIONS AT SPEAKER

NOTES:
1. ELECTRICIAN TO PROVIDE (1) SINGLE GANG J-BOX STUBBED TO CEILING ABOVE AT EQUIPMENT LOCATION FOR CABLE PULLS TO SPEAKERS LOCATIONS (COVER PLATE PROVIDED BY PLAYNETWORK).
2. ELECTRICIAN TO PROVIDE (1) DUPLEX A/C RECEPTABLE AT EQUIPMENT LOCATION FOR SYSTEM POWER.
3. SYSTEM ELECTRONICS TO BE LOCATED ON WALL MOUNTED SHELF (SHELF PROVIDED BY PLAYNETWORK).
4. ELECTRICIAN TO PROVIDE (1) SINGLE GANG J-BOX FOR DATA.

SOUND SYSTEM INSTALLATION DETAILS

3" = 1'-0" | 00D-E0402-C00-SOUN | C | 10.14.11

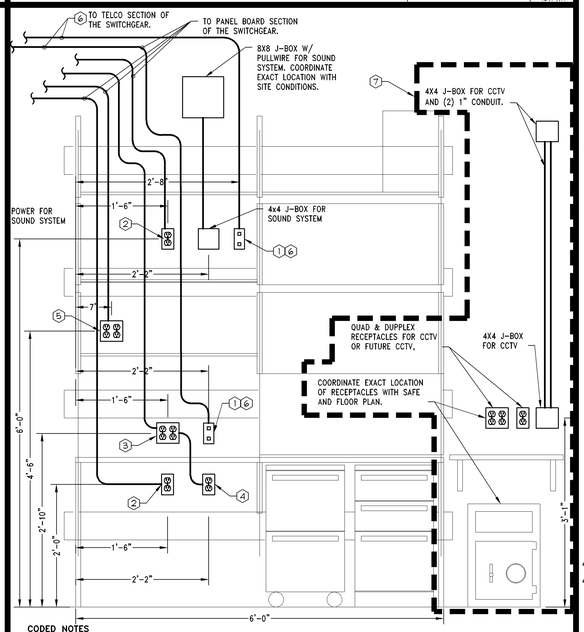

CODED NOTES

1. JUNCTION BOX FOR DATA, TELEPHONE, FAX, AND POLLING. INSTALL EMPTY 1" CONDUIT, WITH PULLWIRE, BACK TO TELCO SECTION OF IFS ENCLOSURE. DATA/TELEPHONE WIRE AND COVERPLATE BY OTHERS.
2. 20 AMP, 120 VOLT, SINGLE PHASE ISOLATED DEDICATED CIRCUIT, 20 AMP #IG6300-W RECEPTACLE, WITH ISOLATED THIRD WIRE GROUND, IN A SINGLE 1/2" CONDUIT BACK TO PANELBOARD SECTION OF IFS ENCLOSURE FOR COMPUTER TERMINAL. DO NOT SHARE ANY PART OF THIS CIRCUIT WITH ANY OTHER BRANCH CIRCUITS. CONNECT TO CIRCUIT SHOWN ON POWER PLAN.
3. 20 AMP, 120 VOLT CIRCUIT AND QUAD WHITE RECEPTACLE AND COVERPLATE FOR UTILITY POWER, IN A SINGLE 1/2" CONDUIT BACK TO PANELBOARD SECTION OF IFS ENCLOSURE. CONNECT TO CIRCUIT SHOWN ON POWER PLAN.
4. 20 AMP, 120 VOLT CIRCUIT AND DUPLEX RECEPTACLE FOR UTILITY POWER, IN A SINGLE 1/2" CONDUIT BACK TO PANELBOARD SECTION OF IFS ENCLOSURE. CONNECT TO CIRCUIT SHOWN ON POWER PLAN.
5. 20 AMP, 120 VOLT CIRCUIT AND QUAD RECEPTACLE FOR WALKIE TALKIE, IN A SINGLE 1/2" CONDUIT BACK TO PANELBOARD SECTION OF IFS ENCLOSURE. CONNECT TO CIRCUIT SHOWN ON POWER PLAN.
6. FOR INFORMATION REGARDING LOW VOLTAGE AND TELEPHONE SYSTEMS CONTACT LIMITED TECHNICAL SERVICES (LTS) AT 1-877-415-7911, OPTION 2. CANADA 1-877-211-5151, THEN 877# OR HELPDESK@LESENZA.COM.
7. WORK WITHIN THIS AREA IS REPLACED WITH DETAIL-K FOR IP CAMERA SYSTEM.

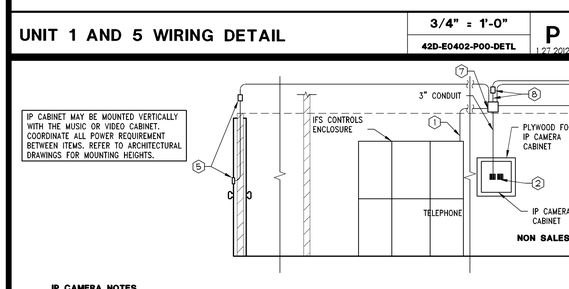

IP CAMERA NOTES

1. 1/2" CONDUIT AND PULL STRING FROM DATA SECTION OF IFS ENCLOSURE TO 8X8 JUNCTION BOX ABOVE CEILING OF IP CABINET.
2. (2) 20 AMP, 120 VOLT ISOLATED GROUND QUAD RECEPTACLES AND (2) CIRCUITS, WITH A 3/4" CONDUIT BACK TO PANELBOARD SECTION OF THE SWITCHGEAR. ALIGN OUTLETS WITH HOLE IN THE CENTER OF IP CABINET, REFER TO ARCHITECTURAL DRAWINGS.
3. 2X4 JUNCTION BOX FOR DATA. ELECTRICAL CONTRACTOR TO RUN A 1/2" EMPTY CONDUIT, WITH PULLWIRE TO 8X8 JUNCTION BOX, ABOVE IP CAMERA CABINET.
4. 20 AMP, 120 VOLT SINGLE PHASE ISOLATED DEDICATED CIRCUIT, 20 AMP #IG6300-W RECEPTACLE, WITH ISOLATED THIRD WIRE GROUND, IN A SINGLE 3/4" CONDUIT BACK TO PANELBOARD SECTION OF THE SWITCHGEAR FOR COMPUTER TERMINAL. DO NOT SHARE ANY PART OF THIS CIRCUIT WITH ANY OTHER BRANCH CIRCUITS.
5. KEYPAD PROVIDED AT LATCH SIDE OF BACKDOOR MOUNTED WITH TOP AT 48" A.F.F. PROVIDE 4X4 JUNCTION BOX ABOVE CEILING AT KEYPAD LOCATION WITH 1/2" CONDUIT AND PULLSTRING DOWN WALL TERMINATING NO LOWER THAN 50" A.F.F. CONTROLLER DEVICE IS MOUNTED TO THE FACE OF THE JUNCTION BOX. CONNECT 4X4 JUNCTION BOX TO 8X8 JUNCTION BOX ABOVE IP CABINET WITH 1/2" CONDUIT AND PULLSTRING. ENSURE THAT A MINIMUM 18X18 ACCESS PANEL PANEL IS PROVIDED IN CEILING FOR CONTROLLER.
6. IF REQUIRED BY LOCAL CODE, FURNISH AND INSTALL 4X4 JUNCTION BOX AT EACH CCTV DEVICE WITH 1/2" CONDUIT BACK TO 8x8 J-BOX.
7. 8X8 JUNCTION BOX ABOVE CEILING. 3" CONDUIT IN FRONT OF WALL TO TERMINATE INTO KNOCKOUT HOLE ON TOP OF IP CABINET.
8. PROVIDE 4X4 JUNCTION BOX ABOVE CEILING OF IP CABINET CONNECTED TO 8X8 JUNCTION BOX WITH 1/2" CONDUIT AND PULLSTRING.
9. PROVIDE 1/2" CONDUIT AND PULLSTRING FROM 4X4 JUNCTION BOX TO A 2X4 JUNCTION BOX WITH BLANK COVER PLATE IN WALL AT 48" A.F.F. ADJACENT TO A.L.L. SYSTEM. COORDINATE FINAL LOCATION WITH LSD&C PROJECT MANAGER.
10. PROVIDE 1/2" CONDUIT AND PULLSTRING FROM 4X4 JUNCTION BOX TO BE STUBBED UP INTO CASHWRAP FOR POTENTIAL PUSH-BUTTON INSTALLATION. (CONDUIT SHALL RUN ADJACENT TO OTHER CONDUIT IN CASHWRAP).
11. IP SYSTEM PUSH-BUTTON TO BE MOUNTED ADJACENT TO A.L.L. SYSTEM WHEN PRESENT. IF A.L.L. SYSTEM IS NOT PLANNED FOR INSTALLATION (VERIFY WITH LSD&C PROJECT MANAGER) THEN BUTTON SHALL BE INSTALLED INSIDE OF CASHWRAP.

IP CAMERA SYSTEM

1/4" = 1'-0" | 42D-E0402-K00-IPCM | K | 10/31/13

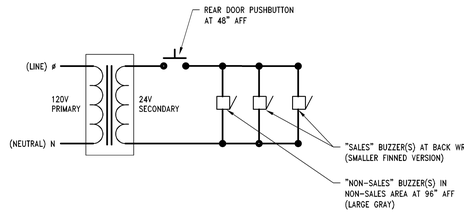

DELIVERY BUZZER SCHEMATIC

NTS | 00D-E0402-N00-BUZZ | N | 10.14.11

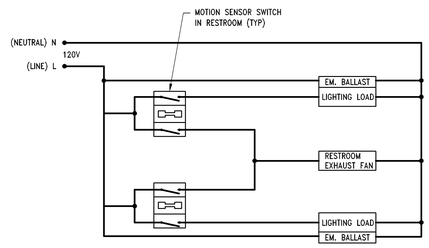

SCHEMATIC FOR 2 R.R EXHAUST FAN

NTS | 00D-E0402-J00-XFAN | J | 10.14.11

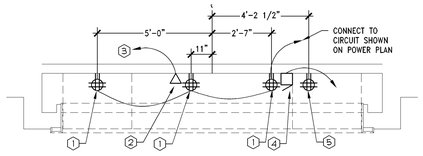

BACKWRAP COUNTER DETAIIL

BACKWRAP & TELE/DATA SYSTEM NOTES

1. 20 AMP, 120V, CIRCUIT FOR UTILITY POWER W/QUAD RECEPTACLE INSTALLED AT 12" A.F.F. DIRECTLY BEHIND CUTOUT IN BACKWRAP. CONNECT TO CIRCUIT AS SHOWN ON POWER PLAN.
2. TELEPHONE OUTLET ON INSIDE OF BACKWRAP UNIT INSTALLED AT 12" A.F.F. SEE NOTE (6). TELEPHONE WIRE AND #RJ14C JACK BY OTHERS.
3. 3/4" TELEPHONE CONDUIT WITH PULLWIRE TO TELEPHONE BOARD BY ELECTRICAL CONTRACTOR. #RJ14C JACK ON LINES #1 AND #2 FOR TELEPHONE BY OTHERS.
4. EDWARDS 1064-G5 BUZZER INSTALLED BY ELECTRICAL CONTRACTOR AT 12" A.F.F.. SEE POWER PLAN FOR ADDITIONAL INFORMATION.
5. 20 AMP, 120V, CIRCUIT FOR UTILITY POWER W/QUAD RECEPTACLE INSTALLED AT 7'-10 1/2" A.F.F. AT FRAME FOR THE ILLUMINATED MARKETING FRAME (WHERE APPLICABLE). CONNECT TO CIRCUIT AS SHOWN ON POWER PLAN.

GENERAL NOTES

1. REFER TO ARCHITECTURAL SHEET A11.01 FOR ADDITIONAL INFORMATION.
2. WIRING DEVICES ARE SHOWN FOR REFERENCE ONLY. COORDINATE FINAL INSTALLATION LOCATION WITH LSD&C PROJECT MANAGER IN FIELD.
3. DATA TERMINALS AND CONNECTIONS BY P.O.S. CONTRACTOR.
4. LABEL AND TAG ALL PULLWIRE RUNS AT EACH END WITH ORIGIN/DESIGNATION.

BACKWRAP P1 & P2 US-B1

3/8" = 1'-0" | 42D-E0402-E00-P1B1 | E | 02/14/14

MANAGER'S WORK STATION DETAIL

1" = 1'-0" | 42D-E0402-A00-MANG | A | 10.14.11

LARSON BINKLEY
Larson Binkley, Inc.
310 W 20th Street, Suite 200
Kansas City, Missouri 64108
Texas Certificate of Authorization Number F-1367
T 816-997-9601
F 816-997-9602
larsonbinkley.com

Limitedbrands
LIMITED STORE PLANNING, INC.
d/b/a STORE DESIGN & CONSTRUCTION
Three Limited Parkway • Columbus, Ohio 43230
Telephone: 614.415.7000 • Fax: 614.415.7349

THESE DRAWINGS ARE COPYRIGHTED AND SUBJECT TO COPYRIGHT PROTECTION AS AN "ARCHITECTURAL WORK" UNDER SECTION 102 OF THE COPYRIGHT ACT, 17 U.S.C. AS AMENDED DECEMBER 1990. THE ARCHITECTURAL WORKS PROTECTION ACT (AWPA) EFFECTIVE DECEMBER 1, 1990, IS NOT RETROACTIVE AND APPLIES ONLY TO BUILDINGS CREATED FROM THAT DATE FORWARD. THE AWPA PROTECTS ORIGINAL ARCHITECTURAL WORKS, INCLUDING BUILDINGS, AS WELL AS ARCHITECTURAL PLANS, DRAWINGS AND MODELS. THESE DRAWINGS ARE THE PROPERTY OF LSD AND SHALL NOT BE DISPLAYED IN PUBLICATIONS, OR REPRODUCED OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN PERMISSION OF LSD. IN THE EVENT OF UNAUTHORIZED REPRODUCTION OF THESE PLANS AND SPECIFICATIONS, LSD SHALL BE ENTITLED TO RECOVER ITS ATTORNEY'S FEES AND COURT COSTS. THESE DRAWINGS ARE COPYRIGHTED AND SUBJECT TO COPYRIGHT PROTECTION AS AN "ARCHITECTURAL WORK" UNDER SECTION 102 OF THE COPYRIGHT ACT, 17 U.S.C. AS AMENDED DECEMBER 1990. THE ARCHITECTURAL WORKS PROTECTION ACT (AWPA) EFFECTIVE DECEMBER 1, 1990, IS NOT RETROACTIVE AND APPLIES ONLY TO BUILDINGS CREATED FROM THAT DATE FORWARD. THE AWPA PROTECTS ORIGINAL ARCHITECTURAL WORKS, INCLUDING BUILDINGS, AS WELL AS ARCHITECTURAL PLANS, DRAWINGS AND MODELS. THESE DRAWINGS ARE THE PROPERTY OF LSD AND SHALL NOT BE DISPLAYED IN PUBLICATIONS, OR REPRODUCED OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN PERMISSION OF LSD. IN THE EVENT OF UNAUTHORIZED REPRODUCTION OF THESE PLANS AND SPECIFICATIONS, LSD SHALL BE ENTITLED TO RECOVER ITS ATTORNEY'S FEES AND COURT COSTS. THESE DRAWINGS ARE COPYRIGHTED AND SUBJECT TO COPYRIGHT PROTECTION AS AN "ARCHITECTURAL WORK" UNDER SECTION 102 OF THE COPYRIGHT ACT, 17 U.S.C. AS AMENDED DECEMBER 1990. THE ARCHITECTURAL WORKS PROTECTION ACT (AWPA) EFFECTIVE DECEMBER 1, 1990, IS NOT RETROACTIVE AND APPLIES ONLY TO BUILDINGS CREATED FROM THAT DATE FORWARD. THE AWPA PROTECTS ORIGINAL ARCHITECTURAL WORKS, INCLUDING BUILDINGS, AS WELL AS ARCHITECTURAL PLANS, DRAWINGS AND MODELS. THESE DRAWINGS ARE THE PROPERTY OF LSD AND SHALL NOT BE DISPLAYED IN PUBLICATIONS, OR REPRODUCED OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN PERMISSION OF LSD. IN THE EVENT OF UNAUTHORIZED REPRODUCTION OF THESE PLANS AND SPECIFICATIONS, LSD SHALL BE ENTITLED TO RECOVER ITS ATTORNEY'S FEES AND COURT COSTS.

024200396

BATH & BODY WORKS
MEMORIAL CITY MALL
303 MEMORIAL CITY WAY
SUITE 733
HOUSTON, TX 77024

PROJECT INFORMATION:
SCOPE: RELO DWN / NEW | PACKAGE: 1
DESIGN TYPE: EASTON-G GENERATION: 141Sa
LSD&C PROJECT #: 60685 A/E PROJECT #: 13643

REVISIONS:

	REQUIRED BY	DATE
1 STOREFRONT REVISION - REV 1		6/10/2014
2 REVISION 2 - LL / PERMIT COMMENTS		6/27/2014

ELITE CONSTRUCTION GROUP
LAKE JACKSON, TX
PHONE: 979-285-0712
NOTE: THESE PRINTS HAVE BEEN REDUCED BY 50 PERCENT. SCALE WILL BE 50 PERCENT OF WHAT IS NOTED ON PLANS

DATE ISSUED: 04/11/2014
DESIGNED BY: PFB
DRAWN BY: PFB
CHECKED BY: TWD

ELECTRICAL DETAILS

DRAWING NUMBER:
E04.02